


NEUTRAL OUTPUT BUS FOR
(4) 225A SUBFEEDS,
OR (8) 225A SUBFEEDS,
OR COMBINATION OF (4) 225A SUBFEEDS AND (2) 400A SUBFEEDS

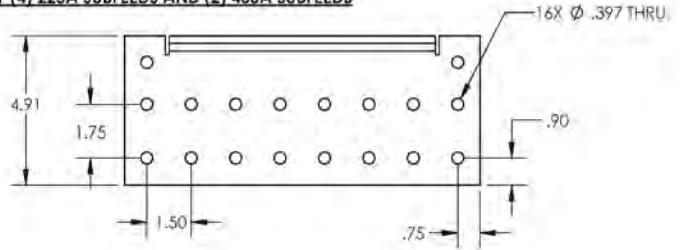


Top cable exit:
 Neutral Busbar for
 subfeeds is placed at
 top of section (225A
 neutral busbar shown).

Distribution Output, top
 module, subfeeds

Distribution Output,
 bottom module, not
 occupied


Bottom cable exit:
 Neutral Busbar is
 placed at bottom of
 section (not shown).

Ground Busbar for subfeeds is
 always at bottom of section
 whether cable exit is from the
 top or bottom.

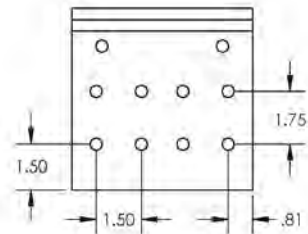

NEUTRAL OUTPUT BUS FOR
(4) 400A SUBFEEDS,

DO NOT USE
 PDI CONNECTION ONLY

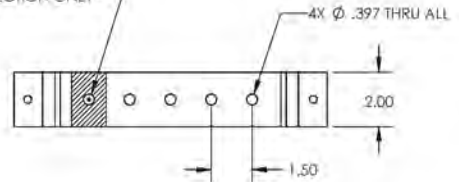

GROUND OUTPUT BUS FOR SUBFEED OPTION