


# SINGLE CABINET RPP AND BYPASS

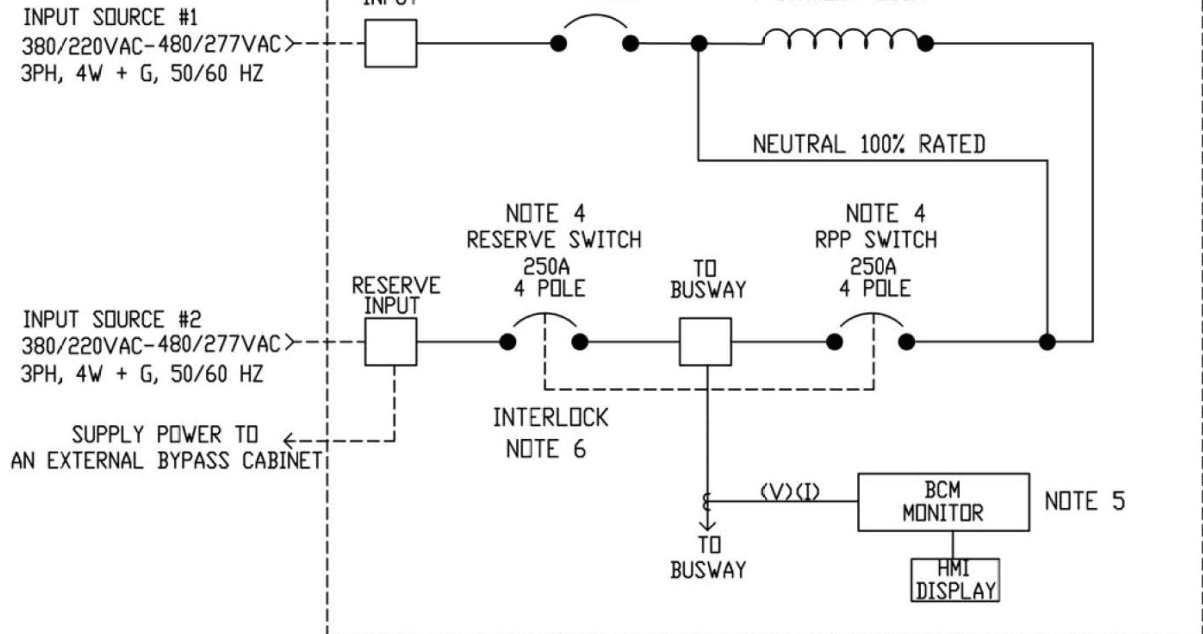

6. MECHANICAL POWER TRANSFER BAR.
5. MONITOR SYSTEM: BCM AND HMI DISPLAY.
4. RESERVE SWITCH AND RPP SWITCH: SEE TABLE ABOVE
3. SWITCHBOARD CABINET STANDARD: UL 891 AND IEC 61439
2. HARMONIC FILTERING CURRENT LIMITING REACTOR -158  $\mu$ H  $\pm$  1% .  
AIR CORE INDUCTANCE OF 73.5  $\mu$ H -3% +10%, TEMPERATURE RISE 80°C
1. MAIN CB: SEE TABLE

NOTES: