


24VDC power from  
PDU M4G Board

REPO signal to  
PDU M4G Board

Modbus  
Upstream  
(RJ12 to Color  
Monitor)

Modbus  
Downstream  
(RJ12 to Color  
Monitor)

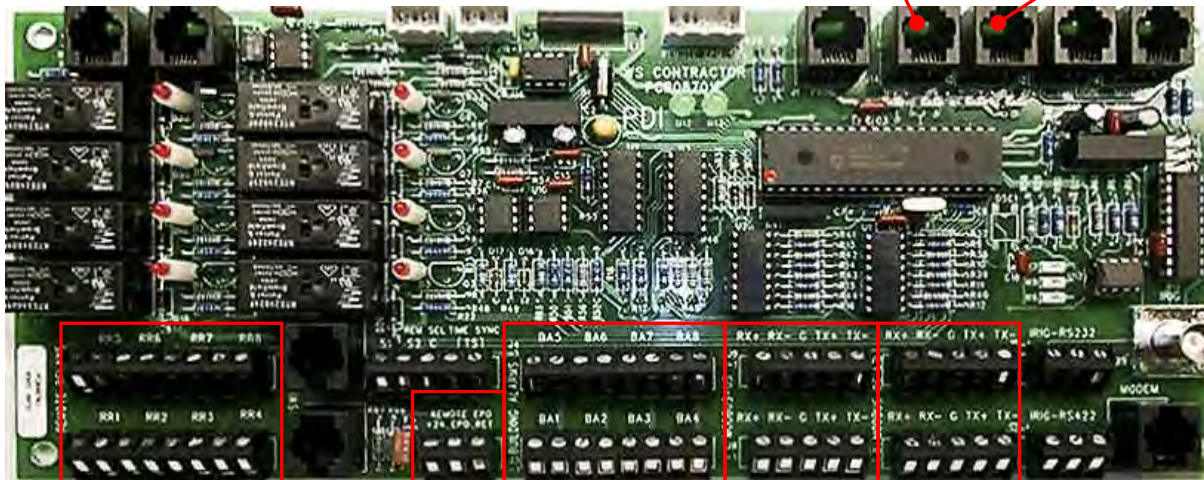

Outputs:

- Remote Relays
- RR1-RR8
- Dry contacts (NO)

Input:

- Remote EPO  
Connection (Dry  
contacts (NO))

Inputs:

- Building Alarms  
BA1-BA8 (Dry  
contacts (NO))

Modbus  
Upstream:  
paralleled  
connectors

Modbus  
Downstream:  
paralleled  
connectors

**NOTE: Customer connections are all at the bottom of the board.**