




REV.	DESCRIPTION	DATE	APPROVED
XD	SUBMITTAL RELEASE	5/27/16	LG

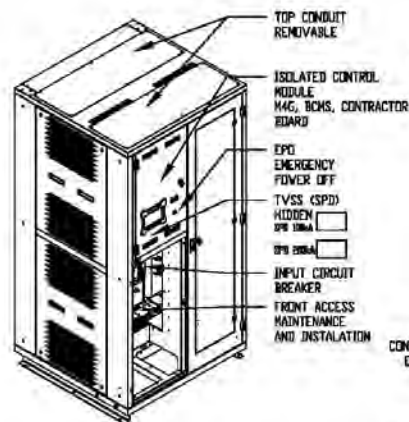


ISO VIEW

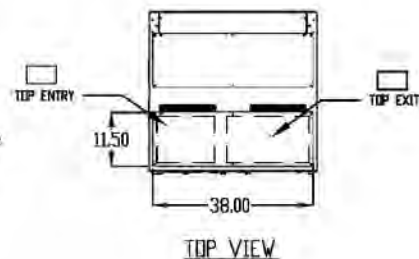


TOP VIEW

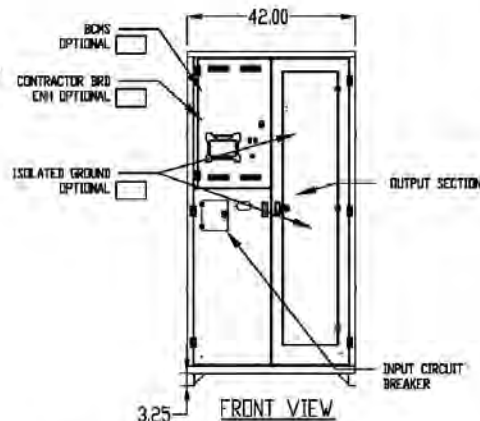

FRONT VIEW

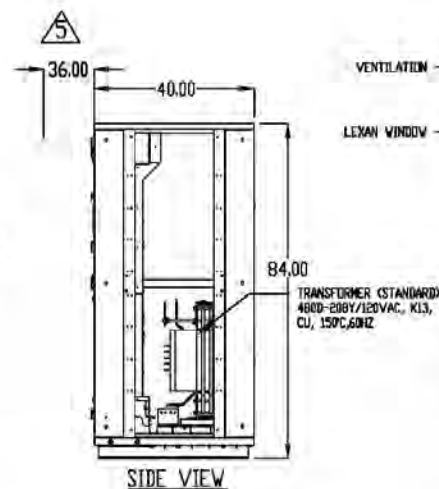


SIDE VIEW

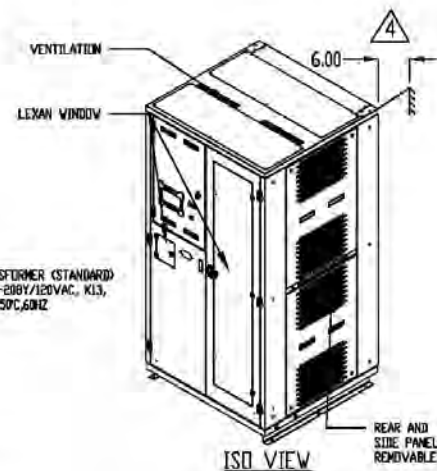

ISO VIEW

- △ INPUT CIRCUIT BREAKER BOTTOM OFFER MECHANICAL LUGS ONLY FOR WIRES LANDING
- △ THE DEPTH OF THE UNIT DEPENDING ON TRANSFORMER SPECIFICATIONS THE DIMENSION MAY VARY FROM PRELIMINARY TO ACTUAL SUBMITTAL
- 10. CONSULT NATIONAL ELECTRIC CODE (NEC) AND LOCAL REGULATIONS
- 9. ALL CUSTOMER SUPPLIED CABLE CONNECTIONS BASED ON 75°C CU OR AL
- 8. COLOR ISM PEARL WHITE AND BLACK OTHER COLOR OPTIONAL
- △ CONSULT THE FACTORY FOR TRANSFORMER SIZE

- △ MINIMUM CLEARANCE FOR LUGS
- △ MINIMUM VENTILATION CLEARANCE FOR REAR AND ONE SIDE
- △ ALL OPERATORS CONTROLS ARE FRONT ACCESS WITHOUT EXPOSURE TO LIVE PARTS
- 2. FRONT ACCESS INSTALLATION AND MAINTENANCE
- 1. ALL DIMENSION ARE IN INCHES
- NOTES: UNLESS OTHERWISE SPECIFIED

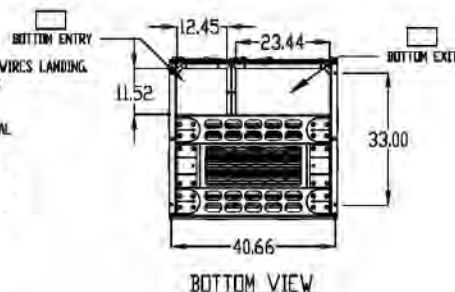

BOTTOM VIEW