
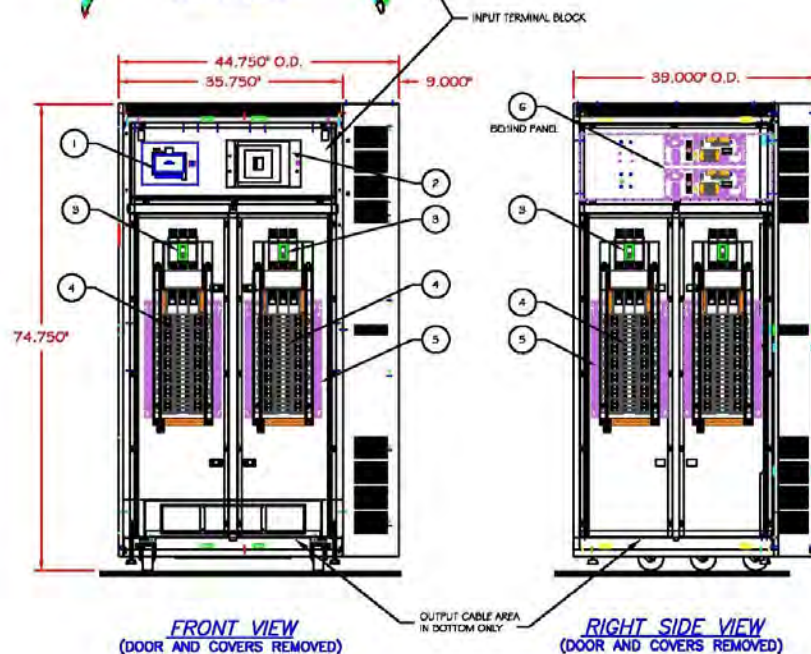


PdUs with 200-300 kVA transformers have 6.25" rear spacers.

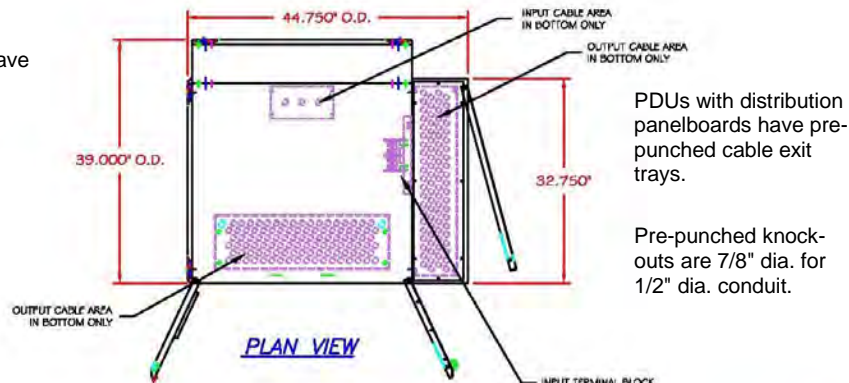

NOTES:

1. OPERATOR INTERFACE PANEL.
2. MAIN INPUT CIRCUIT BREAKER.
3. 225A SECONDARY MAIN CIRCUIT BREAKER.
4. (42) POLE DISTRIBUTION PANELBOARDS.
5. CT STRIPS FOR BCMS.
6. BCMS CIRCUIT BOARDS.
7. RECOMMEND A MINIMUM OF 30" IN REAR OR SIDE OF UNIT FOR MAINTENANCE.
8. MINIMUM OF 36" CLEARANCE FOR DOOR SWING.
9. RECOMMEND 6" CLEARANCE BETWEEN VENTILATED SIDES AND WALL FOR PROPER COOLING.