

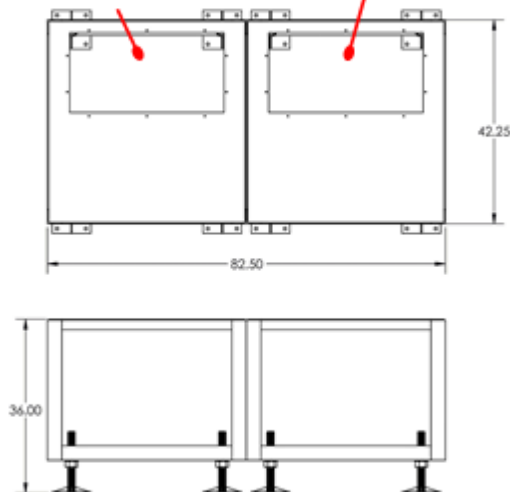


PDI recommends that the optional left cover be removed to provide additional air flow to the unit.

Remove optional right cover for cable entry to the unit.



STS is attached to floor stand at sides using brackets. See next illustration.

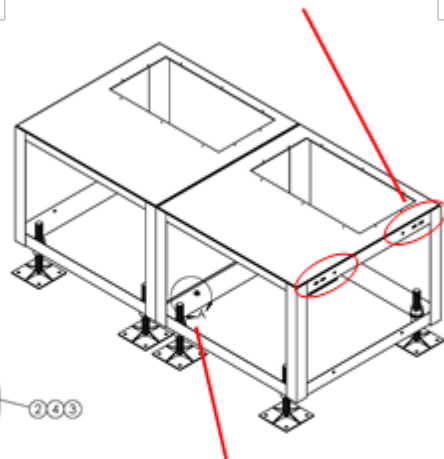

Floor stands for 1000A STS units are shipped as a pair of floor stands and must be bolted together at customer site using hardware provided (see parts list at left.)

| ITEM NO. | PART NUMBER | Description1                      | QTY. |
|----------|-------------|-----------------------------------|------|
| 1        | MIS20119-1  | FLOOR STAND, 89" X 42-5/16" X 36" | 2    |
| 2        | REFERENCE   | 1/2-13 X 1.75" HEX HEAD BOLT      | 4    |
| 3        | REFERENCE   | 1/2 SPLIT WASHER                  | 4    |
| 4        | REFERENCE   | 1/2-13 HEX NUT                    | 4    |