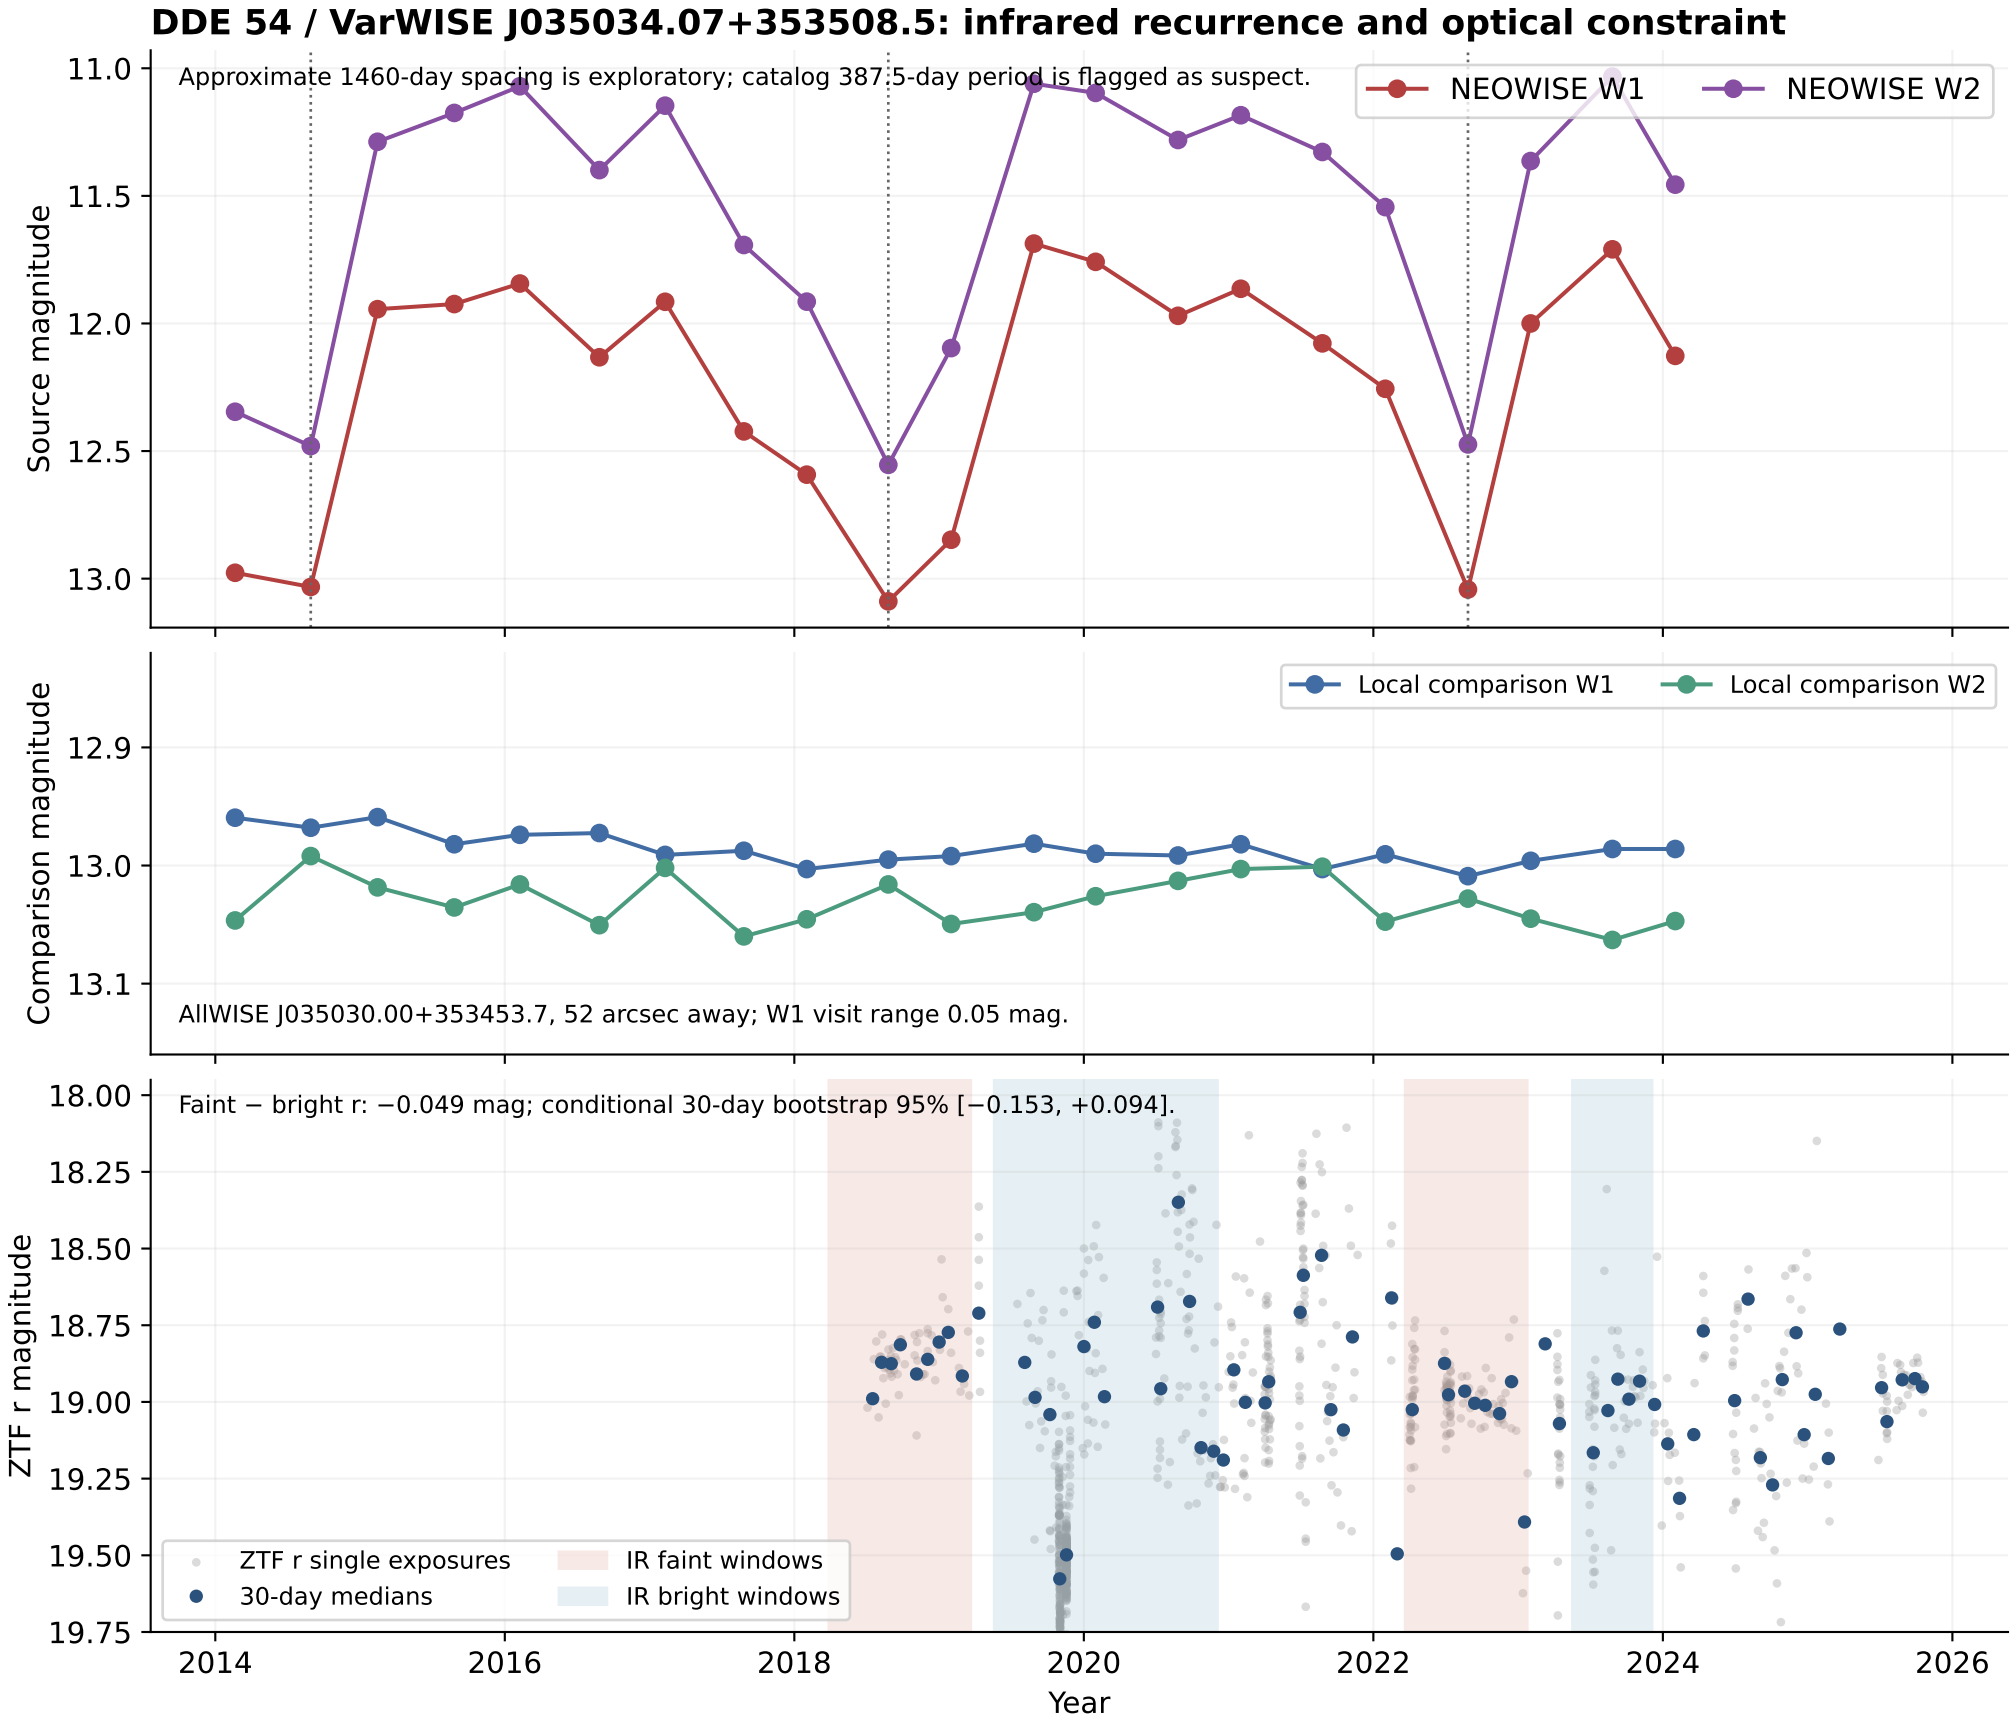
DDE 54 / VarWISE J035034.07+353508.5: infrared recurrence and optical constraint
Approximate 1460-day spacing is exploratory; catalog 387.5-day period is flagged as suspect.
NEOWISE W1
NEOWISE W2
Source magnitude
11.0
11.5
12.0
12.5
13.0
Local comparison W1
Local comparison W2
Comparison magnitude
12.9
13.0
13.1
AllWISE J035030.00+353453.7, 52 arcsec away; W1 visit range 0.05 mag.
Faint − bright r: −0.049 mag; conditional 30-day bootstrap 95% [−0.153, +0.094].
ZTF r magnitude
18.00
18.25
18.50
18.75
19.00
19.25
19.50
19.75
ZTF r single exposures
30-day medians
IR faint windows
IR bright windows
2014
2016
2018
2020
2022
2024
2026
Year