Perforated tray

Villa Complex 415V LV Network · REV — · 15 October 2026

2 tiers × 600 × 50 mm — fill 17 %


Basis

Containment	Perforated tray
Laying	Spaced one diameter apart
Side height	50 mm
Spare	25 %

Cables

Cable	Size	Qty	OD (mm)	kg/m each
Sub-main	4C × 95 mm²	3	41.7	5.40
Feeders	4C × 25 mm²	6	28.9	2.00
Final circuits	4C × 6 mm²	8	18.7	0.80
Total		**17**	Σ 448	34.6 kg/m

Cross-section (to scale)

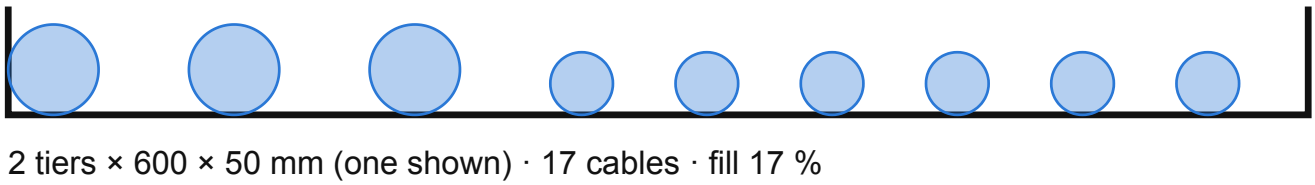

2 tiers × 600 × 50 mm (one shown) · 17 cables · fill 17 %

Grouping factor for the cables on the tray: **0.87** (IEC 60364-5-52 Table B.52.20).

Notes

- Spaced one diameter apart: the grouping factor is the better (spaced) one

Factors are typical IEC 60364-5-52 values; confirm with the cable manufacturer's data. * diameter from the next size in the cable data.