


PROJECT INFORMATION		CHAMBER SPECIFICATION		COMPLIANCE		
Configuration ref	3F9C2A71	System	Surface water	STANDARD	SCOPE	STATUS
Quote ref	Not yet quoted	External diameter	1050 mm	DCG Section C7.1.1	Sediment Management - Adoptable	PASS
Date issued	23 Sep 2026	Depth to outlet soffit	3000 mm	Sewers for Adoption 7th Ed. (SfA7)	Adoptable Sewer Standards	PASS
Drawing no.	SE-DRG-SERSIC1050-3000-S104	Overall height	3615 mm	BS EN 13598-2 (2009)	Plastic Inspection Chambers	PASS
Product	Inspection chamber	Sump below outlet invert	350 mm	Building Regulations Part H1	Surface Water Drainage	PASS
Series	RHINO SERSIC SERIES	Adoption	S104 adoptable	DCG Parts B and C	Minimum 50mm fall from side inlets to main channel	PASS
Status	PASS Rule checks passed	Maximum depth	3000 mm (S104)	DCG Restricted Access (350mm > 1m depth)	Manhole Cover Compliance	PASS
		Access	Reducing cap, Ø600 clear opening	Outlet rule - no flow increase on exit	Rule Engine Validation	PASS
		Cover	D400 cover and frame			
		Material	HDPE, BS EN 13598-2			


PIPEWORK						
REF	POSITION	ANGLE	SIZE		INVERT H	CENTRE H
OUT	12 o'clock	0°	Ø225 Twinwall	LOCKED R2	350	463
IN1	3 o'clock	90°	Ø225 Twinwall		350	463
IN2	5 o'clock	150°	Ø160 EN1401		424	500
IN3	6 o'clock	180°	Ø160 EN1401		424	500
IN4	7 o'clock	210°	Ø110 EN1401		471	523
IN5	9 o'clock	270°	Ø160 EN1401		424	500
Heights in mm above the internal base. Outlet fixed at 12 o'clock (0°, north); angles clockwise from north. Inlet soffits aligned with the outlet soffit. No flow control selected.						

RULE ENGINE LOG			
RULE	CHECK	RESULT	STATUS
R1	Maximum inlets	5 of 5 inlets allowed for a 1050mm chamber.	PASS
R2	Outlet minimum size	5 inlets need at least a Ø225 twinwall outlet. Outlet locked at Ø225 TW.	PASS
R3	Blocked positions	None. The outlet at 12 o'clock does not block any inlet position.	PASS
R4	Maximum depth	3000mm selected, 3000mm maximum (S104 adoptable).	PASS
R5	Outlet position	Outlet fixed at 12 o'clock (0°). Inlets at 3, 5, 6, 7, 9 o'clock.	PASS
R6	No flow increase on exit	No inlet is larger than the Ø225 TW outlet.	PASS
R7	Maximum pipe size	All pipes within the Ø300 maximum for a 1050mm chamber.	PASS

PLAN VIEW (COVER REMOVED) | SCALE 1:20

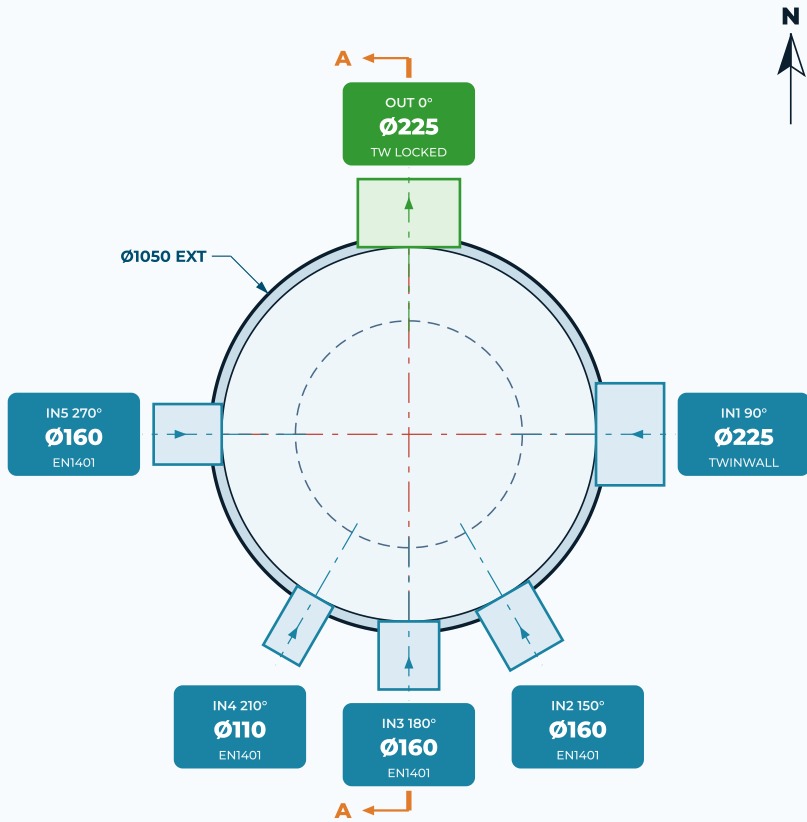

SECTION A-A LOOKING WEST | SCALE 1:20 | SHAFT SHOWN BROKEN

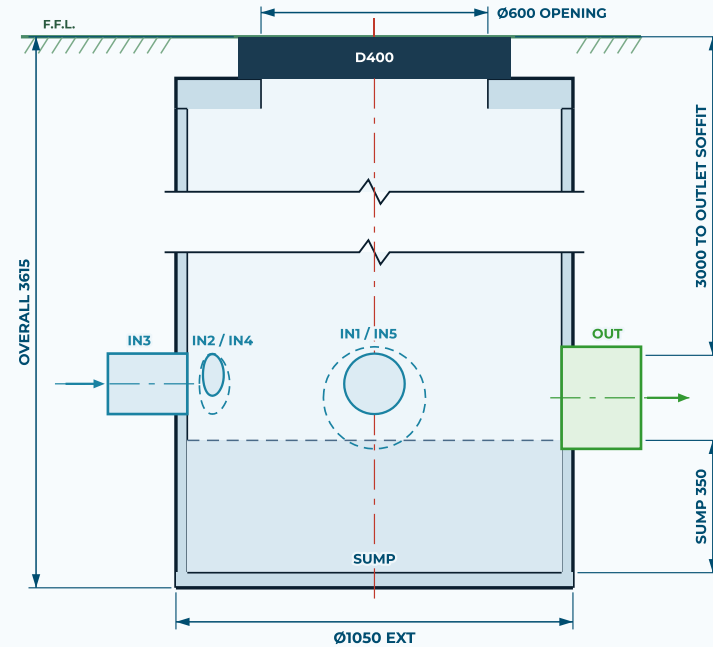

PIPE SCHEDULE

REF	POSITION	ANGLE	SIZE	H
OUT	12 o'clock	0°	Ø225 TW (R2)	463
IN1	3 o'clock	90°	Ø225 TW	463
IN2	5 o'clock	150°	Ø160 EN1401	500
IN3	6 o'clock	180°	Ø160 EN1401	500
IN4	7 o'clock	210°	Ø110 EN1401	523
IN5	9 o'clock	270°	Ø160 EN1401	500

H = CENTRELINE ABOVE INTERNAL BASE (mm).
INLET SOFFITS ALIGNED WITH OUTLET SOFFIT.

BILL OF MATERIALS

#	DESCRIPTION	MATERIAL	QTY	PART NO.
1	Chamber body and base	HDPE, BS EN 13598-2	1	SE-SERSIC1050-BODY
2	Riser shaft sections	HDPE	A/R	SE-SERSIC1050-RISER
3	Reducing cap to Ø600 opening	HDPE	1	SE-CAP-1050-600
4	D400 cover and frame	Ductile iron, BS EN 124	1	SE-COVER-D400
5	Pipe sealing rings	EPDM, BS EN 681-1	6	SE-SEAL-EPDM
6	Access steps	GRP, BS EN 13101	Set	SE-STEP-GRP

GENERAL NOTES

- ALL DIMENSIONS IN MILLIMETRES UNLESS STATED. DO NOT SCALE FROM THIS DRAWING.
- OUTLET FIXED AT 12 O'CLOCK (0° NORTH). INLET ANGLES ARE MEASURED CLOCKWISE FROM NORTH. INLETS ARE MANUFACTURED AT 3, 5, 6, 7 AND 9 O'CLOCK ONLY.
- OUTLET SIZE Ø225 TWINWALL IS RULE-ENGINE LOCKED (R2, 5 INLETS). DO NOT REDUCE.
- INLET SOFFITS ARE ALIGNED WITH THE OUTLET SOFFIT. H IS THE PIPE CENTRELINE HEIGHT ABOVE THE INTERNAL BASE.
- SUMP DEPTH 350mm IS MEASURED FROM THE OUTLET INVERT TO THE INTERNAL BASE.
- DEPTH IS MEASURED FROM COVER LEVEL TO THE OUTLET SOFFIT. MAXIMUM 3000mm S104 ADOPTABLE, 6000mm PRIVATE.
- PIPE JOINT SEALS TO BS EN 681-1. LUBRICATE TO THE MANUFACTURER'S SPECIFICATION.
- TOLERANCES: LINEAR +/-5mm, ANGULAR +/-1°. THIRD ANGLE PROJECTION.

SE

SuDS Enviro Ltd

The Home of SuDS Rhino

01224 057 700 | sales@sudsenvirono.com

9 Ambleside Court

Chester-le-Street DH3 2EB

INSPECTION CHAMBER

RHINO SERSIC SERIES

Ø1050mm x 3000mm to outlet soffit | HDPE, BS EN 13598-2

Surface water | S104 adoptable | 5 inlets

CODE SERSIC1050-3000-S104

DRG NO.

SE-DRG-SERSIC1050-3000-S104

DATE

23 Sep 2026

SHEET

2 of 2

REVISION

A

SCALE (A4)

PLAN 1:20
SECTION 1:20

PROJECTION



THIRD ANGLE

DRAWN BY

Configurator

CHECKED

Review required

APPROVED

Pending