



PROJECT INFORMATION		CHAMBER SPECIFICATION		COMPLIANCE		
Configuration ref	3F9C2A71	System	Surface water	STANDARD	SCOPE	STATUS
Quote ref	Not yet quoted	External diameter	1200 mm	DCG Section C7.1.1	Sediment Management - Adoptable	PASS
Date issued	23 Sep 2026	Depth to outlet soffit	6000 mm	Sewers for Adoption 7th Ed. (SfA7)	Adoptable Sewer Standards	PASS
Drawing no.	SE-DRG-SERSIC1200-6000-PRIV	Overall height	6690 mm	BS EN 13598-2 (2009)	Plastic Inspection Chambers	PASS
Product	Inspection chamber	Sump below outlet invert	350 mm	Building Regulations Part H1	Surface Water Drainage	PASS
Series	RHINO SERSIC SERIES	Adoption	Private (non-adoptable)	DCG Parts B and C	Minimum 50mm fall from side inlets to main channel	PASS
Status	PASS Rule checks passed	Maximum depth	6000 mm (private)	DCG Restricted Access (350mm > 1m depth)	Manhole Cover Compliance	PASS
		Access	Reducing cap, Ø600 clear opening	Outlet rule - no flow increase on exit	Rule Engine Validation	PASS
		Cover	D400 cover and frame			
		Material	HDPE, BS EN 13598-2			

PIPEWORK							RULE ENGINE LOG			
REF	POSITION	ANGLE	SIZE		INVERT H	CENTRE H	RULE	CHECK	RESULT	STATUS
OUT	12 o'clock	0°	Ø300 Twinwall	R2 MIN Ø225	350	500	R1	Maximum inlets	5 of 5 inlets allowed for a 1200mm chamber.	PASS
IN1	3 o'clock	90°	Ø300 Twinwall		350	500	R2	Outlet minimum size	5 inlets need at least a Ø225 twinwall outlet. Outlet locked at Ø300 TW.	PASS
IN2	5 o'clock	150°	Ø225 Twinwall		425	538	R3	Blocked positions	None. The outlet at 12 o'clock does not block any inlet position.	PASS
IN3	6 o'clock	180°	Ø300 Twinwall		350	500	R4	Maximum depth	6000mm selected, 6000mm maximum (private).	PASS
IN4	7 o'clock	210°	Ø160 EN1401		499	575	R5	Outlet position	Outlet fixed at 12 o'clock (0°). Inlets at 3, 5, 6, 7, 9 o'clock.	PASS
IN5	9 o'clock	270°	Ø225 Twinwall		425	538	R6	No flow increase on exit	No inlet is larger than the Ø300 TW outlet.	PASS
Heights in mm above the internal base. Outlet fixed at 12 o'clock (0°, north); angles clockwise from north. Inlet soffits aligned with the outlet soffit. Vortex flow control on the outlet, 12 L/s.							R7	Maximum pipe size	All pipes within the Ø300 maximum for a 1200mm chamber.	PASS

PLAN VIEW (COVER REMOVED) | SCALE 1:25

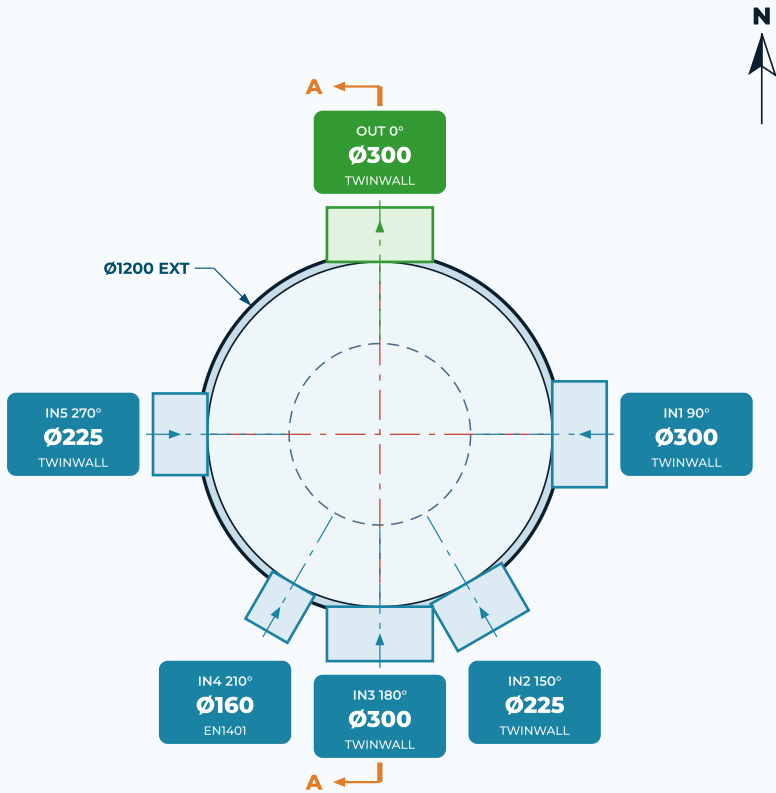

SECTION A-A LOOKING WEST | SCALE 1:25 | SHAFT SHOWN BROKEN

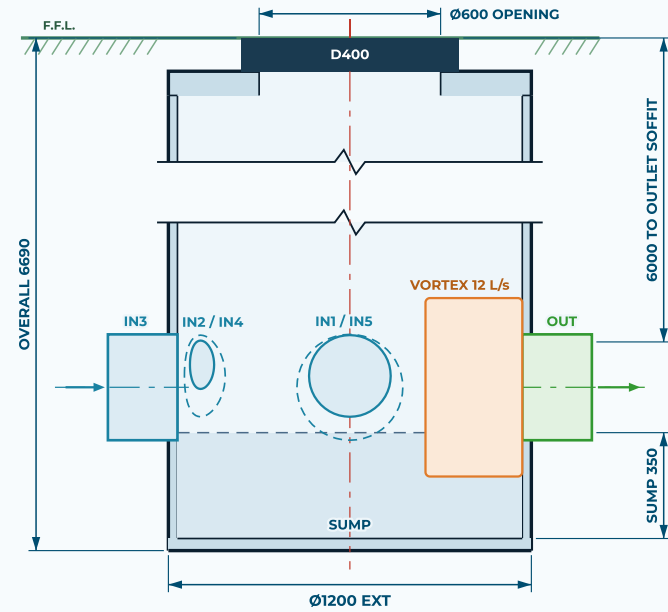

PIPE SCHEDULE

REF	POSITION	ANGLE	SIZE	H
OUT	12 o'clock	0°	Ø300 TW	500
IN1	3 o'clock	90°	Ø300 TW	500
IN2	5 o'clock	150°	Ø225 TW	538
IN3	6 o'clock	180°	Ø300 TW	500
IN4	7 o'clock	210°	Ø160 EN1401	575
IN5	9 o'clock	270°	Ø225 TW	538

H = CENTRELINE ABOVE INTERNAL BASE (mm).
INLET SOFFITS ALIGNED WITH OUTLET SOFFIT.

FLOW CONTROL

Vortex unit on the outlet, 12 L/s.

BILL OF MATERIALS

#	DESCRIPTION	MATERIAL	QTY	PART NO.
1	Chamber body and base	HDPE, BS EN 13598-2	1	SE-SERSIC1200-BODY
2	Riser shaft sections	HDPE	A/R	SE-SERSIC1200-RISER
3	Reducing cap to Ø600 opening	HDPE	1	SE-CAP-1200-600
4	D400 cover and frame	Ductile iron, BS EN 124	1	SE-COVER-D400
5	Pipe sealing rings	EPDM, BS EN 681-1	6	SE-SEAL-EPDM
6	Vortex flow control, 12 L/s	Stainless steel 316	1	SE-VFC-12LS
7	Access steps	GRP, BS EN 13101	Set	SE-STEP-GRP

GENERAL NOTES

- ALL DIMENSIONS IN MILLIMETRES UNLESS STATED. DO NOT SCALE FROM THIS DRAWING.
- OUTLET FIXED AT 12 O'CLOCK (0°, NORTH). INLET ANGLES ARE MEASURED CLOCKWISE FROM NORTH. INLETS ARE MANUFACTURED AT 3, 5, 6, 7 AND 9 O'CLOCK ONLY.
- OUTLET MINIMUM Ø225 TWINWALL IS RULE-ENGINE LOCKED (R2, 5 INLETS). Ø300 TWINWALL SPECIFIED. DO NOT REDUCE.
- INLET SOFFITS ARE ALIGNED WITH THE OUTLET SOFFIT. H IS THE PIPE CENTRELINE HEIGHT ABOVE THE INTERNAL BASE.
- SUMP DEPTH 350mm IS MEASURED FROM THE OUTLET INVERT TO THE INTERNAL BASE.
- DEPTH IS MEASURED FROM COVER LEVEL TO THE OUTLET SOFFIT. MAXIMUM 3000mm S104 ADOPTABLE, 6000mm PRIVATE.
- VORTEX FLOW CONTROL ON THE OUTLET, 12 L/s. DESIGN HEAD TO BE CONFIRMED WITH SuDS ENVIRO.
- PIPE JOINT SEALS TO BS EN 681-1. LUBRICATE TO THE MANUFACTURER'S SPECIFICATION.
- TOLERANCES: LINEAR +/-5mm, ANGULAR +/-1°. THIRD ANGLE PROJECTION.

SE**SuDS Enviro Ltd**

The Home of SuDS Rhino

01224 057 700 | sales@sudsenvirono.com

9 Ambleside Court

Chester-le-Street DH3 2EB

INSPECTION CHAMBER**RHINO SERSIC SERIES**

Ø1200mm x 6000mm to outlet soffit | HDPE, BS EN 13598-2

Surface water | Private (non-adoptable) | 5 inlets

CODE SERSIC1200-6000-PRIV

DRG NO.

SE-DRG-SERSIC1200-6000-PRIV

DATE

23 Sep 2026

SHEET

2 of 2

REVISION

A

SCALE (A4)

**PLAN 1:25
SECTION 1:25**

PROJECTION



THIRD ANGLE

DRAWN BY

Configurator

CHECKED

Review required

APPROVED

Pending