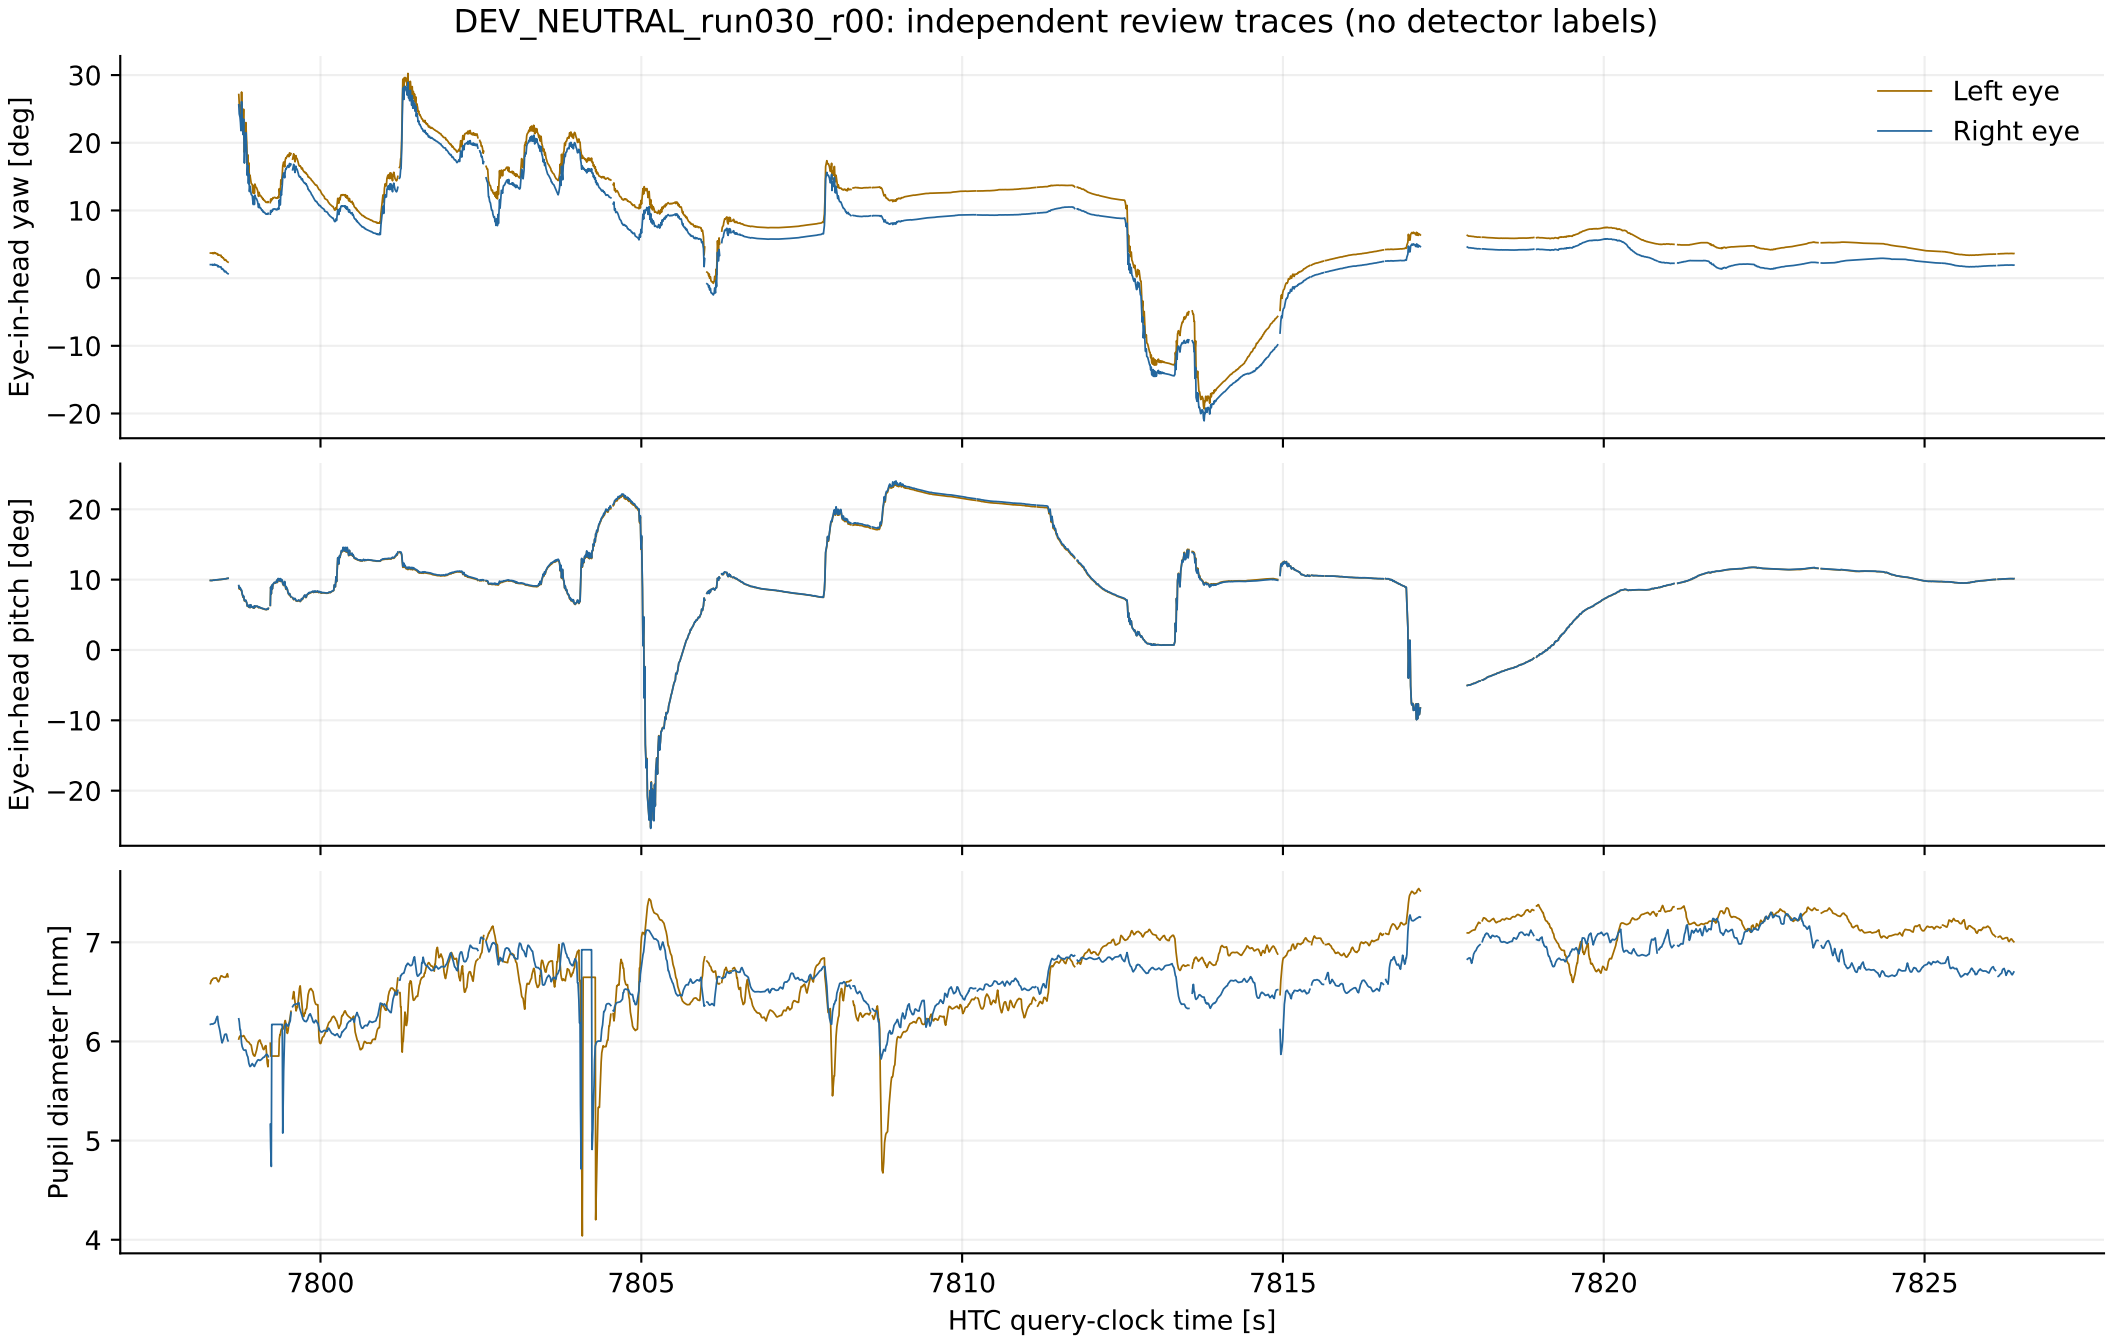

DEV_NEUTRAL_run030_r00: independent review traces (no detector labels)
Left eye
Right eye
Eye-in-head yaw [deg]
Eye-in-head pitch [deg]
Pupil diameter [mm]
HTC query-clock time [s]
7800
7805
7810
7815
7820
7825