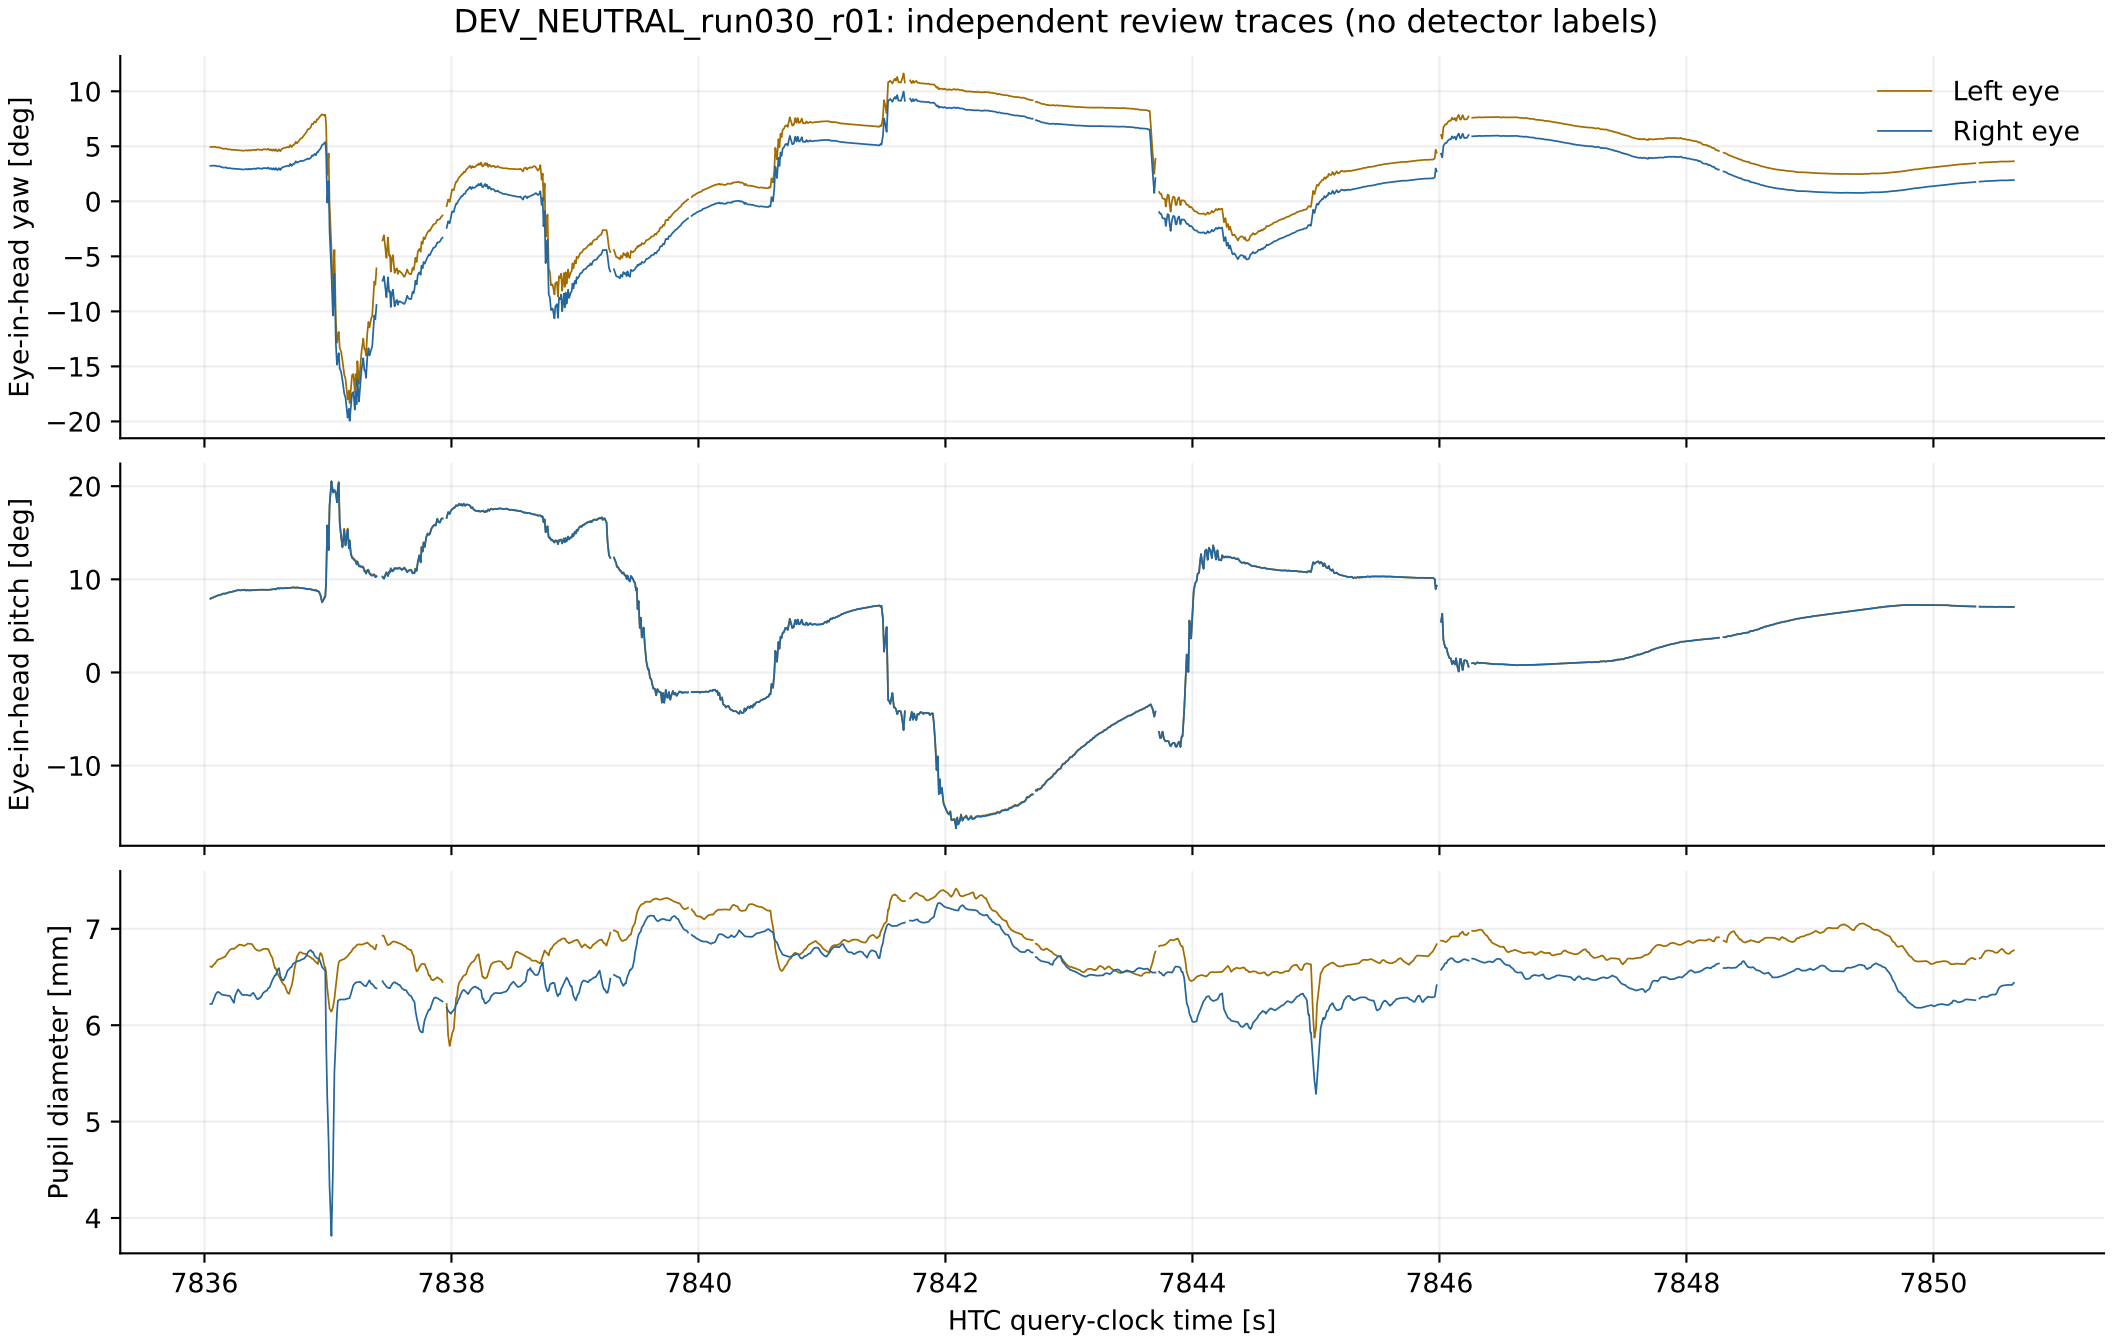

DEV_NEUTRAL_run030_r01: independent review traces (no detector labels)
Left eye
Right eye
Eye-in-head yaw [deg]
10
5
0
−5
−10
−15
−20
Eye-in-head pitch [deg]
20
10
0
−10
Pupil diameter [mm]
7
6
5
4
7836
7838
7840
7842
7844
7846
7848
7850
HTC query-clock time [s]