
Certification and computation across experiment families


Each panel uses its stated design and precision target.

A General coarsening: 60/60

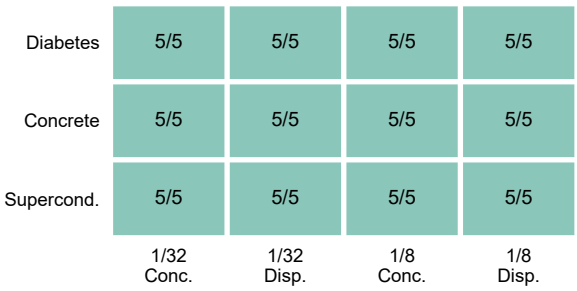


Width $\leq 3 \times 10^{-6}$; all exact replays pass
Complete algorithm: at most 156.76 s

B Rank-three tail diagnostics

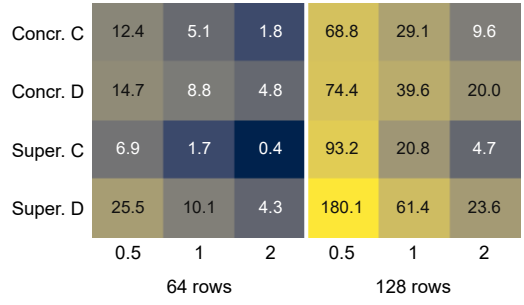


λ multiplier; tail in 10^{-6}
24 bound diagnostics; two cells per row

C Dense rows: 4/4 certified

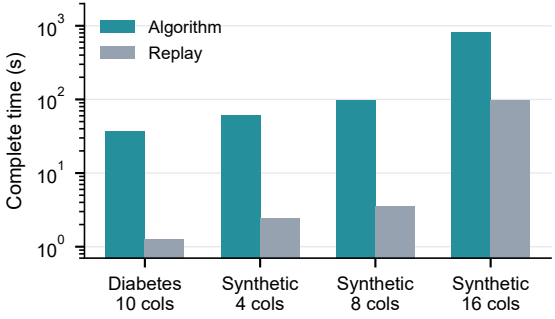

Original width target 10^{-8}; all features retained
4 uncertain rows; independent replay shown separately

D Structural family: setup cost

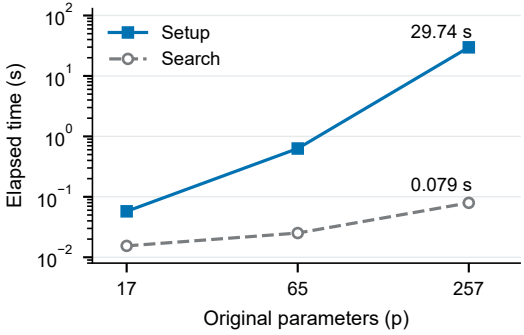

$\alpha = 1/32$, rank 1; single timing per size
Setup includes input, anchor and method receipt