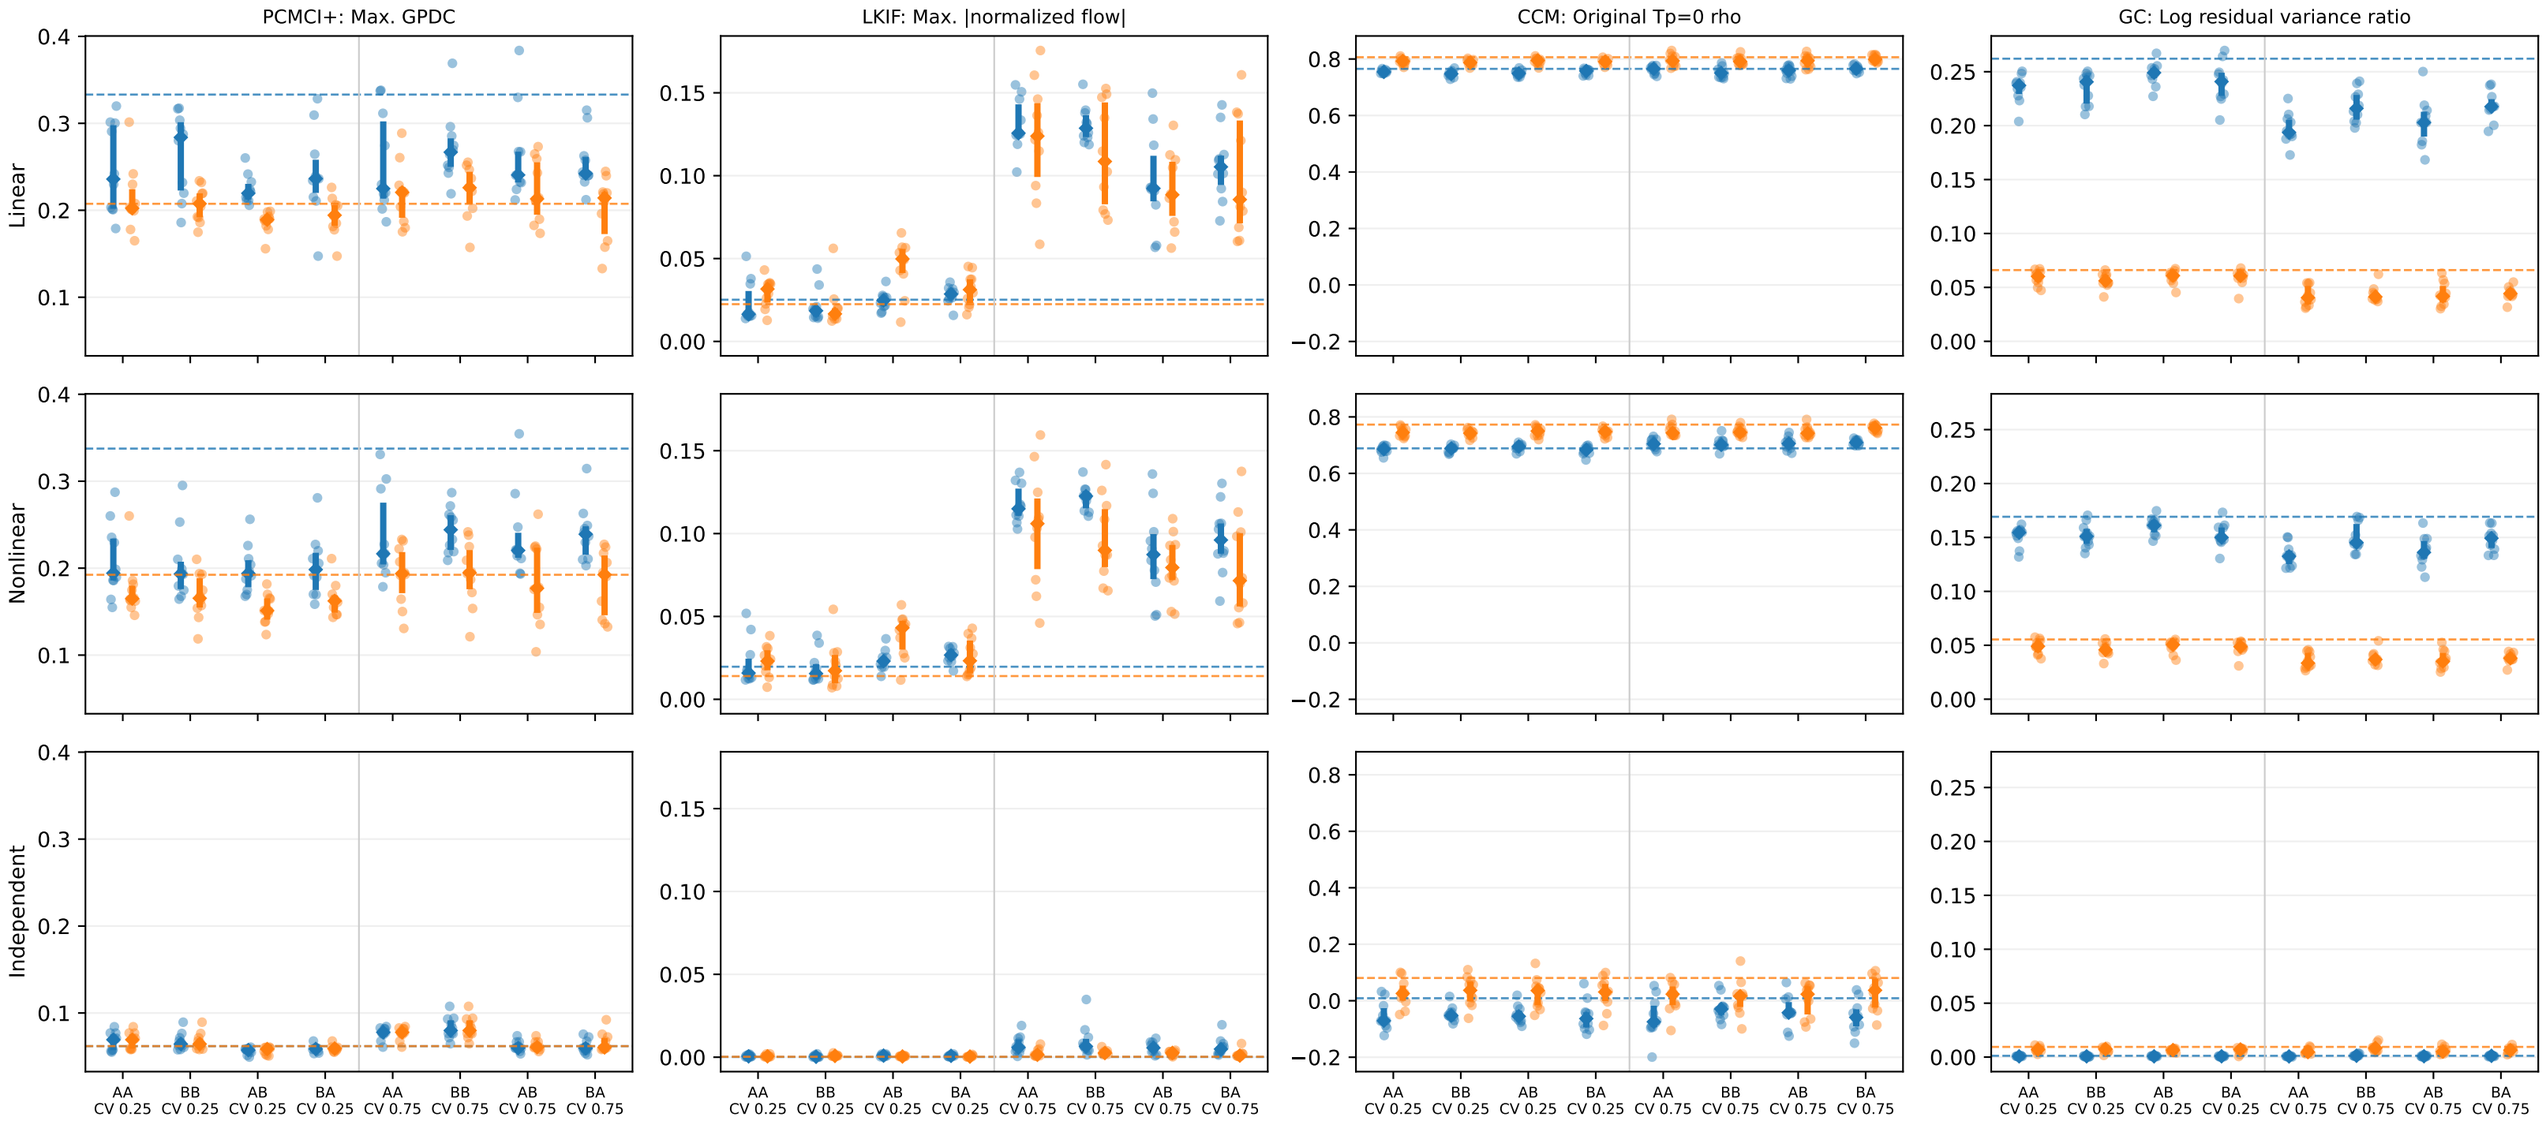

Individual irregular sampling pairings: points = mask groups; diamonds = median; bars = IQR
PCMCI+: Max. GPDC
LKIF: Max. |normalized flow|
CCM: Original Tp=0 rho
GC: Log residual variance ratio
Linear
Nonlinear
Independent
AA CV 0.25
BB CV 0.25
AB CV 0.25
BA CV 0.25
AA CV 0.75
BB CV 0.75
AB CV 0.75
BA CV 0.75
AA/BB use synchronous masks; AB/BA use different X/Y masks. Labels show usable/requested scores when pending or failed. Successful CCM rho0 survives lag-screen failure. IQR is not a confidence interval.
X → Y
Y → X
Regular 80-year baseline