Additional-cohort assessment with partial reuse

GSE293559: 14+14 genes available; TLR5 and ITK absent

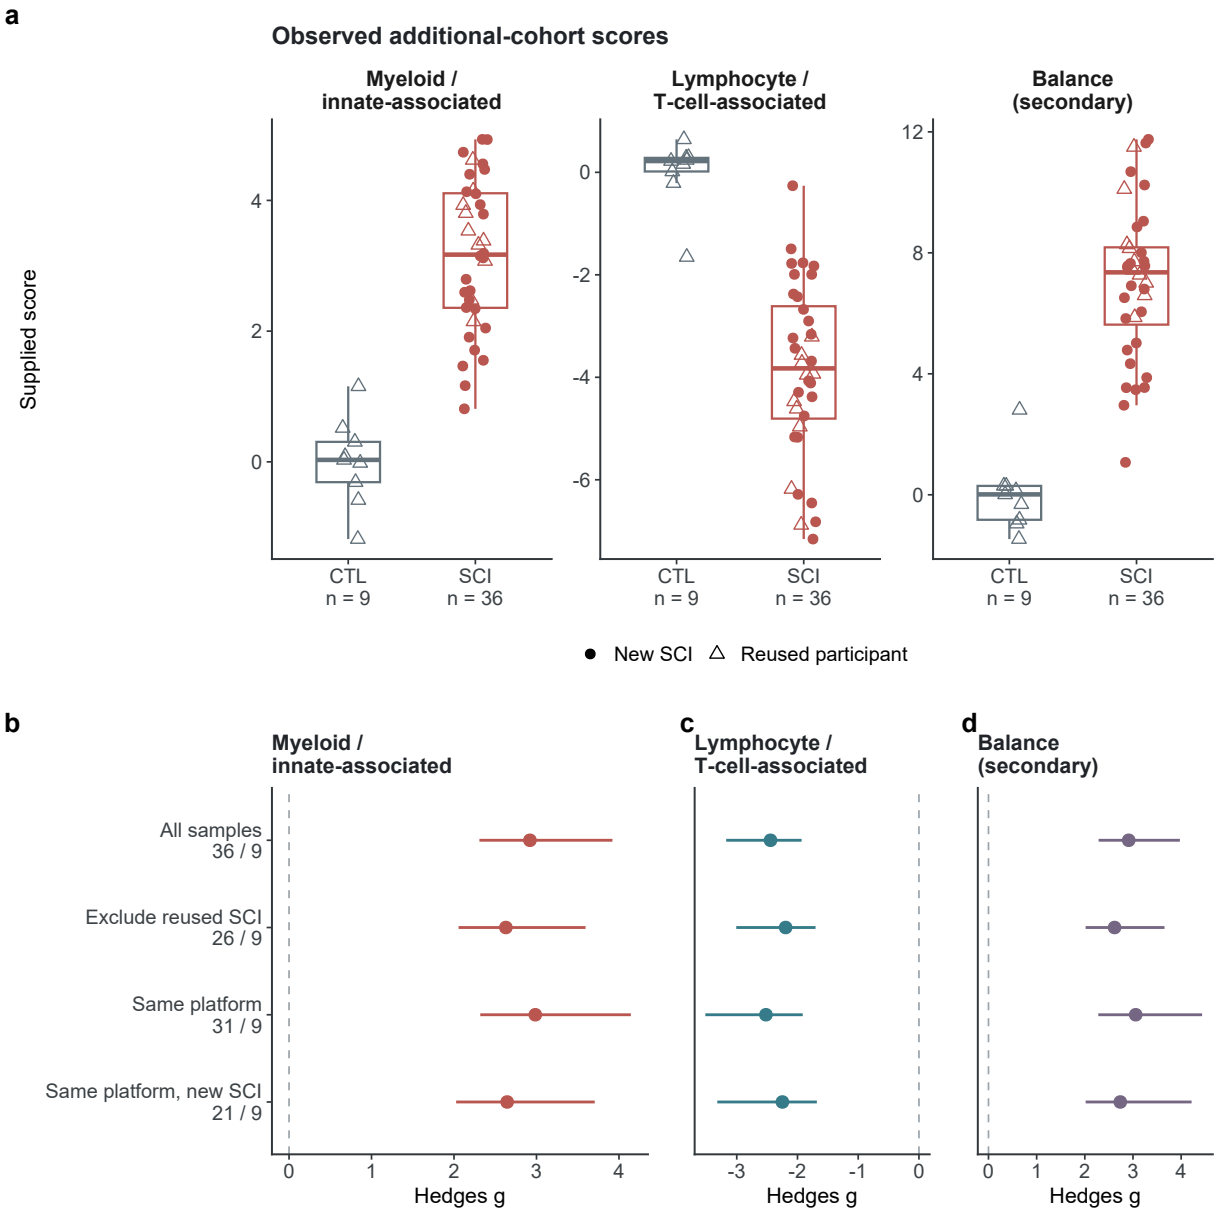

Triangles identify reused participants: 10 SCI and all 9 controls. Excluding reused SCI retains all controls.
Lower panels: all four scopes (SCI / CTL n), saved Hedges g and participant-bootstrap 95% CIs.
Scores retain the supplied transformation. Partial reuse and lack of trauma controls limit independence.