

4/10/2026 1:51:50 PM



SHEET NOTES

1. REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATION OF DEVICES.
2. EXISTING ITEMS SHOWN ARE DIAGRAMMATIC BASED ON AVAILABLE RECORD DRAWINGS AND SITE WALKS DURING THE DESIGN PERIOD. NOT ALL SYSTEM COMPONENTS ARE SHOWN. FIELD VERIFY DEVICE LOCATIONS AND QUANTITIES PRIOR TO COMMENCING WORK.

SCOPE NARRATIVE

PROVIDE 20A CIRCUIT FROM EXISTING SPARE BREAKER IN EXISTING PANEL 'PD' TO THE NEW CAAMS PANEL.



PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

HARGIS

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz



SEAL

KEYPLAN


REV	DESCRIPTION	DATE
DATE		04/15/26
PROJECT No.		208570
PROJECT MANAGER		JR
DESIGNER		TV
CHECKED		BH
APPROVED		DS
FACILITY No.		1276
RECORD/SDCI No.		
BLDG ID		KNE


SHEET NAME

SECOND FLOOR
(UPPER)
ELECTRICAL PLAN

SHEET No.

E6.5




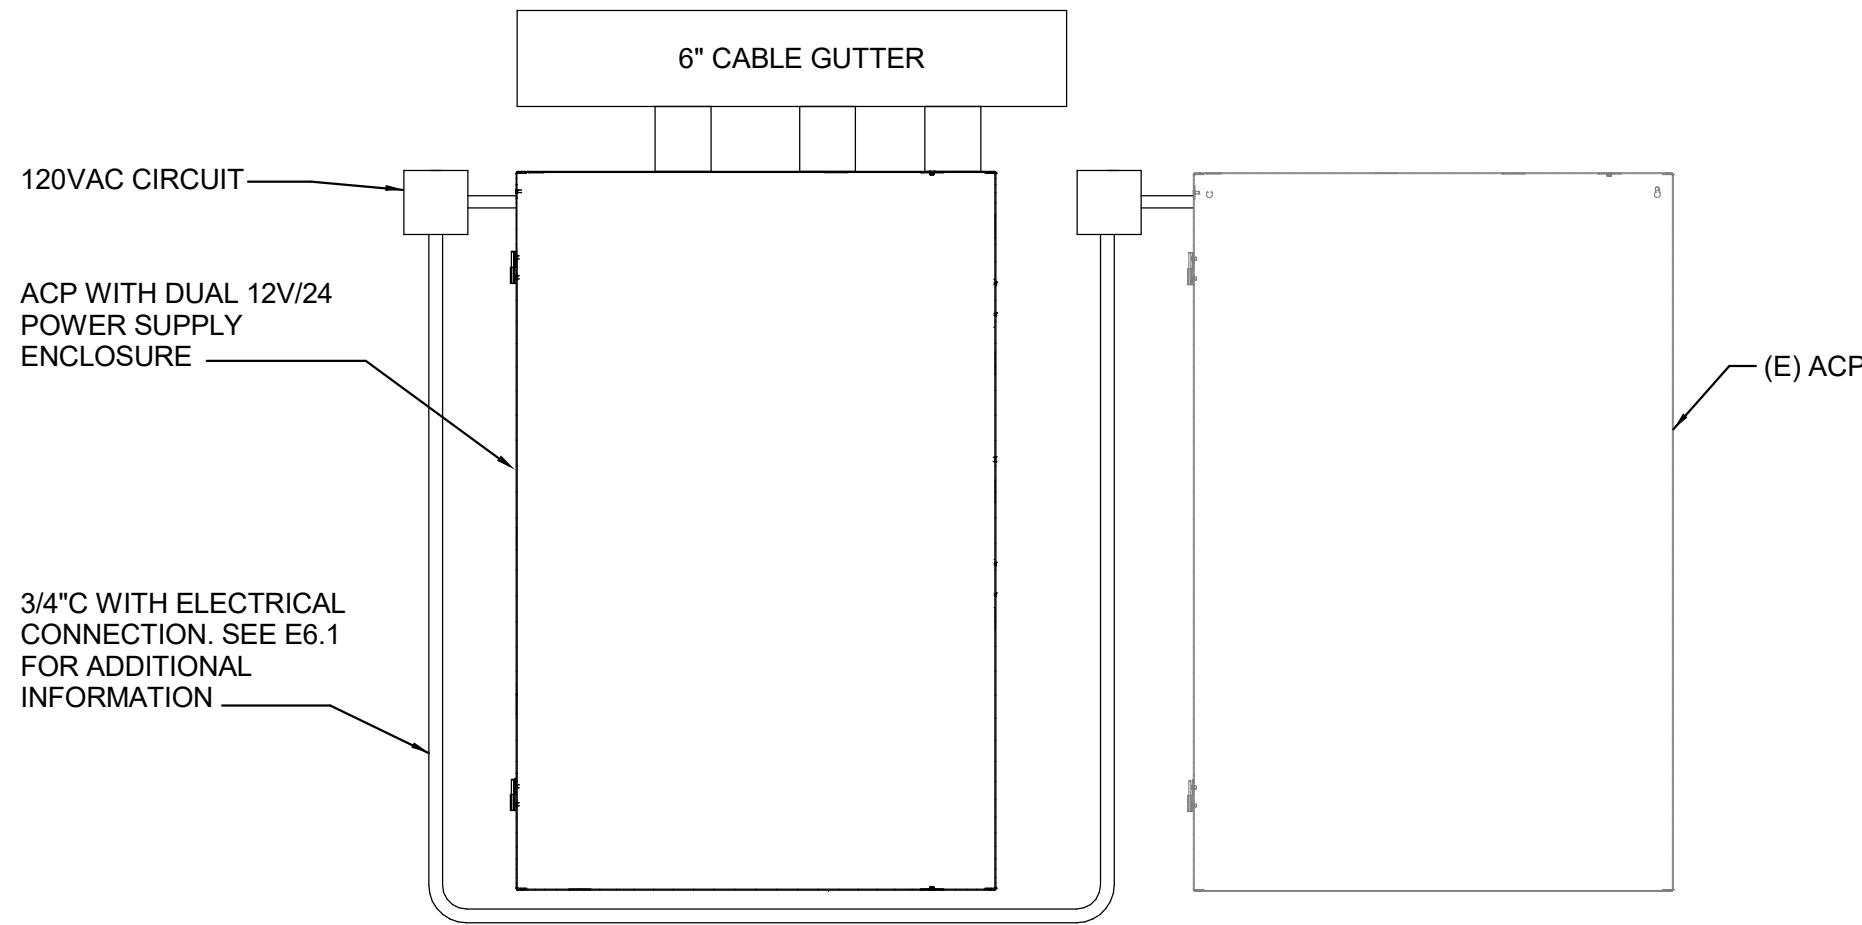

1
E8.1

DETAIL - ACCESS CONTROL PANEL ELEVATION RM 030


SCALE: NONE

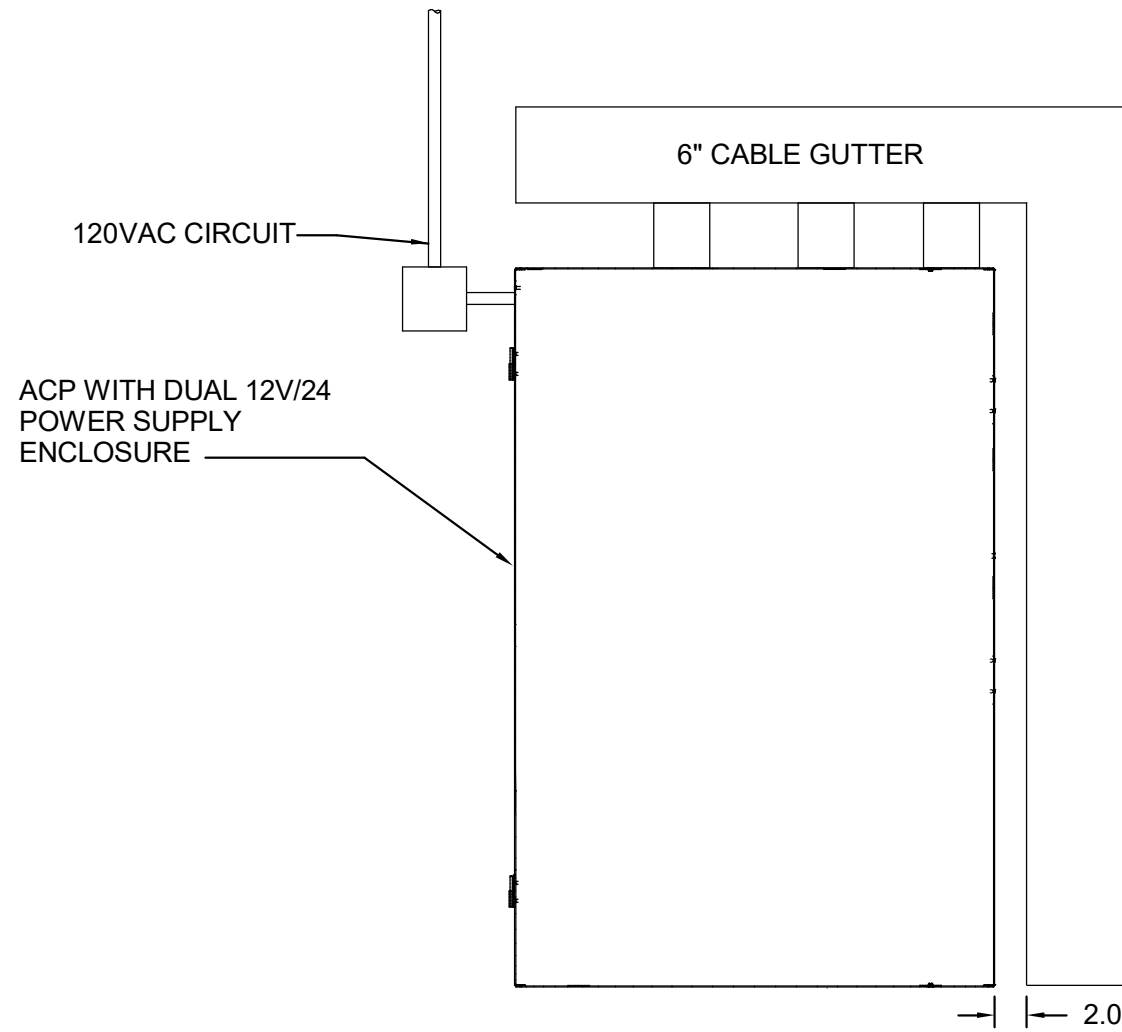

2
E8.1

DETAIL - ACCESS CONTROL PANEL ELEVATION RM 100A


SCALE: NONE

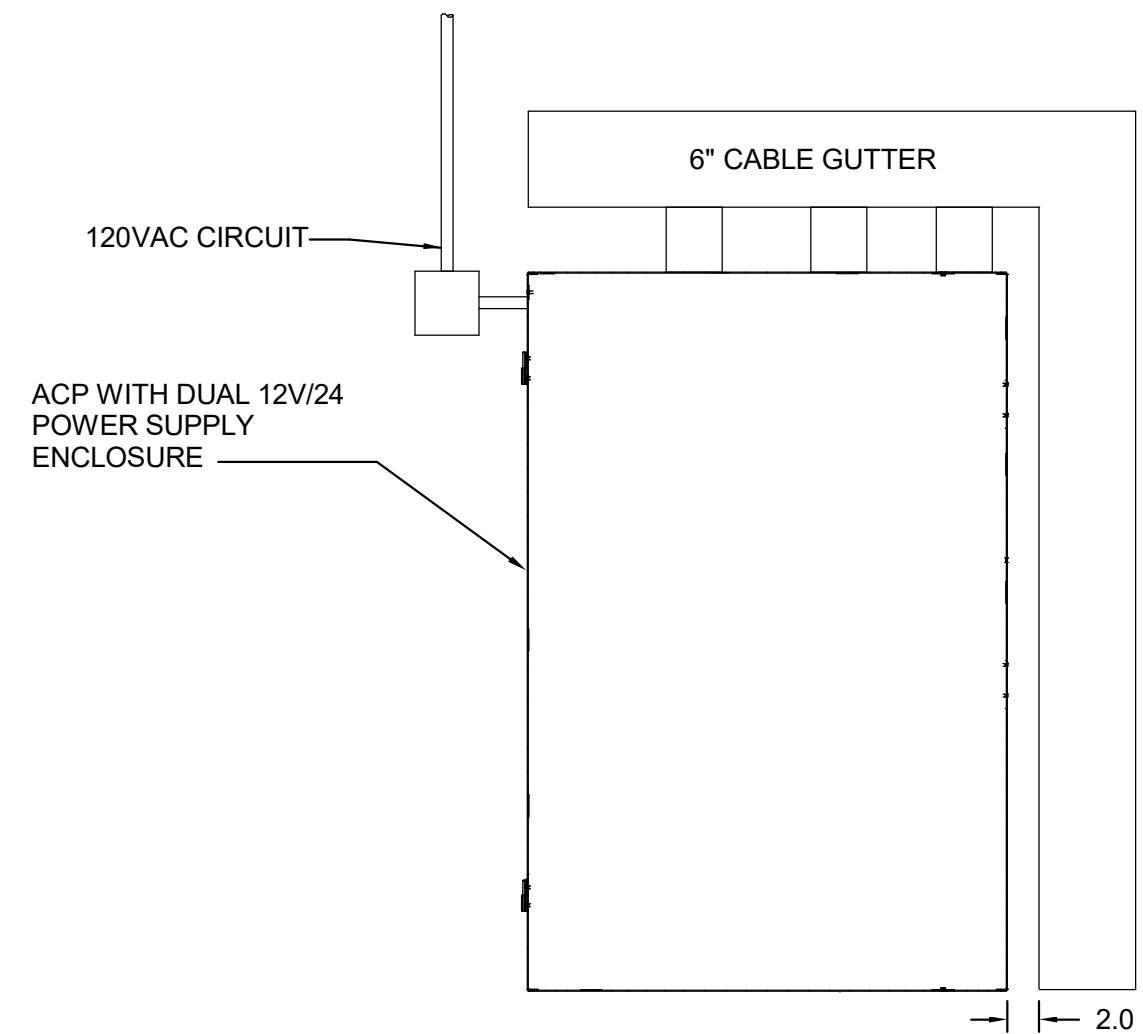

3
E8.1

DETAIL - ACCESS CONTROL PANEL ELEVATION RM 124


SCALE: NONE

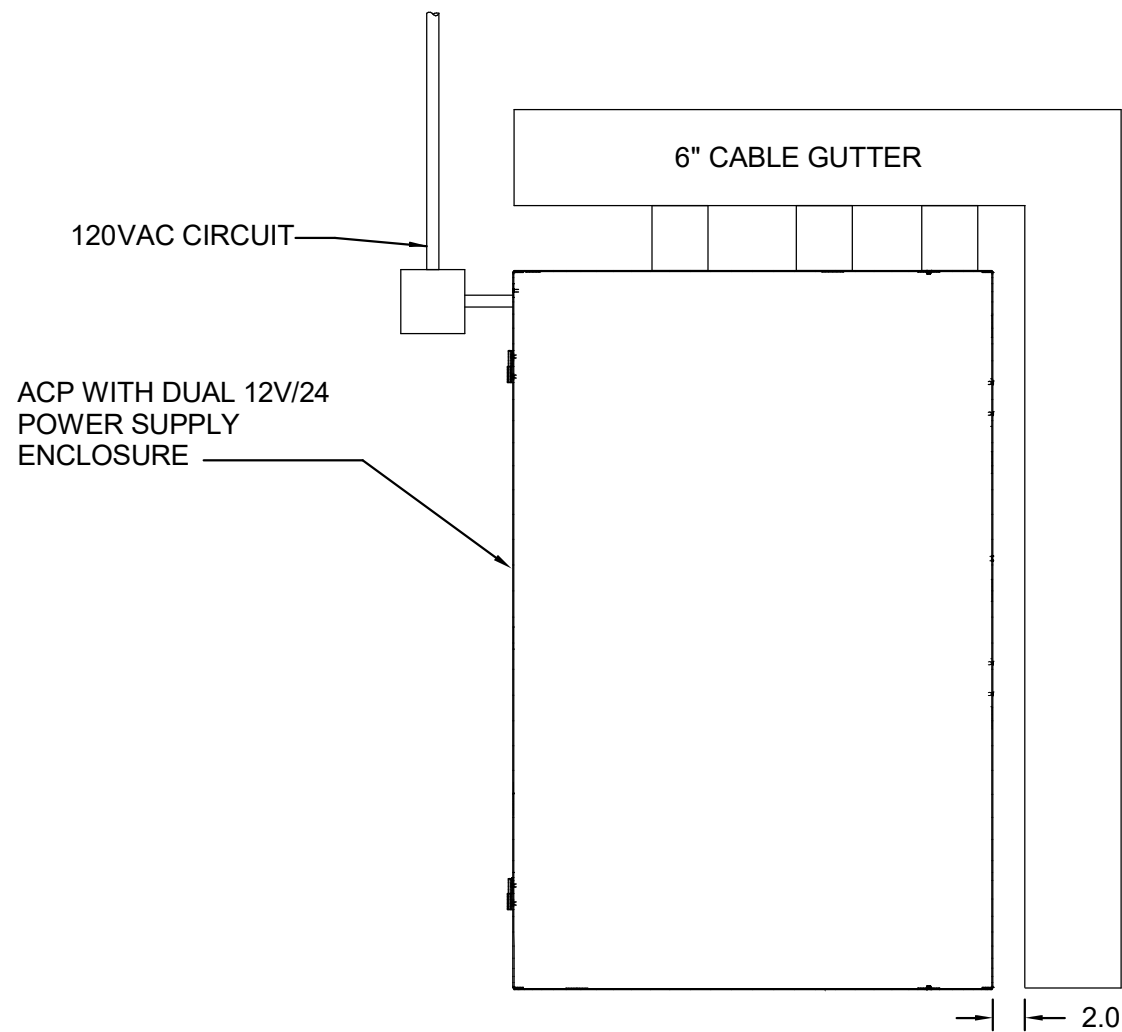

4
E8.1

DETAIL - ACCESS CONTROL PANEL ELEVATION RM 212


SCALE: NONE

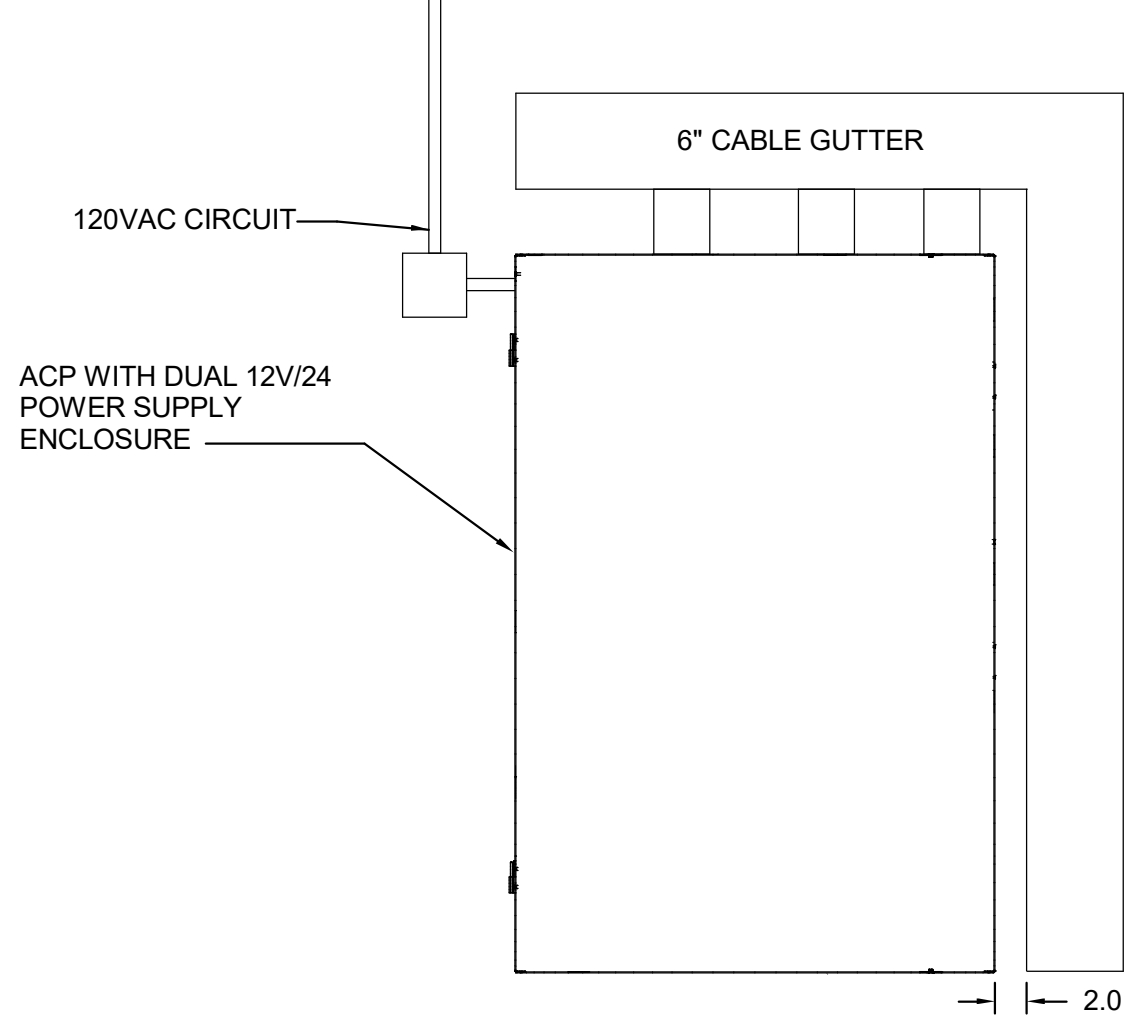

5
E8.1

DETAIL - ACCESS CONTROL PANEL ELEVATION RM 221


SCALE: NONE

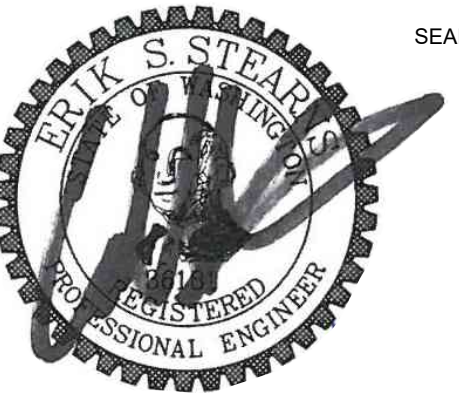

REV	DESCRIPTION	DATE
DATE	04/15/26	
PROJECT No.	208570	
PROJECT MANAGER	JR	
DESIGNER	TV	
CHECKED	BH	
APPROVED	DS	
FACILITY No.	1276	
RECORD/SDCI No.		
BLDG ID	KNE	

REV	DESCRIPTION	DATE

DATE	04/15/26
PROJECT No.	208570
PROJECT MANAGER	JR
DESIGNER	TV
CHECKED	BH
APPROVED	DS
FACILITY No.	1276
RECORD/SDC1 No.	
BLDG ID	KNE

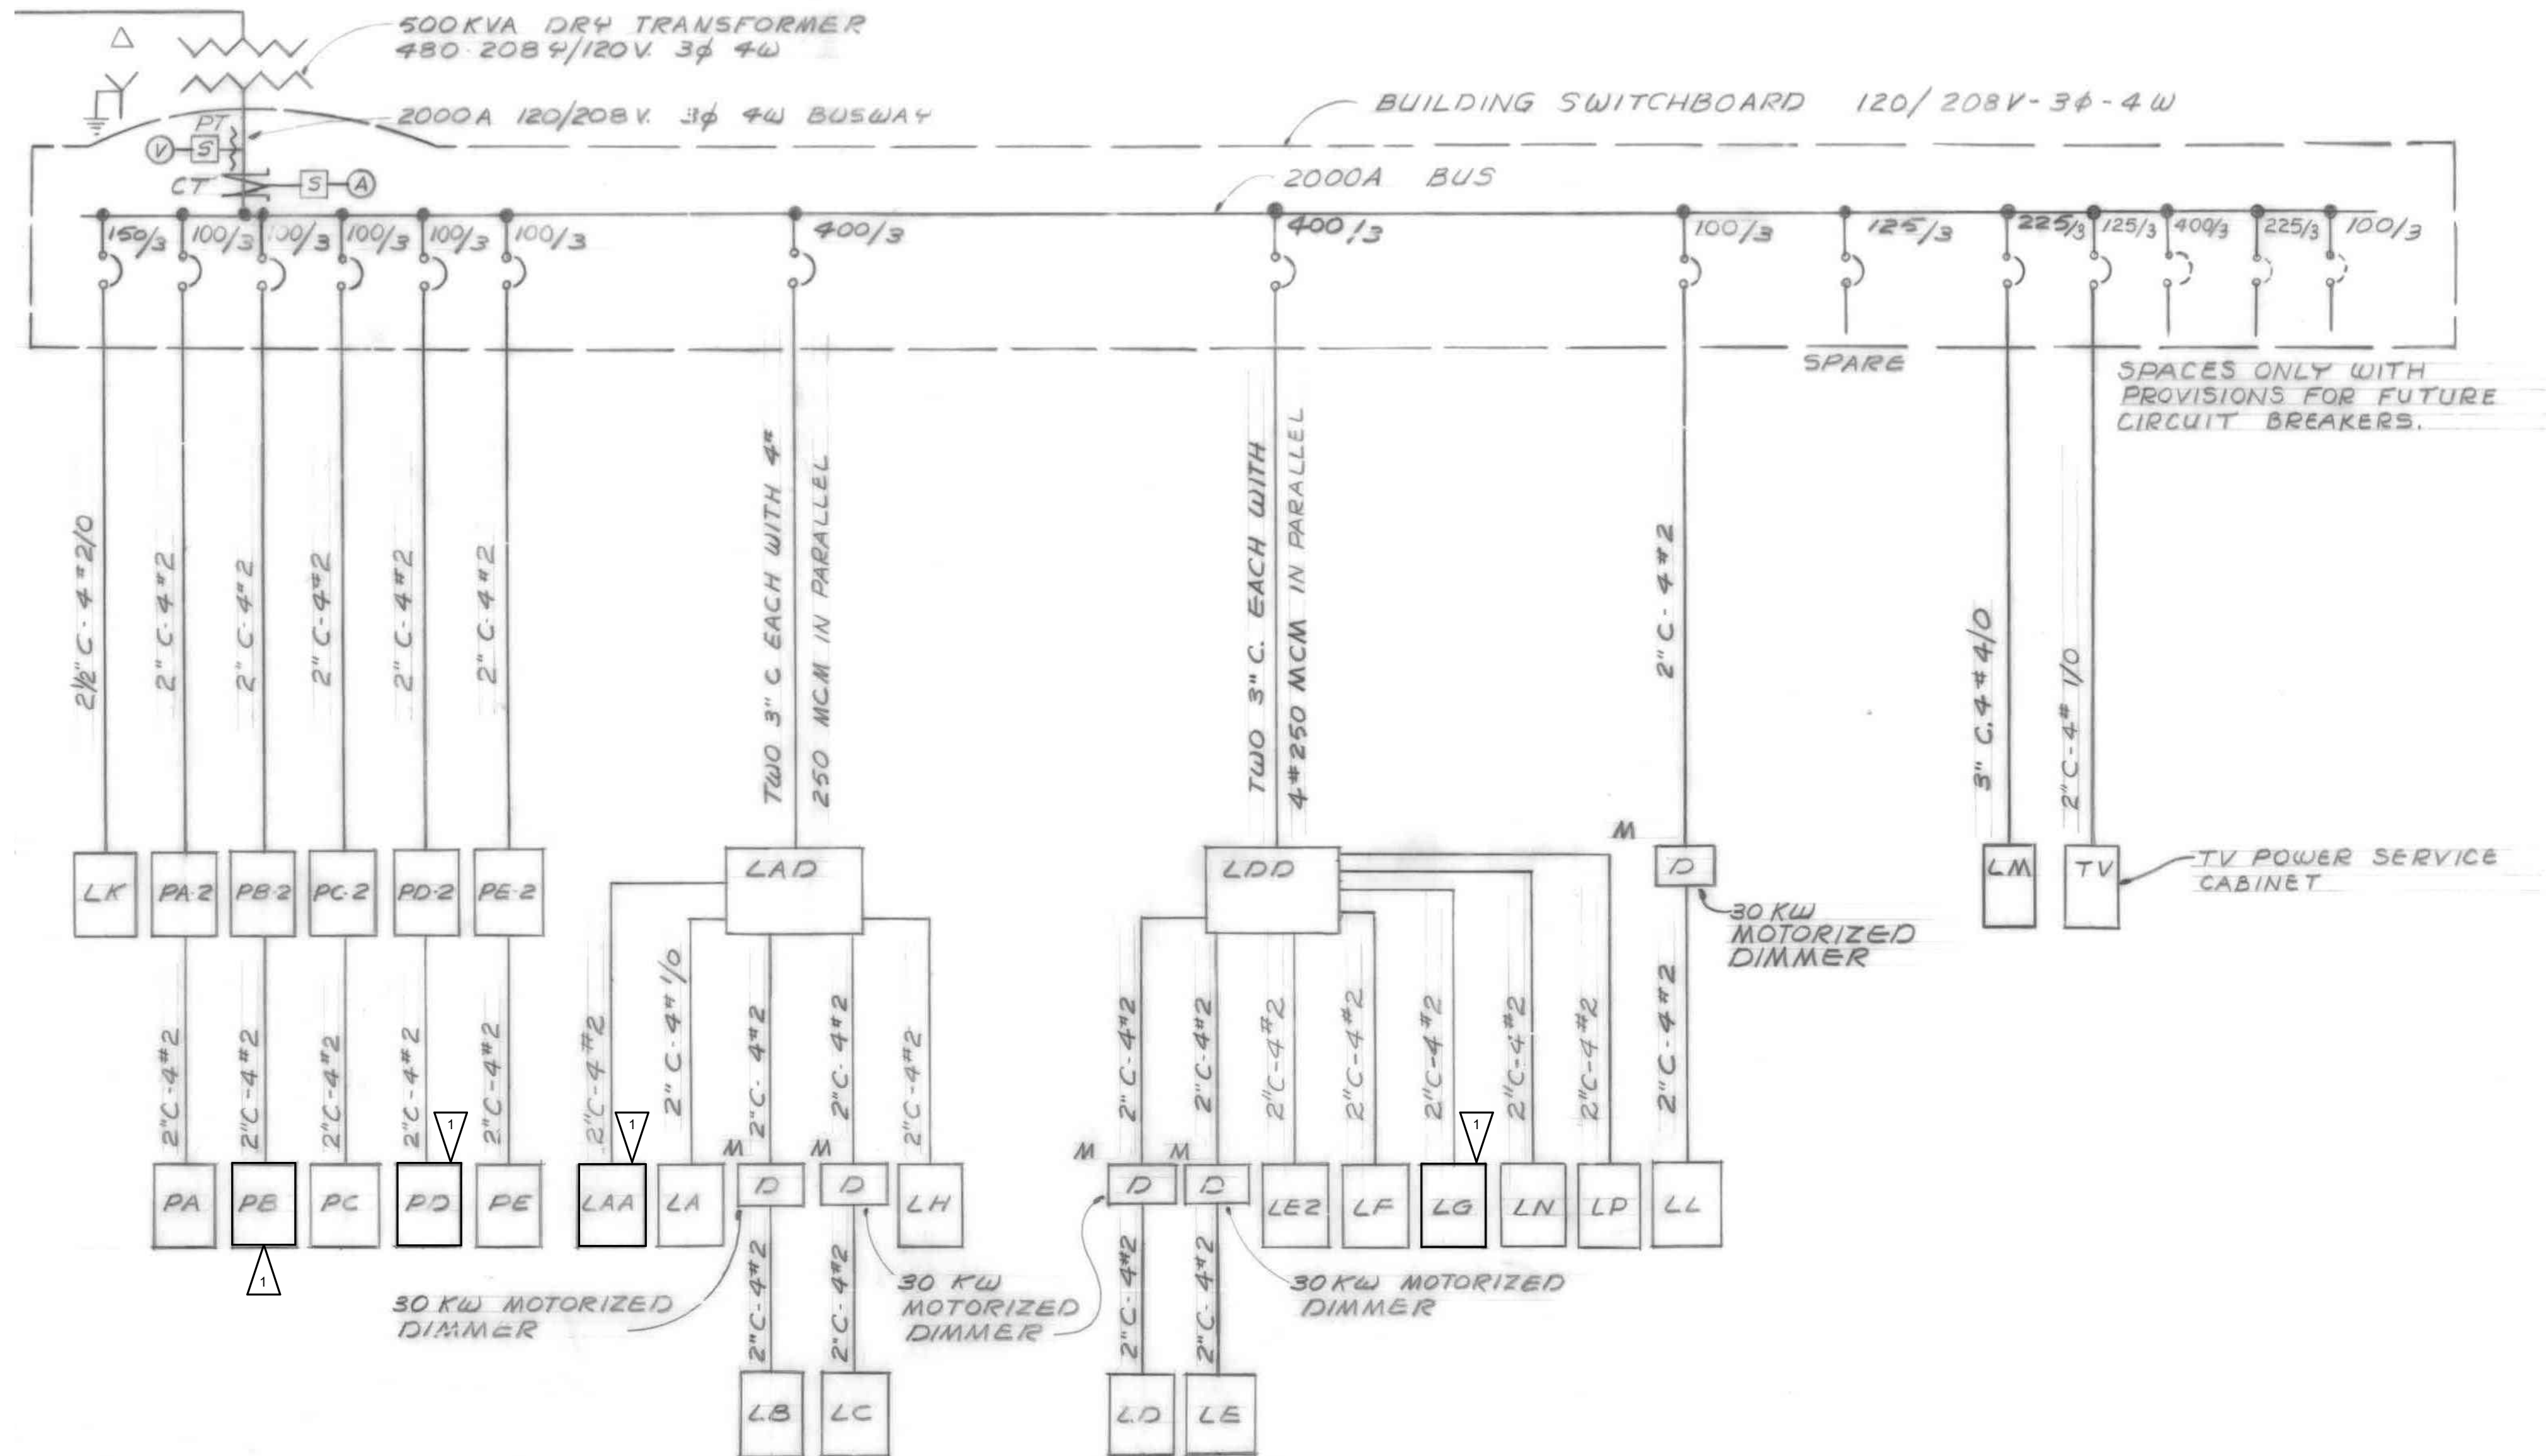

ELECTRICAL EXISTING PARTIAL ONE-LINE DIAGRAM

PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

HARGIS

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz



SEAL

04/15/26

KEYPLAN

PANEL SCHEDULE : 04/06/2026										(E) PANEL 'LAA' - BEFORE										PROJECT: UW Kane Hall CAAMS									
CLASSIFICATION: NORMAL					VOLTAGE: 208Y/120V 3Ø, 4-WIRE					SECTION: 1 OF 1																			
FED FROM: (E) PANEL 'LAD'					MAINS: 100A MAIN LUGS ONLY																								
MOUNTING: FIELD VERIFY					NEUTRAL: 100% RATED																								
NOTE	ITEM DESCRIPTION				CKT NO.	BREAKER AMPS	POLE	LOAD (VA)	Ø	LOAD (VA)	BREAKER AMPS	POLE	CKT NO.	ITEM DESCRIPTION				NOTE											
	EXISTING LOAD				1	20	1		A		20	1	2	EXISTING LOAD															
	EXISTING LOAD				3	20	1		B		20	1	4	EXISTING LOAD															
	EXISTING LOAD				5	20	1		C		20	1	6	EXISTING LOAD															
	EXISTING LOAD				7	20	1		A		20	1	8	EXISTING LOAD															
	EXISTING LOAD				9	20	1		B		20	1	10	EXISTING LOAD															
	EXISTING LOAD				11	20	1		C		20	1	12	EXISTING LOAD															
	EXISTING LOAD				13	20	1		A		20	1	14	EXISTING LOAD															
	EXISTING LOAD				15	20	1		B		20	1	16	EXISTING LOAD															
	EXISTING LOAD				17	20	1		C		20	1	18	EXISTING LOAD															
	EXISTING LOAD				19	20	1		A		20	1	20	EXISTING LOAD															
	EXISTING LOAD				21	20	1		B		20	1	22	LTS SO. ENTRANCE															
	SPARE				23	20	1		C		20	1	24	SPARE															
	FL DUCT RECEP				25	20	1		A		20	1	26	WHEEL CHAIR OPEN															
	WHEEL CHAIR				27	20	1		B		20	1	28	LTS STAIR #1, #4 NITE LITE, TIME CLOCK															
	SPARE				29	20	1		C		20	2	30	OUTSIDE BUILDING OUTLET															
	OUTSIDE BUILDING OUTLET				31	20	1		A	-	-	-	32																
	SUBWOOFER				33	20	1		B		20	1	34	DUPLEX GFCI OUTLET															
	SPARE				35	20	1		C		20	1	36	SPARE															
	SPARE				37	20	1		A		20	1	38	SPARE															
	SPARE				39	20	1		B		20	1	40	SPARE															
	SPARE				41	20	1		C		20	1	42	SPARE															
	SPARE				43	20	1		A		20	1	44	SPARE															
	SPARE				45	20	1		B		20	1	46	SPARE															
	SPARE				47	20	1		C		20	1	48	SPARE															
	SPARE				49	20	1		A		20	1	50	SPARE															
	SPARE				51	20	1		B		20	1	52	SPARE															
	SPARE				53	20	1		C		20	1	54	SPARE															
LOAD CALCULATIONS																													
LOAD DESCRIPTION				CONN. (VA)		DEMAND FACTOR		CALC. (VA)																					
MISCELLANEOUS CONTINUOUS:				-		125%		-																					
EQUIPMENT & MISCELLANEOUS:				-		100%		-																					
LIGHTING:				-		125%		-																					
LARGEST MOTOR:				-		125%		-																					
MOTORS:				-		100%		-																					
RECEPTACLE:				-		100%		-																					
RECEPTACLES OVER 10KVA:				-		50%		-																					
TOTALS:																													
LOAD SUMMARY																													
TOTAL CONNECTED LOAD										AMPS																			
PHASE A:																													
PHASE B:																													
PHASE C:																													
TOTAL CALCULATED LOAD:																													
TOTAL CALCULATED AMPS:																													
NOTES:																													
1.																													
2.																													
3.																													
4.																													
5.																													
										HARGIS ENGINEERS, INC. 1201 THIRD AVENUE, SUITE 600 SEATTLE, WA 98101 PH. (206) 448-3376 FAX. (206) 448-4450																			

PANEL SCHEDULE : 04/10/2026										(E) PANEL 'LAA' - AFTER										PROJECT: UW Kane Hall CAAMS									
CLASSIFICATION: NORMAL					VOLTAGE: 208Y/120V 3Ø, 4-WIRE					SECTION: 1 OF 1																			
FED FROM: (E) PANEL 'LAD'					MAINS: 100A MAIN LUGS ONLY																								
MOUNTING: FIELD VERIFY					NEUTRAL: 100% RATED																								
NOTE	ITEM DESCRIPTION				CKT NO.	BREAKER AMPS	POLE	LOAD (VA)	Ø	LOAD (VA)	BREAKER AMPS	POLE	CKT NO.	ITEM DESCRIPTION				NOTE											
	EXISTING LOAD				1	20	1		A		20	1	2	EXISTING LOAD															
	EXISTING LOAD				3	20	1		B		20	1	4	EXISTING LOAD															
	EXISTING LOAD				5	20	1		C		20	1	6	EXISTING LOAD															
	EXISTING LOAD				7	20	1		A		20	1	8	EXISTING LOAD															
	EXISTING LOAD				9	20	1		B		20	1	10	EXISTING LOAD															
	EXISTING LOAD				11	20	1		C		20	1	12	EXISTING LOAD															
	EXISTING LOAD				13	20	1		A		20	1	14	EXISTING LOAD															
	EXISTING LOAD				15	20	1		B		20	1	16	EXISTING LOAD															
	EXISTING LOAD				17	20	1		C		20	1	18	EXISTING LOAD															
	EXISTING LOAD				19	20	1		A		20	1	20	EXISTING LOAD															
	EXISTING LOAD				21	20	1		B		20	1	22	LTS SO. ENTRANCE															
	SPARE				23	20	1		C		20	1	24	SPARE															
	FL DUCT RECEP				25	20	1		A		20	1	26	WHEEL CHAIR OPEN															
	WHEEL CHAIR				27	20	1		B		20	1	28	LTS STAIR #1, #4 NITE LITE, TIME CLOCK				2											
	SPARE				29	20	1		C		20	2	30	OUTSIDE BUILDING OUTLET															
	OUTSIDE BUILDING OUTLET				31	20	1		A	-	-	-	32																
	SUBWOOFER				33	20	1		B		20	1	34	DUPLEX GFCI OUTLET															
	SPARE				35	20	1		C		20	1	36	SPARE															
	SPARE				37	20	1		A		20	1	38	SPARE															
1	CAAMS ACCESS CONTROL PANEL				39	20	1	500	B		20	1	40	SPARE															
	SPARE				41	20	1		C		20	1	42	SPARE															
	SPARE				43	20	1		A		20	1	44	SPARE															
	SPARE				45	20	1		B		20	1	46	SPARE															
	SPARE				47	20	1		C		20	1	48	SPARE															
	SPARE				49	20	1		A		20	1	50	SPARE															
	SPARE				51	20	1		B		20	1	52	SPARE															
	SPARE				53	20	1		C		20	1	54	SPARE															
LOAD CALCULATIONS																													
LOAD DESCRIPTION				CONN. (VA)		DEMAND FACTOR		CALC. (VA)		LOAD SUMMARY																			
MISCELLANEOUS CONTINUOUS:				-		125%		-																					
EQUIPMENT & MISCELLANEOUS:				500		100%		500																					
LIGHTING:				-		125%		-																					
LARGEST MOTOR:				-		125%		-																					
MOTORS:				-		100%		-																					
RECEPTACLE:				-		100%		-																					
RECEPTACLES OVER 10KVA:				-		50%		-																					
TOTALS:				500				500		TOTAL CONNECTED LOAD AMPS PHASE A: PHASE B: 500 VA 4 A PHASE C: TOTAL CALCULATED LOAD: 500 VA TOTAL CALCULATED AMPS: 1 A																			
NOTES: 1. ADDED LOAD IS LESS THAN 5% OF PANEL CAPACITY. 2. NEW LIGHT IS EQUAL OR LOWER LOAD THAN EXISTING. 3. 4. 5.										HARGIS ENGINEERS, INC. 1201 THIRD AVENUE, SUITE 600 SEATTLE, WA 98101 PH. (206) 448-3376 FAX. (206) 448-4450																			

PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

HARGIS

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz

SEAL



04/15/26

KEYPLAN

REV	DESCRIPTION	DATE

DATE	04/15/26
PROJECT No.	208570
PROJECT MANAGER	JR
DESIGNER	TV
CHECKED	BH
APPROVED	DS
FACILITY No.	1276
RECORD/SDCI No.	
BLDG ID	KNE
SHEET NAME	

PANEL
SCHEDULES

SHEET No.

E10.2

PANEL SCHEDULE : 04/06/2026					(E) PANEL 'PB' - BEFORE					PROJECT: UW Kane Hall CAAMS				
CLASSIFICATION: NORMAL FED FROM: (E) PANEL 'PB-2' MOUNTING: FIELD VERIFY					VOLTAGE: 208Y/120V 3Ø, 4-WIRE MAINS: 100A MAIN LUGS ONLY NEUTRAL: 100% RATED					SECTION: 1 OF 1				
NOTE	ITEM DESCRIPTION	CKT NO.	BREAKER AMPS	POLE	LOAD (VA)	Ø	LOAD (VA)	BREAKER AMPS	POLE	CKT NO.	ITEM DESCRIPTION	NOTE		
	SPARE	1	100	3		A		30	2	2	SPARE			
		3	-	-		B		-	-	4				
		5	-	-		C		20	2	6	SPARE			
	SPARE	7	50	3		A		-	-	8				
		9	-	-		B		20	1	10				
		11	-	-		C		20	1	12				
	CONTROL ROOM, RM 124 208V RECEPT	13	20	2		A		20	2	14	TWIST LOCK, WIREMOLD RM 124			
		15	-	-		B		-	-	16				
	MONITORS	17	20	1		C		20	1	18	W AUDITORIUM RECEPTS			
	GENERAL RECEPT	19	20	1		A		20	1	20	RM 124			
	PODIUM	21	20	1		B		20	1	22	E AUDITORIUM RECEPT			
	TRENCHDUCT RECEPT	23	20	1		C		20	1	24	RM. 124 OUTLET E.			
	SPARE	25	20	1		A		20	1	26	RM. 124 RECEPT N. WALL			
	SPARE	27	20	1		B		20	1	28	AUDIO VIDEO RACK			
	SPARE	29	20	1		C		20	1	30	SPARE			
	SPARE	31	20	1		A		20	1	32	MOTION SENSORS			
	SPARE	33	20	1		B		20	1	34	SPARE			
	SPARE	35	20	1		C		20	1	36	SPARE			
	SPARE	37	20	1		A		20	1	38	SPARE			
	SPARE	39	20	1		B		20	1	40	SPARE			
	SPARE	41	20	1		C		20	1	42	SPARE			
LOAD CALCULATIONS														
LOAD DESCRIPTION		CONN. (VA)		DEMAND FACTOR		CALC. (VA)		LOAD SUMMARY						
MISCELLANEOUS CONTINUOUS:		-		125%		-		TOTAL CONNECTED LOAD AMPS PHASE A: _____ PHASE B: _____ PHASE C: _____ TOTAL CALCULATED LOAD: TOTAL CALCULATED AMPS:						
EQUIPMENT & MISCELLANEOUS:		-		100%		-								
LIGHTING:		-		125%		-								
LARGEST MOTOR:		-		125%		-								
MOTORS:		-		100%		-								
RECEPTACLE:		-		100%		-								
RECEPTACLES OVER 10KVA:		-		50%		-								
TOTALS:														
NOTES:														
1.														
2.														
3.														
4.														
5.														
HARGIS ENGINEERS, INC. 1201 THIRD AVENUE, SUITE 600 SEATTLE, WA 98101 PH. (206) 448-3376 FAX. (206) 448-4450														

PANEL SCHEDULE : 04/07/2026				(E) PANEL 'PB' - AFTER				PROJECT: UW Kane Hall CAAMS			
CLASSIFICATION: NORMAL FED FROM: (E) PANEL 'PB-2' MOUNTING: FIELD VERIFY				VOLTAGE: 208Y/120V 3Ø, 4-WIRE MAINS: 100A MAIN LUGS ONLY NEUTRAL: 100% RATED				SECTION: 1 OF 1			
NOTE	ITEM DESCRIPTION	CKT NO.	BREAKER AMPS POLE	LOAD (VA)	Ø	LOAD (VA)	BREAKER AMPS POLE	CKT NO.	ITEM DESCRIPTION	NOTE	
	SPARE	1	100 3		A		30 2	2	SPARE		
		3	- -		B		- -	4			
		5	- -		C		20 2	6	SPARE		
	SPARE	7	50 3		A		- -	8			
		9	- -		B		20 1	10			
		11	- -		C		20 1	12			
	CONTROL ROOM, RM 124 208V RECEPT	13	20 2		A		20 2	14	TWIST LOCK, WIREMOLD RM 124		
		15	- -		B		- -	16			
	MONITORS	17	20 1		C		20 1	18	W AUDITORIUM RECEPTS		
	GENERAL RECEPT	19	20 1		A		20 1	20	RM 124		
	PODIUM	21	20 1		B		20 1	22	E AUDITORIUM RECEPT		
	TRENCHDUCT RECEPT	23	20 1		C		20 1	24	RM, 124 OUTLET E.		
	SPARE	25	20 1		A		20 1	26	RM, 124 RECEPT N. WALL		
	SPARE	27	20 1		B		20 1	28	AUDIO VIDEO RACK		
	SPARE	29	20 1		C	500	20 1	30	CAAMS ACCESS CONTROL PANEL	1	
	SPARE	31	20 1		A		20 1	32	MOTION SENSORS		
	SPARE	33	20 1		B		20 1	34	SPARE		
	SPARE	35	20 1		C		20 1	36	SPARE		
	SPARE	37	20 1		A		20 1	38	SPARE		
	SPARE	39	20 1		B		20 1	40	SPARE		
	SPARE	41	20 1		C		20 1	42	SPARE		
LOAD CALCULATIONS											
LOAD DESCRIPTION		CONN. (VA)		DEMAND FACTOR		CALC. (VA)		LOAD SUMMARY			
MISCELLANEOUS CONTINUOUS:		-		125%		-		TOTAL			
EQUIPMENT & MISCELLANEOUS:		500		100%		500		CONNECTED LOAD AMPS			
LIGHTING:		-		125%		-		PHASE A:			
LARGEST MOTOR:		-		125%		-		PHASE B:			
MOTORS:		-		100%		-		PHASE C: 500 VA 4 A			
RECEPTACLE:		-		100%		-		TOTAL CALCULATED LOAD: 500 VA			
RECEPTACLES OVER 10KVA:		-		50%		-		TOTAL CALCULATED AMPS: 1 A			
TOTALS:		500				500					
NOTES:											
1. ADDED LOAD IS LESS THAN 5% OF PANEL CAPACITY.											
2.											
3.											
4.											
5.											
HARGIS ENGINEERS, INC. 1201 THIRD AVENUE, SUITE 600 SEATTLE, WA 98101 PH. (206) 448-3376 FAX. (206) 448-4450											

PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

H A R G I S

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz

SEAL



KEYPLAN

REV	DESCRIPTION	DATE
DATE	04/15/26	
PROJECT No.	208570	
PROJECT MANAGER	JR	
DESIGNER	TV	
CHECKED	BH	
APPROVED	PS	
FACILITY No.	1276	
RECORD/SDCI No.		
BLDG ID	KNE	
SHEET NAME		

SECURITY LEGEND
AND DRAWING
INDEX

SHEET No.

SE0.1

GENERAL

- EXISTING ELECTRICAL TO BE REMOVED
- EXISTING ELECTRICAL TO REMAIN
- NEW ELECTRICAL WORK
- MATCHLINE OR PROPERTY LINE
- ENLARGED PLAN BOUNDARY

1
E1.01
DETAIL/PLAN IDENTIFIER

1
E1.01
SECTION IDENTIFIER

1
E1.01
ELEVATION IDENTIFIER

REVISION DEFINITION AREA. AREA ENCIRCLED CONTAINS CHANGES MADE SUBSEQUENT TO PREVIOUS ISSUE

- REVISION CALLOUT
- FLAG NOTE CALLOUT
- DEMOLITION NOTE TAG
- EQUIPMENT TAG

AHU-01 MECHANICAL EQUIPMENT TAG

NORTH ARROW

1
LOCATION WHERE PICTURE WAS TAKEN AND DIRECTION

GROUNDING

- GROUNDING CONDUCTOR
- GROUNDING ROD
- GROUNDING BUSBAR
- EQUIPMENT GROUNDING CONNECTION
- GROUNDING STRAP

RACEWAY AND BOXES

- JUNCTION BOX
- FURNITURE WALL FEED OUTLET BOX
- PULL BOX
(WHERE INDICATED, SUBSCRIPT INDICATES PULL BOX NUMBER)
- HANDHOLE
(WHERE INDICATED, SUBSCRIPT INDICATES HANDHOLE NUMBER)
- VAULT
(WHERE INDICATED, SUBSCRIPT INDICATES VAULT TYPE)
- FLOORBOX (WHERE INDICATED, SUBSCRIPT INDICATES FLOOR BOX TYPE)
- POKE-THRU (WHERE INDICATED, SUBSCRIPT INDICATES FLOOR POKE-THRU TYPE)
- POWER POLE, FLOOR TO CEILING

- SURFACE METAL RACEWAY
- RACEWAY CONCEALED IN-WALL OR IN-CEILING
(EXPOSED IN UNFINISHED AREAS)
- RACEWAY RUN BELOW FLOOR OR BELOW GRADE

- FLEXIBLE RACEWAY
- RACEWAY (CIRCLE DENOTES VERTICAL TRANSITION)
- RACEWAY CONTINUATION

- RACEWAY STUB WITH BUSHINGS
- RACEWAY SLEEVE WITH BUSHINGS
- FIRE STOPPING SLEEVE

- CABLE TRAY, 12"W x 4"H OVERHEAD, UNLESS OTHERWISE NOTED
- CABLE TRAY, OVERHEAD LADDER TYPE

HOMERUN TO PANEL
(INDICATES PANEL DESIGNATION AND CIRCUIT NUMBER)

- (GAUGE OF WIRE OTHER THAN AWG#12)
- NUMBER OF CONDUCTORS
- (GROUND CONDUCTOR)
- (PHASE CONDUCTORS)
- (NEUTRAL CONDUCTOR)

TELECOMMUNICATIONS SYSTEM

- TELECOMMUNICATIONS DEVICE
(X = REPRESENTS THE # OF TELECOMMUNICATIONS MODULES)
(W = TELECOMMUNICATIONS WALL PHONE MTD AT +48" AFF)
(B = BLANK COVER PLATE)
- (F = MODULAR FURNITURE DEVICE)
(AC = ABOVE COUNTER DEVICE)
(S = SURFACE MOUNT)
(WAP = WALL-MOUNTED WIRELESS ACCESS POINT DATA DEVICE)
- ABOVE CEILING TELECOMMUNICATIONS DEVICE
(X = REPRESENTS THE # OF TELECOMMUNICATIONS MODULES)
(WAP = WIRELESS ACCESS DEVICE)
(SV = SECURITY VIDEO CAMERA)
- FIRE RESISTANT 3/4" PLYWOOD BACKBOARD
- TWO-POST EQUIPMENT RACK
- 3.65" DOUBLE-SIDED VERTICAL MANAGEMENT
- 6" DOUBLE-SIDED VERTICAL MANAGEMENT
- 12" DOUBLE-SIDED VERTICAL MANAGEMENT
- FLOOR MOUNTED SERVER ENCLOSURE
- WALL-MOUNTED ENCLOSURE
- 110 BLOCK WITH LEGS
- 66 BLOCK

ACCESS CONTROL SYSTEM

- ACCESS CONTROL PANEL
- CREDENTIAL/CARD READER
(CR = CARD READER, WALL-MOUNTED)
(CRM = CARD READER, MULLION-MOUNTED)
- DOOR POSITION SWITCH
- DOOR ENTRY STATION, WALL-MOUNTED
- DOOR MASTER STATION, DESK TOP
- SECURITY BUTTONS/SWITCH, WALL-MOUNTED
(AO = AUTO OPERATOR)
- CLASSROOM LOCKDOWN BUTTON, WALL-MOUNTED
- REQUEST TO EXIT, INTEGRAL MICRO SWITCH
- HORN
- DOOR HARDWARE POWER SUPPLY (DIV 08)
(EL = ELECTRIFIED LOCKSET/EXIT DEVICE)
(ES = ELECTRIFIED STRIKE)
- PANEL INTERFACE MODULE

NOT ALL SYMBOLS MAY APPEAR ON THE DRAWINGS

GENERAL NOTES

1. PERFORM WORK IN ACCORDANCE WITH APPLICABLE NATIONAL AND STATE CODES AS AMENDED LOCALLY AND ENFORCED BY THE AHJ.
2. OBTAIN AND PAY FOR PERMITS REQUIRED FOR INSTALLATION OF WORK. ARRANGE AND SCHEDULE REQUIRED INSPECTIONS.
3. COORDINATE WITH UTILITY COMPANIES FURNISHING SERVICES TO PROJECT. INSTALLATION OF UTILITY SERVICES SHALL BE IN ACCORDANCE WITH UTILITY REQUIREMENTS. VERIFY APPLICABLE INSTALLATION STANDARDS AND REQUIREMENTS. PROVIDE AND SUBMIT ELECTRICAL DRAWINGS TO UTILITY FOR APPROVAL PRIOR TO ROUGH-IN AND PRIOR TO ORDERING EQUIPMENT.
4. DEVICE LOCATIONS ARE APPROXIMATE. COORDINATE DEVICE LOCATIONS AND ELEVATIONS WITH APPROPRIATE DOCUMENTS INCLUDING CASEWORK SHOP DRAWINGS AND ARCHITECT'S INTERIOR ELEVATIONS PRIOR TO ROUGH-IN.
5. COORDINATE SECURITY WORK WITH THAT OF OTHER TRADES. REFER TO ARCHITECTURAL DRAWINGS AND SPECIFICATIONS. COORDINATION SHALL OCCUR PRIOR TO FABRICATION, PURCHASE, AND INSTALLATION OF WORK.
6. REFER TO ARCHITECTURAL DRAWINGS FOR LOCATIONS OF EXPANSION/SEISMIC JOINTS. PROVIDE RACEWAY EXPANSION/SEISMIC JOINTS FOR RACEWAYS CROSSING BUILDING EXPANSION/SEISMIC JOINTS.
7. DEMOLISH EXISTING SYSTEMS AS INDICATED ON PLANS OR AS REQUIRED FOR INSTALLATION OF NEW WORK. MATERIAL SHALL BE REMOVED FROM SITE AND LEGALLY DISPOSED OF OFF SITE UNLESS OTHERWISE DIRECTED. RETURN ITEMS TO OWNER IN EXISTING CONDITION WHEN DIRECTED BY OWNER.
8. COMPLETION OF WORK SHALL BE EXECUTED IN ACCORDANCE WITH THE PROJECT SCHEDULE. SCHEDULE INSTALLATION WITH OTHER TRADES TO ENSURE PROJECT MILESTONES ARE MET.
9. DRAWINGS ARE DIAGRAMMATIC AND DO NOT SHOW ALL COMPONENTS REQUIRED FOR A COMPLETE INSTALLATION. PROVIDE COMPONENTS REQUIRED FOR COMPLETE AND OPERATIONAL SYSTEMS INCLUDING RACEWAYS, CONDUCTORS, BOXES, SUPPORTS AND SIMILAR ITEMS.

10. LOCATIONS OF RACEWAY, PATHWAY AND SIMILAR ITEMS ARE SHOWN SCHEMATICALLY. COORDINATE INSTALLATION, INCLUDING BUT NOT LIMITED TO CABLING, TELECOMMUNICATION PATHWAYS AND SPACES, AND EXACT LOCATION OF HORIZONTAL AND BACKBONE CABLING WITH LOCATIONS OF FIXED CASEWORK AND BUILDING CONDITIONS AFFECTING THE WORK OF THIS CONTRACT.
11. NEW CABLING INSTALLATIONS SHALL BE CONCEALED IN UNITS, CEILINGS, AND LOW RAISED FLOOR SPACES UNLESS OTHERWISE NOTED ON THE DRAWINGS. CABLING ACCESSIBLE CEILING SPACES SHALL BE INSTALLED AS OPEN CABLING NEAR STRUCTURES AND WALLS OR AS SPECIFICALLY NOTED ON DRAWINGS. SEE SPECIFICATIONS FOR SUPPORT REQUIREMENTS.
12. PROVIDE FIRESTOPPING SYSTEMS FOR CONDUIT AND RACEWAY SYSTEMS AT PENETRATIONS, SLEEVES AND SLOTS OF FIRE RATED CONSTRUCTION FOR HORIZONTAL AND INTRABUILDING PATHWAYS AND SPACES.
13. MAINTAIN A MINIMUM SPACING OF 12" FROM ELECTRICAL FEEDERS AND BRANCH CIRCUIT WIRING AND 12" FROM AUXILIARY SYSTEM CABLING.
14. MINIMUM SPACING FROM ELECTRICAL APPARATUS SUCH AS MOTOR DRIVEN EQUIPMENT AND TRANSFORMERS SHALL BE 8'-0". SPACING REQUIREMENTS SHALL APPLY TO OPEN CABLING PATHWAYS WHERE EQUIPMENT IS LOCATED ON THE SAME FLOOR, FLOOR ABOVE, FLOOR BELOW, OR IN ROOMS ADJACENT TO SUCH EQUIPMENT AS THOUGH WALLS AND FLOORS DID NOT EXIST. EXCEPTION: BUILDING CONSTRUCTION THAT RESULTS IN CONTINUOUS METALLIC BARRIER BETWEEN ELECTRICAL APPARATUS AND CABLE PATHWAYS SHALL BE CONSIDERED AS SUITABLE SEPARATION.
15. PRIOR TO STARTING SECURITY INSTALLATION, CAREFULLY INSPECT INSTALLED WORK OF OTHER TRADES AND VERIFY THAT SUCH WORK IS COMPLETE TO THE POINT WHERE WORK MAY PROPERLY COMMENCE. NOTIFY THE ARCHITECT AND ENGINEER IN WRITING OF CONDITIONS DETRIMENTAL TO THE PROPER AND TIMELY COMPLETION OF THE WORK.
16. DO NOT BEGIN SECURITY INSTALLATION UNTIL ALL UNSATISFACTORY CONDITIONS ARE RESOLVED. BEGINNING WORK CONSTITUTES ACCEPTANCE OF CONDITIONS AS SATISFACTORY.
17. THE SECURITY CONTRACTOR SHALL PROVIDE ALL CONDUIT, OUTLET BOXES, JUNCTION BOXES, RACEWAY SYSTEMS, ETC. FOR A COMPLETE AND OPERATIONAL PATHWAY SYSTEM FOR ALL TELECOMMUNICATIONS SYSTEMS PER THE SCOPE OF WORK INDICATED ON THE CONSTRUCTION DRAWINGS AND BID SPECIFICATIONS.

ABBREVIATIONS

AC	AMPERE AIR CONDITIONING; ALTERNATING CURRENT, ABOVE COUNTER	LEC LTG	LOCAL EXCHANGE CARRIER LIGHTING
AF	AMP FUSE; AMP FRAME	M	METER
AFC	AVAILABLE FAULT CURRENT	MAN	METROPOLITAN AREA NETWORK
AFF	ABOVE FINISHED FLOOR	MAX	MAXIMUM
AG	ABOVE GRADE	MC	MAIN CROSS CONNECT; METAL CLAD (CABLE)
AHJ	AUTHORITIES HAVING JURISDICTION	MCB	MAIN CIRCUIT BREAKER
AHU	AIR HANDLING UNIT	MDF	MAIN DISTRIBUTION FRAME
AL	ALUMINUM	MDP	MAIN DISTRIBUTION PANEL
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE	MFR	MANUFACTURER
AS	AMP SWITCH	MH	MANHOLE
AT	AMP TRIP	MIN	MINIMUM
ATS	AUTOMATIC TRANSFER SWITCH	MLO	MAIN LUGS ONLY
AV	AUDIO VISUAL	MM	MULTIMODE
AWG	AMERICAN WIRE GAUGE	MPOE	MAIN POINT OF ENTRY
		MTD	MOUNTED
BAS	BUILDING AUTOMATION SYSTEM	MTS	MANUAL TRANSFER SWITCH
BATT	BATTERIES	MV	MEDIUM VOLTAGE
BIL	BASIC IMPULSE INSULATION LEVEL		
BKBD	BACKBOARD	(N)	NEW
BKR	BREAKER	N	NEUTRAL
BLDG	BUILDING	NAC	NOTIFICATION APPLIANCE CIRCUIT
		NEC	NATIONAL ELECTRICAL CODE
C	CONDUIT; DEGREES CELCIUS	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
CAB	CABINET		
CAT	CATEGORY	NF	NON-FUSED
CATV	COMMUNITY ANTENNA TELEVISION	NIC	NOT IN CONTRACT
CB	CIRCUIT BREAKER		
CCTV	CLOSED CIRCUIT TELEVISION	OFC	OPTICAL FIBER CABLE
CLG	CEILING	OHL	OVERHEAD LINE
CM	CEILING-MOUNTED	OL	OVERLOAD
CO	CONDUIT ONLY	OS	OCCUPANCY SENSOR
CR	CONTROLLED RECEPTACLE	OSP	OUTSIDE PLANT
CU	COPPER		
		P	POLE
D	DEDICATED	PH	PHASE
DDC	DIRECT DIGITAL CONTROL	PIR	PASSIVE INFRARED
DEMARC	DEMARICATION POINT	PIV	POST INDICATING VALVE
DISC	DISCONNECT	PNL	PANEL
DIST	DISTRIBUTION	PP	PATCH
DSL	DIGITAL SUBSCRIBER LINE	PVC	POLYVINYL CHLORIDE
DWG	DRAWING		
		RCP	REFLECTED CEILING PLAN
(E)	EXISTING	REC	RECEPTACLE
EA	EACH	REF	REFER TO
EIA	ELECTRONIC INDUSTRIES ASSOCIATION	REV	REVISION
ELEV	ELEVATION	RM	ROOM
EM	EMERGENCY	RMC	RIGID METALLIC CONDUIT
EMT	ELECTRICAL METALLIC TUBING	RTRC	REINFORCED THERMOSETTING RESIN CONDUIT
ENCL	ENCLOSURE	RU	RACK UNIT
EPM	ELECTRONIC POWER METER		
EPO	EMERGENCY POWER OFF	SHT	SHEET
EQUIP	EQUIPMENT	SM	SINGLEMODE
ETR	EXISTING TO REMAIN	SMFC	SURFACE-MOUNTED OPTICAL FIBER CABINET
		SMR	SURFACE METAL RACEWAY
F	FUSES; DEGREES FAHRENHEIT	SP	SERVICE PROVIDER
FA	FIRE ALARM	SPD	SURGE PROTECTIVE DEVICE
FAAP	FIRE ALARM ANNUNCIATOR PANEL	SPEC	SPECIFICATIONS
FACP	FIRE ALARM CONTROL PANEL	SPST	SINGLE POLE SINGLE THROW
FBO	FURNISHED BY OWNER	ST	SHUNT TRIP
FOIC	FURNISHED BY OWNER INSTALLED BY CONTRACTOR	STP	SHIELDED TWISTED PAIR
		SVGA	SUPER VIDEO GRAPHICS ARRAY
FOIO	FURNISHED BY OWNER INSTALLED BY OWNER	SW	SWITCH
		SWBD	SWITCHBOARD
G	GROUND		
GB	GROUND FAULT CIRCUIT INTERRUPTER BREAKER	TBB	TELECOMMUNICATIONS BONDING BACKBONE
GF	GROUND FAULT CIRCUIT INTERRUPTER	TEL	TELEPHONE
GFP	GROUND FAULT PROTECTION	TELCO	TELEPHONE COMPANY
GND	GROUND	TGB	TELECOMMUNICATIONS GROUNDING BUSBAR
GRS	GALVANIZED RIGID STEEL	TIA	TELECOMMUNICATIONS INDUSTRY ASSOCIATION
		TMGB	TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
HC	HORIZONTAL CROSS CONNECT	TP	TAMPERPROOF
HID	HIGH INTENSITY DISCHARGE	TR	TELECOMMUNICATIONS ROOM
HP	HORSEPOWER	TV	TELEVISION
HTR	HEATER	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSION
Hz	HERTZ	TYP	TYPICAL
IBC	INTERNATIONAL BUILDING CODE	UG	UNDERGROUND
IC	INTERMEDIATE CROSS CONNECT	UL	UNDERWRITERS LABORATORIES
IDF	INTERMEDIATE DISTRIBUTION FRAME	UON	UNLESS OTHERWISE NOTED
IEEE	INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS	UPS	UNINTERRUPTIBLE POWER SUPPLY
IG	ISOLATED GROUND	USB	UNIVERSAL SERIAL BUS
IMC	INTERMEDIATE METALLIC CONDUIT	UTP	UNSHIELDED TWISTED PAIR
ISDN	INTEGRATED SERVICES DIGITAL NETWORK	UV	UNIT VENTILATOR
J	JUNCTION	V	VOLTS
		VA	VOLT AMPERES
		VFD	VARIABLE FREQUENCY DRIVE
K	KIRK KEY		
KCMIL	THOUSAND CIRCULAR MILS	W	WASTE, WATT, WIDE, WATER
kVA	KILOVOLT AMPERE	W/	WITH
KVAR	KILOVOLT AMPERE REACTIVE	W/O	WITHOUT
KW	KILOWATT	WA	WORKSTATION AREA
		WAN	WIDE AREA NETWORK
LAN	LOCAL AREA NETWORK	WG	WIRE GUARD
LCP	LIGHTING CONTROL PANEL	WP	WEATHERPROOF



PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

H A R G I S

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz

SEAL



KEYPLAN

REV	DESCRIPTION	DATE

DATE 04/15/26

PROJECT No. 208570

PROJECT MANAGER JR

DESIGNER TV

CHECKED BH

APPROVED PS

FACILITY No. 1276

RECORD/SDCI No.

BLDG ID KNE

SHEET NAME

SECURITY ABBREVIATIONS AND GENERAL NOTES

SHEET No.

SE0.2

PROJECT TITLE

UW KANE HALL
CAAMS

BID SET

CONSULTANT NAME

shks ARCHITECTS

H A R G I S

1201 third avenue, ste 600
seattle, wa 98101
206.448.3376
www.hargis.biz

SEAL



KEYPLAN

REV	DESCRIPTION	DATE

DATE	04/15/26
PROJECT No.	208570
PROJECT MANAGER	JR
DESIGNER	TV
CHECKED	BH
APPROVED	PS
FACILITY No.	1276
RECORD/SDCI No.	
BLDG ID	KNE

SHEET NAME

SECURITY
ROUGH-IN
SCHEDULES

SHEET No.

SE0.3

ACCESS CONTROL ROUGH-IN SCHEDULE

SYMBOL	MOUNTING HEIGHT	DEVICE NAME	OUTLET BOX		CONDUIT			MUD RING	DETAIL	NOTES
			QTY	SIZE	QTY	SIZE	TERM LOCATION			
CR	+44"	CARD READER	1	4"S	1	1/2"	SEE ARCH DETAILS	SINGLE-GANG	1,2/SE8.2	1
CRM	+44"	CARD READER, MULLION	-	-	1	1/2"	SEE ARCH DETAILS	-	1,2/SE8.2	-
S	TOP OF FRAME	DOOR POSITION SWITCH	-	-	1	1/2"	SEE ARCH DETAILS	-	1,2/SE8.2	3
CLD	+44"	CLASSROOM LOCKDOWN BUTTON	1	4"S	1	1/2"	SEE ARCH DETAILS	SINGLE-GANG	-	-
R	-	INTEGRAL MICRO REX	-	-	-	-	-	-	1,2/SE8.2	-
S	SEE ARCH DETAILS	HORN/ STROBE	1	4"S	1	1/2"	SEE ARCH DETAILS	SINGLE-GANG	1,2/SE8.2	1
EL	-	ELECTRIFIED LOCKSET/ EXIT DEVICE	VARIES	SINGLE-GANG MASONRY	VARIES	1/2"	SEE ARCH DETAILS	-	1,2/SE8.2	4

- GENERAL NOTES:**
- A. MOUNTING HEIGHTS INDICATED ON THE SCHEDULE REFER TO CENTER OF BACK BOX.
 - B. COORDINATE ROUGH-IN REQUIREMENTS WITH SECURITY CONTRACTOR AND DOOR HARDWARE CONTRACTOR.
- NOTES:**
- 1. SINGLE-GANG MASONRY BACK BOXES ARE ACCEPTABLE FOR EXTERIOR MOUNTED DEVICES.
 - 2. PROVIDE FACEPLATE WITH COMPRESSION BOX CONNECTOR AND 1/4" ARMORED CABLING UNDER WORK SURFACE TO DEVICE.
 - 3. WHERE DOOR FRAME IS FILLED, PROVIDE SINGLE-GANG MASONRY BACK BOX AT TOP OF DOOR FRAME AT 4" ON CENTER FROM STRIKE SIDE OF DOOR.
 - 4. PROVIDE SINGLE-GANG MASONRY BACK BOX AT CENTER HINGE ON BOTH SIDES OR AT STRIKE.



REV	DESCRIPTION	DATE

DATE	04/15/26
PROJECT No.	208570
PROJECT MANAGER	JR
DESIGNER	TV
CHECKED	BH
APPROVED	PS
FACILITY No.	1276
RECORD/SDCI No.	
BLDG ID	KNE

SHEET NOTES

- SEE SHEET SE0.3 FOR BACK BOX REQUIREMENTS.
- COORDINATE DEVICE LOCATIONS AND HEIGHTS WITH ARCHITECTURAL ELEVATION DRAWINGS.
- SEE ARCHITECTURAL DRAWINGS FOR ROUTING AND PATHWAY REQUIREMENTS.
- EXISTING ITEMS SHOWN ARE DIAGRAMMATIC BASED ON AVAILABLE RECORD DRAWINGS AND SITE WALKS DURING THE DESIGN PERIOD. NOT ALL SYSTEM COMPONENTS ARE SHOWN. FIELD VERIFY DEVICE LOCATIONS AND QUANTITIES PRIOR TO COMMENCING WORK.

FLAG NOTES

- COORDINATE FINAL ACCESS CONTROL PANEL LOCATION WITH OWNER PRIOR TO INSTALLATION. SEE DETAILS ON SHEETS SE8.1, E6.1, AND E8.1 FOR ADDITIONAL INFORMATION.
- COORDINATE FINAL PANEL INTERFACE MODULE LOCATION WITH OWNER PRIOR TO INSTALLATION. CONNECT TO ACCESS CONTROL SYSTEM THROUGH RS-485 CONNECTION. PROVIDE 2#18, 4#22 SHIELDED FROM ACP. SEE ONE-LINE DIAGRAMS ON SE9.X SHEETS FOR ADDITIONAL INFORMATION.

