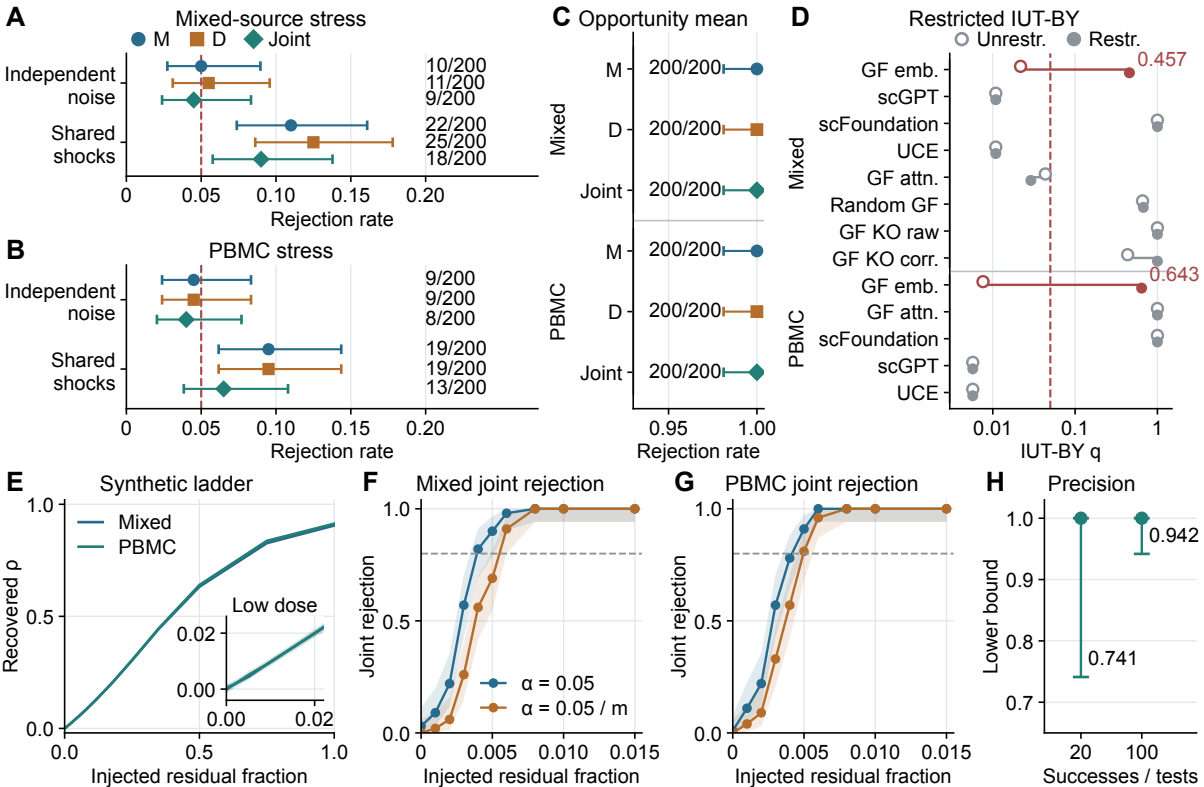
A
Mixed-source stress
M
D
Joint
Independent noise
Shared shocks
10/200
11/200
9/200
22/200
25/200
18/200
0
0.05
0.10
0.15
0.20
Rejection rate
B
PBMC stress
Independent noise
Shared shocks
9/200
9/200
8/200
19/200
19/200
13/200
0
0.05
0.10
0.15
0.20
Rejection rate
C
Opportunity mean
Mixed
PBMC
M
D
Joint
200/200
0.95
1.00
Rejection rate
D
Restricted IUT-BY
Unrestr.
Restr.
Mixed
PBMC
GF emb.
scGPT
scFoundation
UCE
GF attn.
Random GF
GF KO raw
GF KO corr.
0.457
0.643
0.01
0.1
1
IUT-BY q
E
Synthetic ladder
Mixed
PBMC
Low dose
Recovered ρ
Injected residual fraction
F
Mixed joint rejection
Joint rejection
α = 0.05
α = 0.05 / m
Injected residual fraction
G
PBMC joint rejection
Joint rejection
Injected residual fraction
H
Precision
Lower bound
0.942
0.741
20
100
Successes / tests