



A

Protocol-pass gates: 0/13 rows pass all predeclared checks

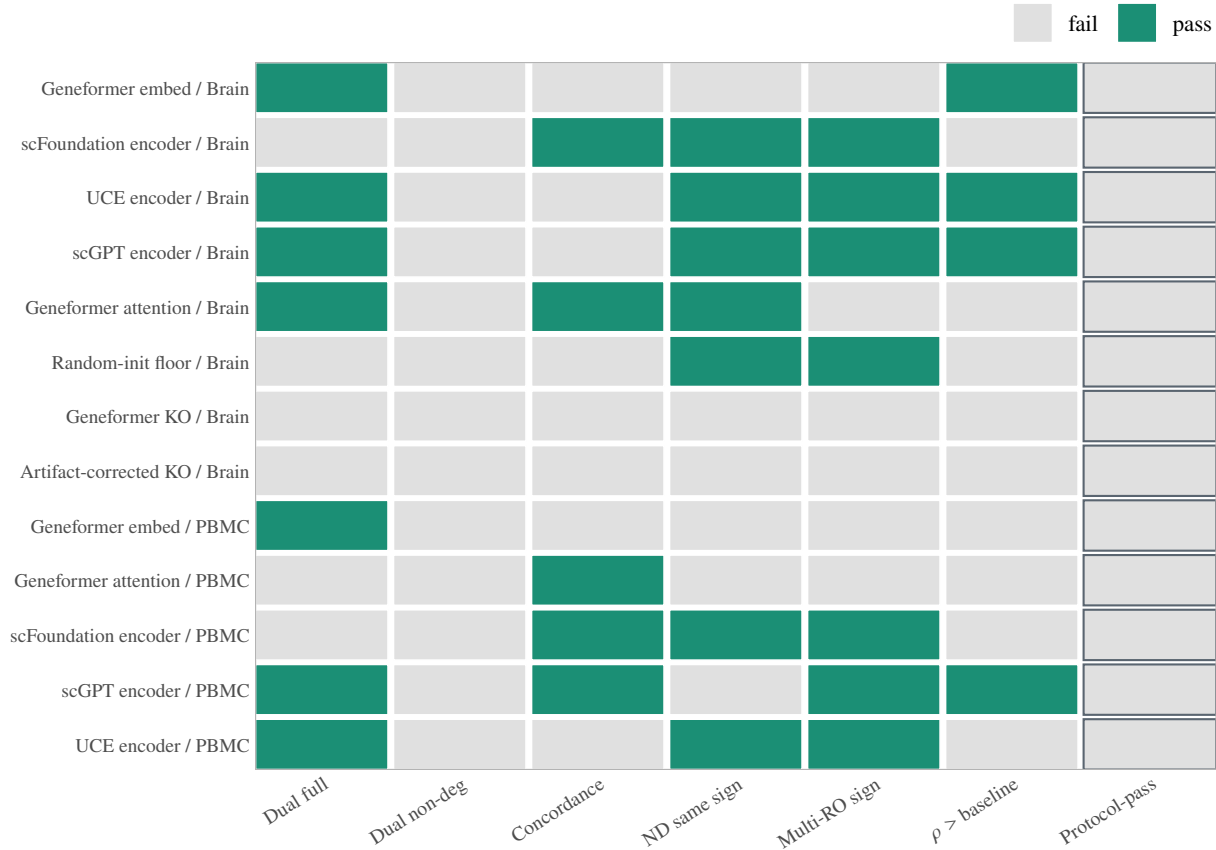

B

Protocol-instance scope (what this audit asks)

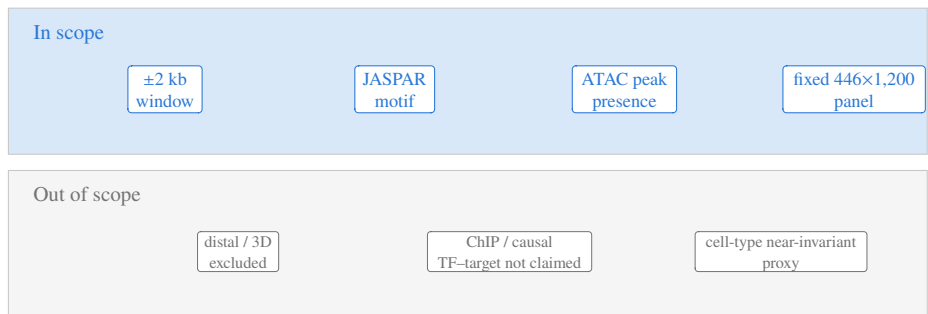

Failure here cannot be read as a field-level negative — other panels, tissues, or GRN-informed models could differ