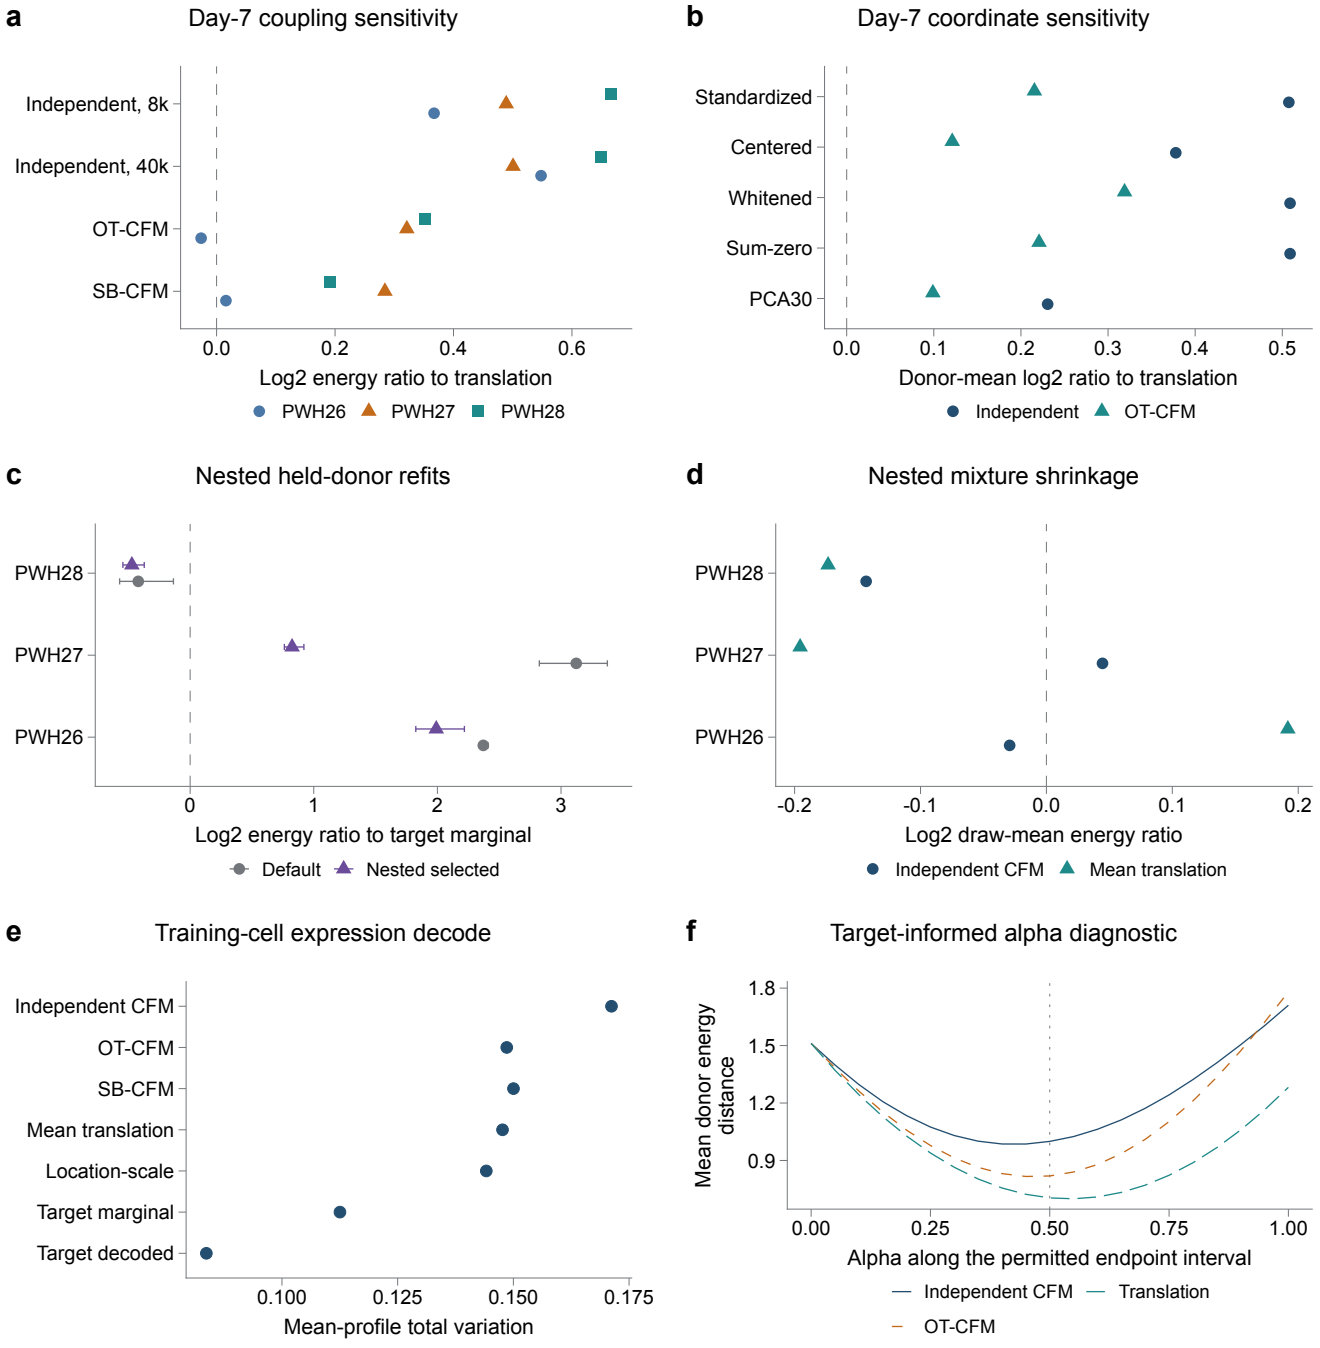
a
Day-7 coupling sensitivity
Independent, 8k
Independent, 40k
OT-CFM
SB-CFM
0.0
0.2
0.4
0.6
Log2 energy ratio to translation
PWH26
PWH27
PWH28
b
Day-7 coordinate sensitivity
Standardized
Centered
Whitened
Sum-zero
PCA30
0.0
0.1
0.2
0.3
0.4
0.5
Donor-mean log2 ratio to translation
Independent
OT-CFM
c
Nested held-donor refits
PWH28
PWH27
PWH26
0
1
2
3
Log2 energy ratio to target marginal
Default
Nested selected
d
Nested mixture shrinkage
PWH28
PWH27
PWH26
-0.2
-0.1
0.0
0.1
0.2
Log2 draw-mean energy ratio
Independent CFM
Mean translation
e
Training-cell expression decode
Independent CFM
OT-CFM
SB-CFM
Mean translation
Location-scale
Target marginal
Target decoded
0.100
0.125
0.150
0.175
Mean-profile total variation
f
Target-informed alpha diagnostic
Mean donor energy distance
1.8
1.5
1.2
0.9
0.00
0.25
0.50
0.75
1.00
Alpha along the permitted endpoint interval
Independent CFM
Translation
OT-CFM