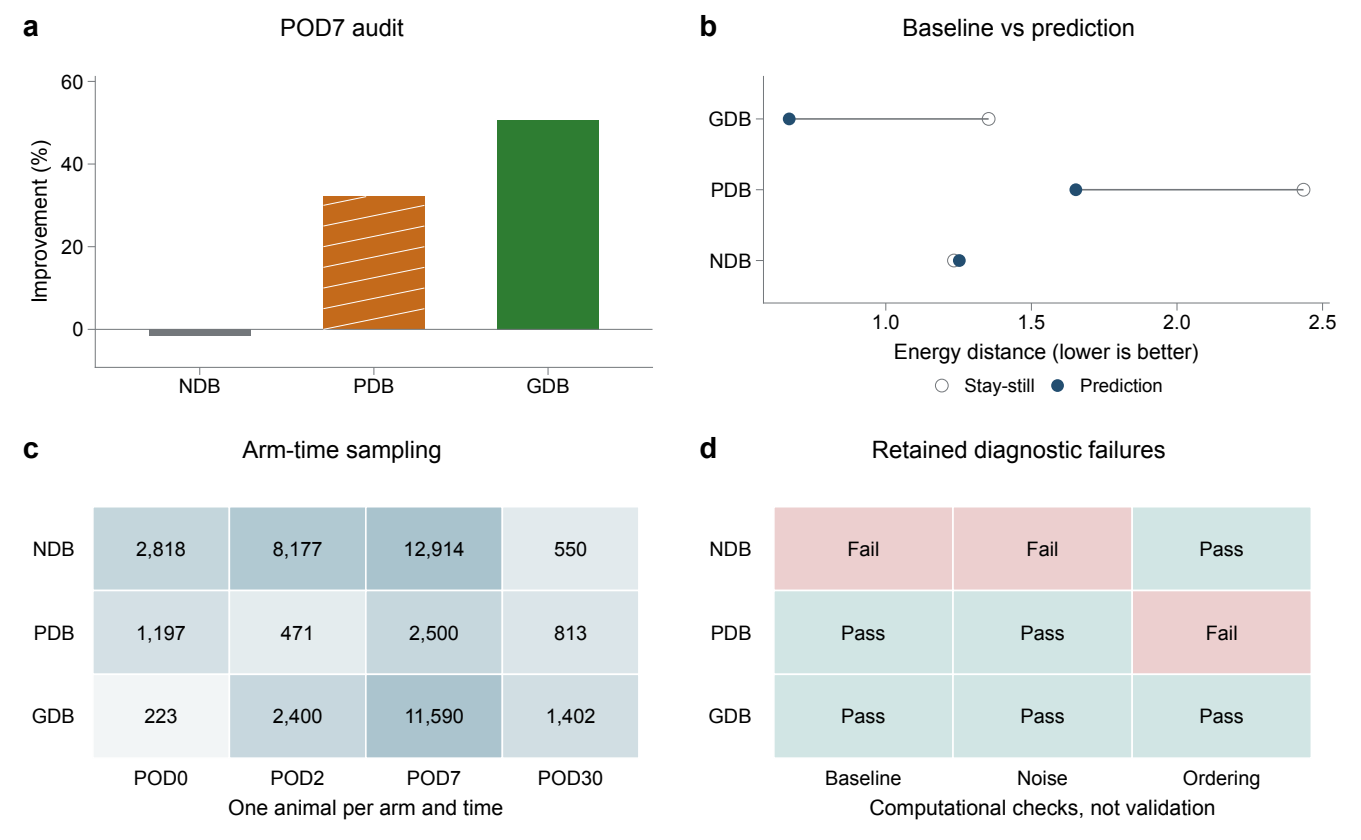
a
POD7 audit
Improvement (%)
60
40
20
0
NDB
PDB
GDB
b
Baseline vs prediction
GDB
PDB
NDB
1.0
1.5
2.0
2.5
Energy distance (lower is better)
Stay-still
Prediction
c
Arm-time sampling
NDB 2,818 8,177 12,914 550
PDB 1,197 471 2,500 813
GDB 223 2,400 11,590 1,402
POD0 POD2 POD7 POD30
One animal per arm and time
d
Retained diagnostic failures
NDB Fail Fail Pass
PDB Pass Pass Fail
GDB Pass Pass Pass
Baseline Noise Ordering
Computational checks, not validation