REVIVE 2024 Report
Resilience and ADORB Summary

Chicago-MDW_Phius Precriptive

1   Introduction

Some regular text and some*italic text.*
Also some crazy characters: $&#{}

1.1   Math that is incorrect

$$2 * 3 = 9$$

2   Tables

Tables for thermal resilience and ADORB Costs

2.1   Resilience Single Point Metrics

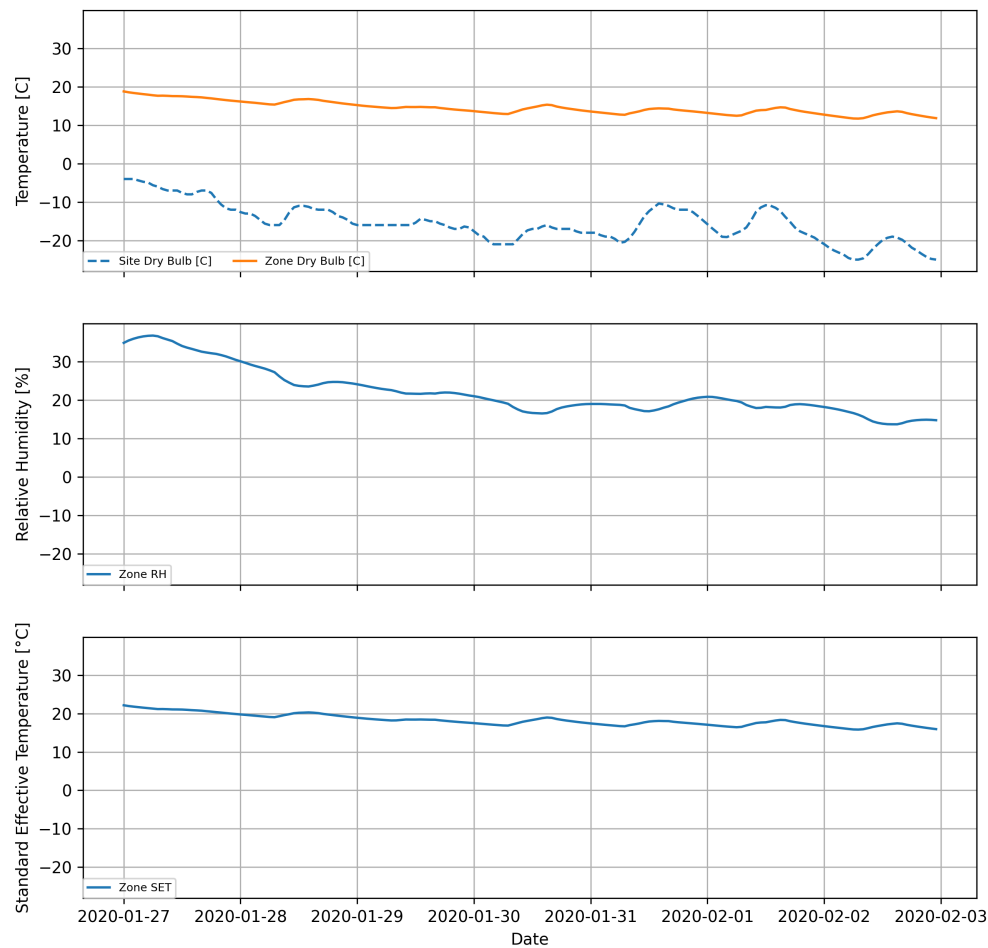| Metric	Result	Unit
Heating SET Hours	0.0	°F hr
Hours Below 2°C	0.0	hr
Caution ($> 26.7, < 32.2$°C)	60.0	hr
Extreme Caution ($> 32.2, < 39.4$°C)	60.25	hr
Danger ($> 39.4, < 51.7$°C)	0.0	hr
Extreme Danger (> 51.7°C)	0.0	hr
Heating Battery Size	6.946577471025454	kWh
Cooling Battery Size	4.696743169494214	kWh

2.2   Adorb Single Point Metrics

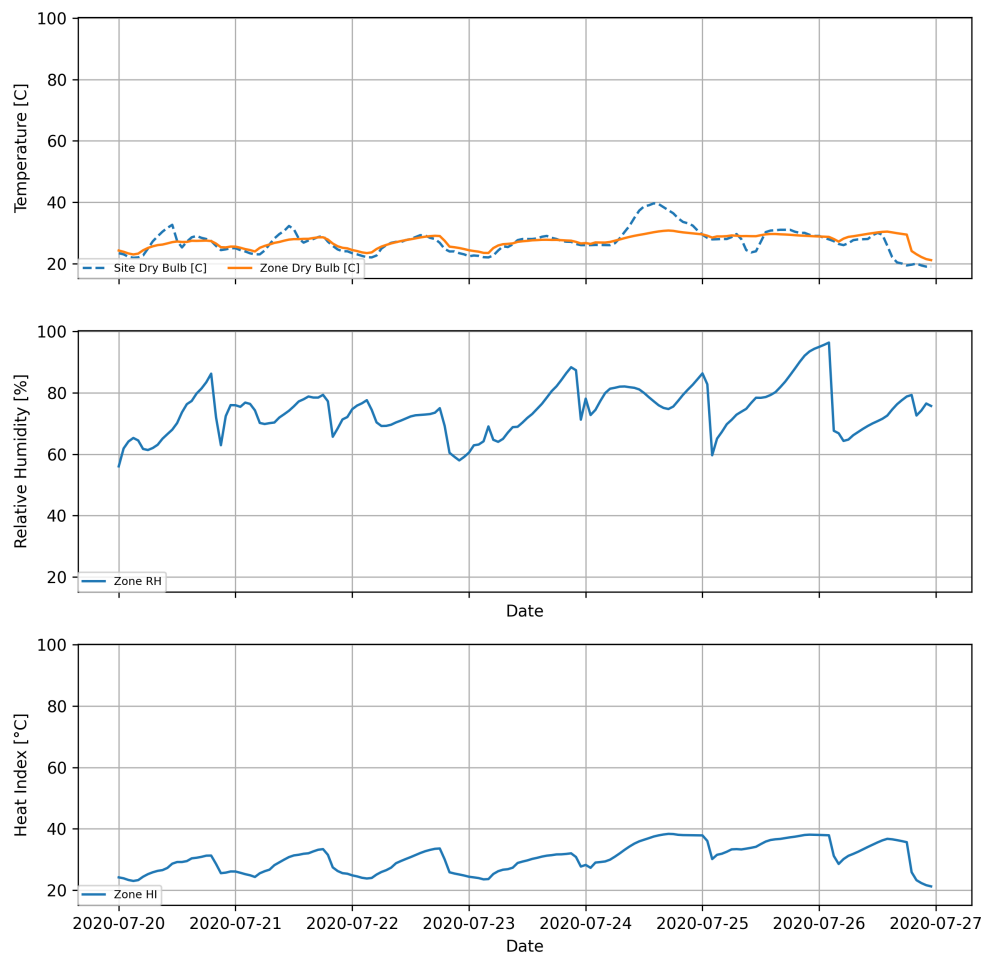| Metric	Result	Unit
Energy Use Intensity	14.02	kBtu/ sf yr
Peak Electrical Load	4000.57	W
First Year Electric Cost	992.9680847886119	$
First Cost	21075.714	$
Total ADORB Cost	86920.13861114542	$

3   Graph Results

Some regular text and some

3.1   Resilience Graph Results

Chicago-MDW_Phius Precriptive_Heating Outage Resilience

Chicago-MDW_Phius Precriptive_Cooling Outage Resilience

3.2   Adorb Graph Results

Name your batch of files_Chicago-MDW_Phius Precriptive_ADORB COST

Total Lifecycle ADORB Cost