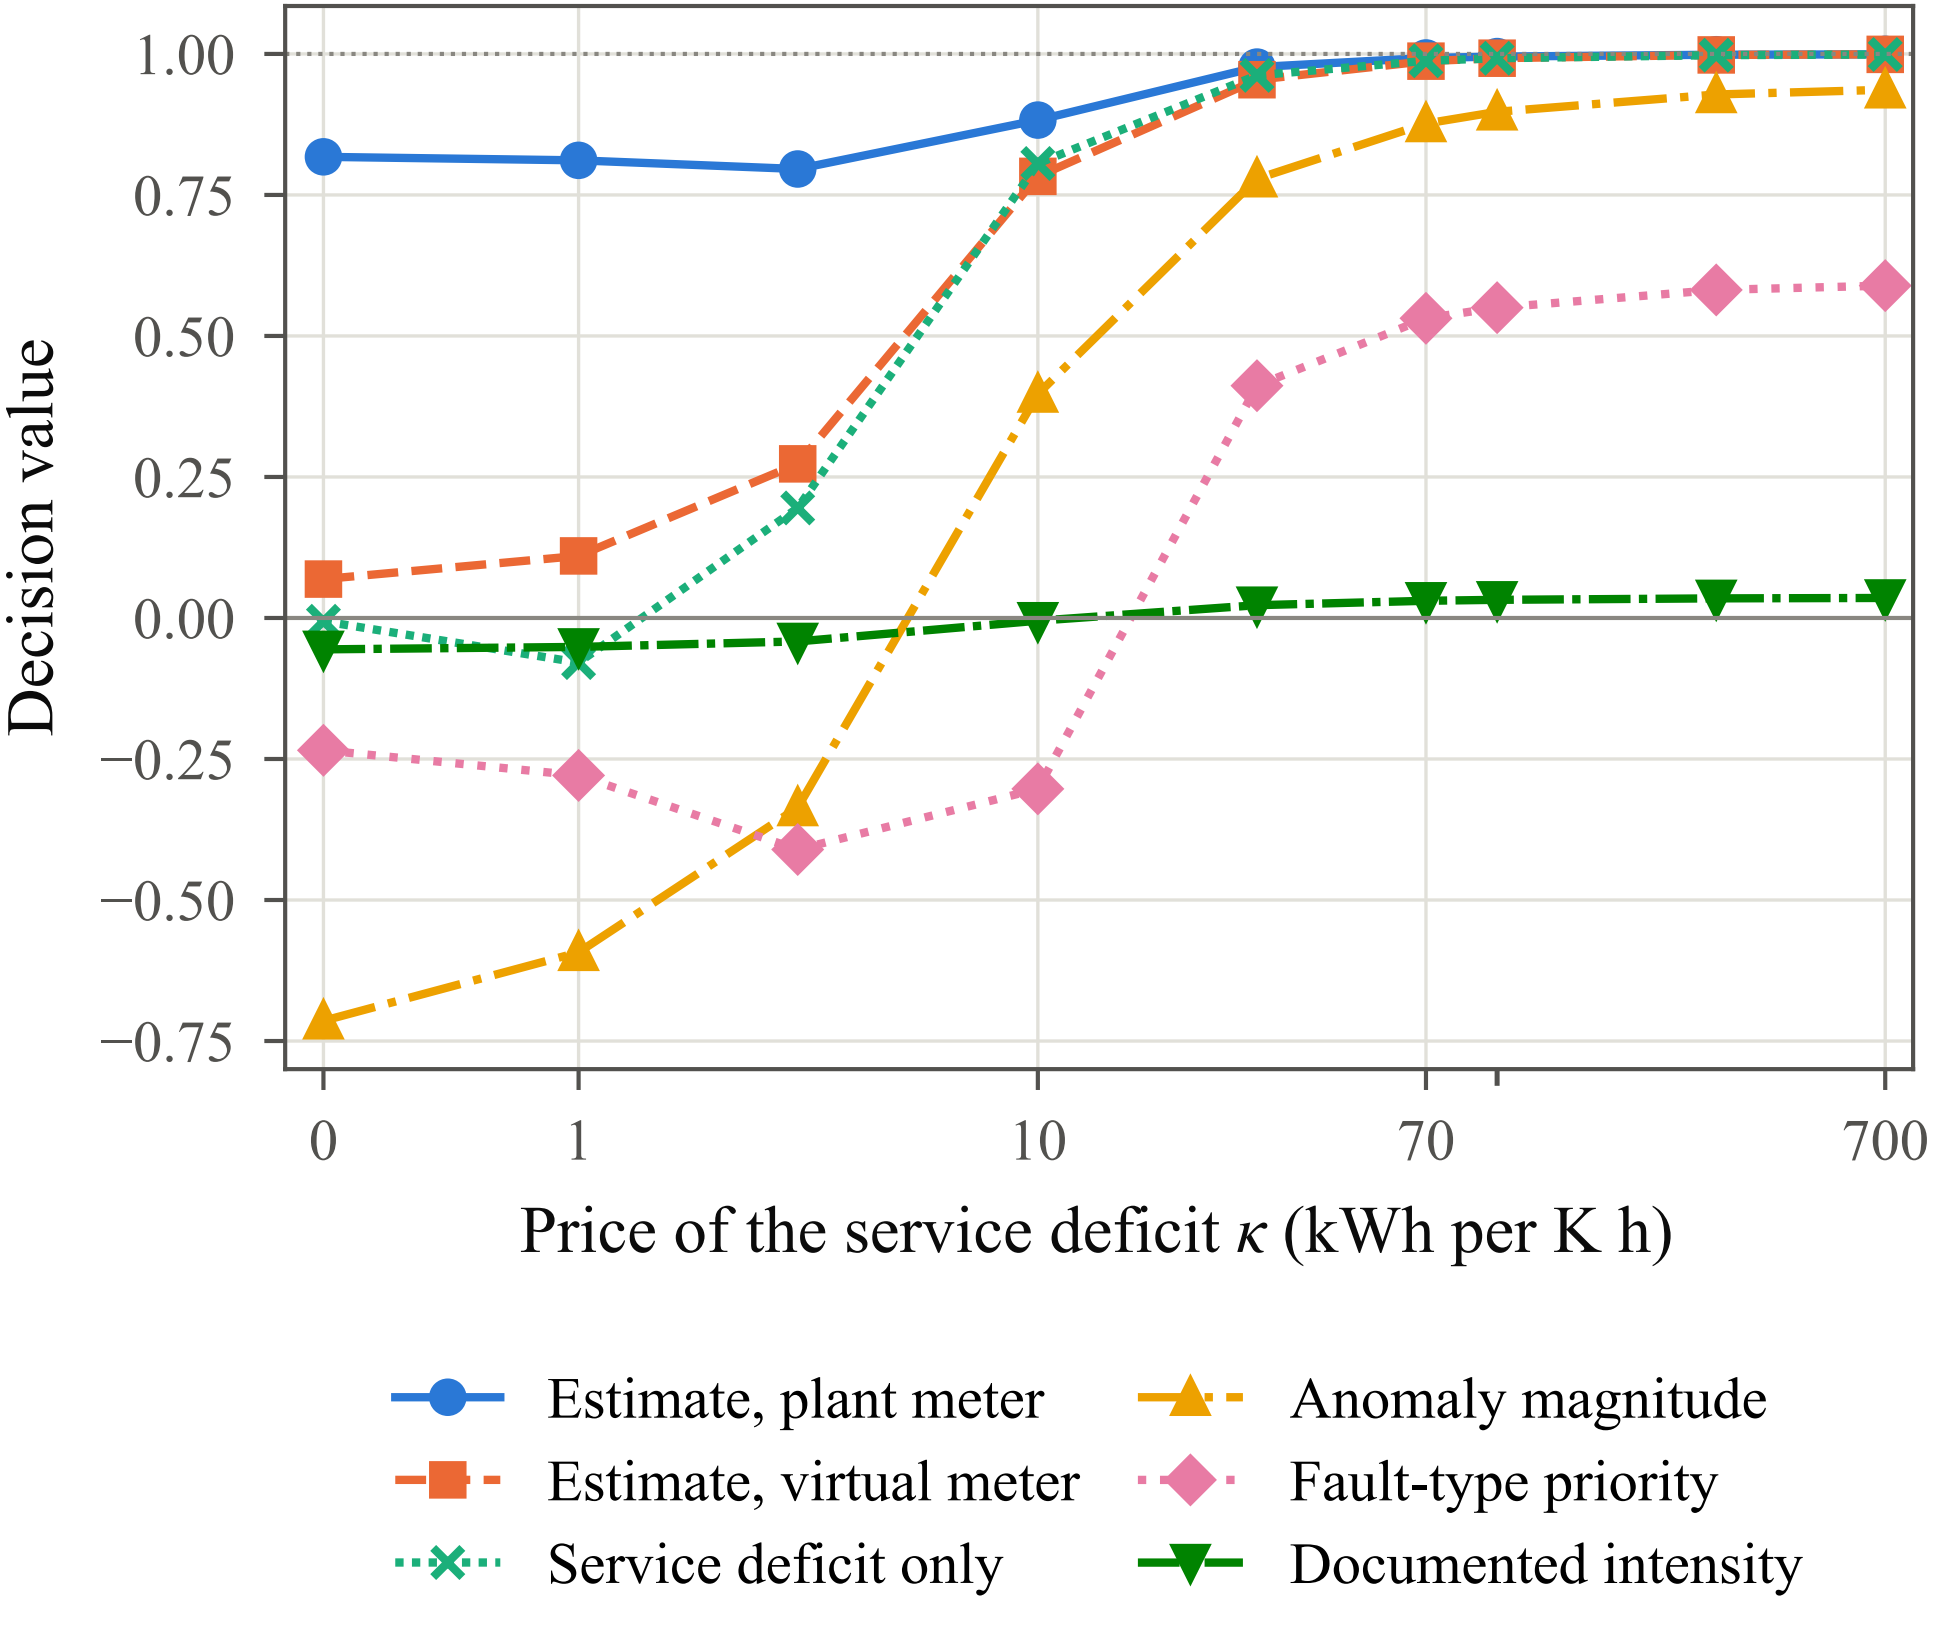
1.00
0.75
0.50
0.25
0.00
−0.25
−0.50
−0.75
Decision value
0
1
10
70
700
Price of the service deficit κ (kWh per K h)
Estimate, plant meter
Estimate, virtual meter
Service deficit only
Anomaly magnitude
Fault-type priority
Documented intensity