



Ref. No.: HT26/Q11

Dated: 04-04-2026

Mr. Padmanathan Alwar

M&C Department-Materials

Chennai Petroleum Corporation Limited

Manali, Chennai 600068

GEM Ref No.: GEM/2026/B/7389028
Publish Date: 25-03-2026
Bid Submission End Date: 10-04-2026
CPCL Tender Enquiry No.: C19M260039
Title: Procurement of Portable Igniters

Respected Sir,

We acknowledge with thanks the receipt of your above mentioned enquiry for online bid submission.
We, at M/s. Hindusthan Thermometers have been continuously striving to improve our services to enhance Customer Delight.

❖ The following documents are uploaded in the portal:


1. Unpriced offer - Details as per attached Annexure – 1
2. Bidder's Information Sheet
3. Pre-Qualification Details
4. Deviation Sheet
5. Declaration of Black Listing/ Holiday Listing
6. Declaration for Confidentiality Clause
7. Land Border Sharing Procurement Rules Declaration
8. Declaration of Compliance to the provisions of Section 206AB/206CCA of Income Tax Act, 1961
9. Local Content Declaration
10. Self Declaration Letter format for OEM
11. MSE Certificate – NSIC, UDYAM, GST, PAN, Turnover, ISO Certificate
12. HT Credentials- Catalogue

Particulars	HINDUSTHAN THERMOMETERS
Eligible Preferential Bidder Status	Yes, we are eligible for Preferential Bidder – Women MSEs
Make in India Class 1 – Min. 50%	Yes, class 1, 80% local Content
MSME L1+15.00 %	Yes
Place of Delivery:	CPCL - 600068

Hope all the required documents have been submitted.

If you need any further information please feel free to contact us.
Thanking you

For **HINDUSTHAN THERMOMETERS**


Ankur Jain



Page 1 of 4



Address

5, HSIDC Industrial Estate,
Ambala Cantt-133 001
Haryana, India



Contact Nos.

Ph: 91-171-4000453
Ph: 91-171-2980237
Mb. : 91-9416020237



Email & website :

htindia@gmail.com
info@htindia.in
www.htindia.in



Schedule 1

S.N.	Material Code & Description	HSN Code GST Rate	Qty.	Quoted (YES/NO)
1.	1399960304 Portable High Energy Igniter System Battery Operated Dwg No.: HT-7000237 Energy: 18 Joules, Input: 24VDC Input Voltage for Charging: 230V AC Area Classification: Zone-1 ,Gas Group- IIC, Temp Class T6 Consisting of	85118000 @18%	14 Nos.	YES
	A. HEA Igniton Excitor Box P/N: HT-HEA-EXD-BO-7J-H7 Operating Voltage: 24VDC Input main power supply : 230V AC for Charging Spark Energy: 7 Joules to 18 Joules FLP & WP Enclosure, Size: 320x320x150 mm, MOC: LM6 Area Classification: Zone 1 & 2, Gas Group IIC, Temp Class T6, PESO Approved Enclosure Having Isolator Switch, Push Button & Indicating Lamp for easy operation.			
	B. HEA Igniter Flexible Cable P/N: HT-FCA-1029-GLJ2 Length: 15 Meters $\pm$ 500 mm 2.5 Sq. mm Two Core multi strand copper cable with FLP Cable Gland at exciter end and FLP enclosure to Igniter Lance end.			
	C. HEA Rigid Spark Rod (Igniter Lance) P/N: HT-RSR-1016-SWL Insertion Length: 1500 mm from Stopper Length: 1557.5 mm (without Tip) Length: 1735 mm $\pm$ 15 mm, OD: 16mm $\pm$ 1 mm (when mounted with Spark Tip) i) Lance have center electrode supported by ceramic insulators. ii) Lance have removable tip at one end and the other end will be connected to small FLP enclosure, suitable for area IIC for cable termination. The igniter tip shall be prefabricated and will not require any gap adjustment.			
	D. HEA Igniter Spark Tip P/N: HT-ST-1012-A Length: 177 mm $\pm$ 3.0 mm Diameter: 16 mm $\pm$ 1 mm			



Address

5, HSIDC Industrial Estate,
Ambala Cantt-133 001
Haryana, India



Contact Nos.

Ph: 91-171-4000453
Ph: 91-171-2980237
Mb. : 91-9416020237



Email & website :

htindia@gmail.com
info@htindia.in
www.htindia.in



Ref. No.: HT26/Q11

Dated: 04-04-2026

Schedule 2

S.N.	Material Code & Description	HSN Code GST Rate	Qty.	Quoted (YES/NO)
2.	7195990644 Portable High Energy Igniter System 230V AC – Mains Operated Dwg No.: HT-7000180 Energy: 18 Joules, Input Voltage: 230V AC Area Classification: Zone-1 ,Gas Group- IIC, Temp Class T6 Consisting of	85118000 @18%	10 Nos.	YES
	A. HEA Igniton Excitor Box P/N: HT-HEA-EXD-1224-H7 Input Voltage : 230V AC $\pm$ 10V Spark Energy: 18 Joules FLP & WP Enclosure, Size: 320x320x150 mm, MOC: LM6 Area Classification: Zone 1 & 2, Gas Group IIC, Temp Class T6, PESO Approved Enclosure Having Isolator Switch, Push Button & Indicating Lamp for easy operation.			
	B. HEA Igniter Flexible Cable P/N: HT-FCA-1029-GLJ2 Length: 15 Meters $\pm$ 500 mm 2.5 Sq. mm Two Core multi strand copper cable with FLP Cable Gland at exciter end and FLP enclosure to Igniter Lance end.			
	C. HEA Rigid Spark Rod (Igniter Lance) P/N: HT-RSR-1016-SWL Insertion Length: 1500 mm from Stopper Length: 1557.5 mm (without Tip) Length: 1735 mm $\pm$ 15 mm, OD: 16mm $\pm$ 1 mm (when mounted with Spark Tip) i) Lance have center electrode supported by ceramic insulators. ii) Lance have removable tip at one end and the other end will be connected to small FLP enclosure, suitable for area IIC for cable termination. The igniter tip shall be prefabricated and will not require any gap adjustment.			
	D. HEA Igniter Spark Tip P/N: HT-ST-1012-A Length: 177 mm $\pm$ 3.0 mm Diameter: 16 mm $\pm$ 1 mm			



Page 3 of 4



Address

5, HSIDC Industrial Estate,
Ambala Cantt-133 001
Haryana, India



Contact Nos.

Ph: 91-171-4000453
Ph: 91-171-2980237
Mb. : 91-9416020237



Email & website :

htindia@gmail.com
info@htindia.in
www.htindia.in



Hindusthan Thermometers

Manufacturers of High Energy Igniters & Flame Scanners

Ref. No.: HT26/Q11

Dated: 04-04-2026

Terms & Conditions:

1.	Price Basis	Fixed, till execution of order
2.	INCOTERMS	F.O.R
3.	IncoTerms Location	CPCL, Manali, Chennai- 600068
4.	P & F	Inclusive
5.	Freight	Inclusive
6.	Transit Insurance	Inclusive
7.	IGST	Inclusive. Present rate is 18%.
8.	Payment	100% payment within 30 days of receipt and acceptance of material at site.
9.	Delivery	Within 2 months after receipt & acceptance of order.
10.	Inspection	At our works, if required.
11.	Price Validity	Our Offer is Valid for 120 Days.
12.	Warranty	12 Months from date of commissioning or 18 months from the supply which is earlier against any Manufacturing Defect.
13.	Fitment cum Interchangeability	Accepted
14.	Material Test Certificate	Will be provided along with dispatch documents, as applicable.
15.	L.D. clause	Accepted as per GEM
16.	Risk Purchase	Accepted as per GEM
17.	Security Deposit	Not Applicable
18.	PBG	Accepted as per GEM
19.	EMD	Not Applicable as per GEM
20.	NSIC Registration No.	NSIC/GP/AMB/2016/0024544, Valid up to: 06-12-2026.
21.	MSME	Udyam No.: UDYAM-HR-01-0001206 Udyog Aadhaar No. HR01B0000789, Date of issue: 16-09-2016 (Small)
22.	PAN	ADEPJ8984H-CHANDER LEKHA JAIN (PROPRIETOR)
23.	GSTIN	06ADEPJ8984H1Z5- Haryana
24.	Make	HINDUSTHAN THERMOMETERS
25.	Brand	TRU FIRE

Thanking You.

For **HINDUSTHAN THERMOMETERS**

Ankur Jain



Page 4 of 4



Address

5, HSIDC Industrial Estate,
Ambala Cantt-133 001
Haryana, India




Contact Nos.

Ph: 91-171-4000453
Ph: 91-171-2980237
Mb. : 91-9416020237



Email & website :

htindia@gmail.com
info@htindia.in
www.htindia.in

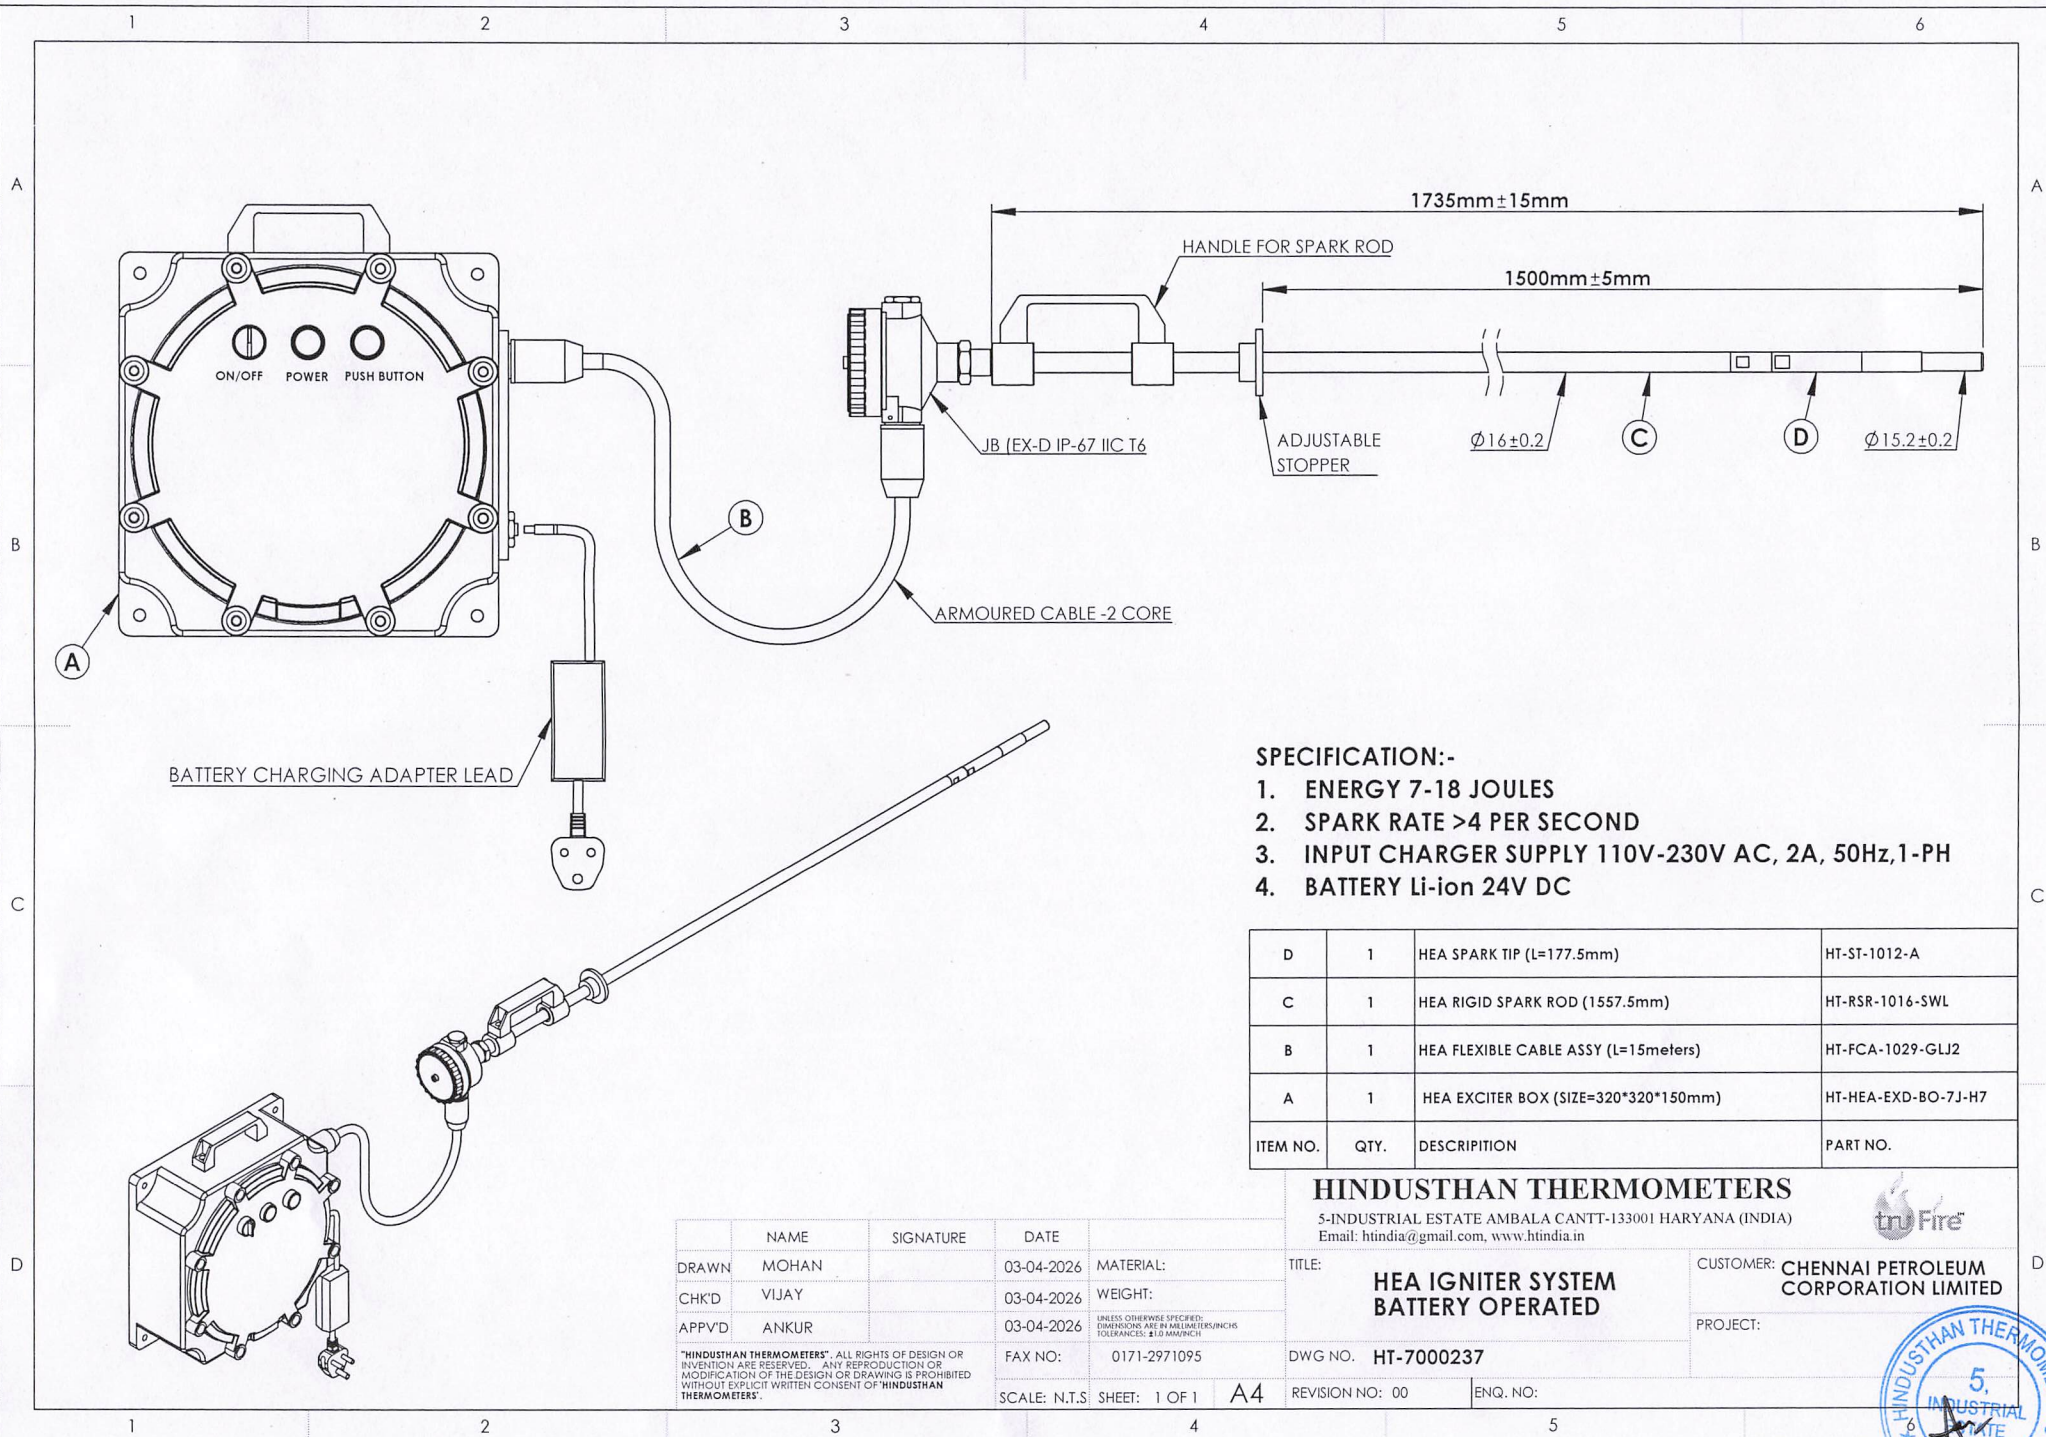

SPECIFICATION:-

1. ENERGY 7-18 JOULES
2. SPARK RATE >4 PER SECOND
3. INPUT CHARGER SUPPLY 110V-230V AC, 2A, 50Hz, 1-PH
4. BATTERY Li-ion 24V DC

D	1	HEA SPARK TIP (L=177.5mm)	HT-ST-1012-A
C	1	HEA RIGID SPARK ROD (1557.5mm)	HT-RSR-1016-SWL
B	1	HEA FLEXIBLE CABLE ASSY (L=15meters)	HT-FCA-1029-GLJ2
A	1	HEA EXCITER BOX (SIZE=320*320*150mm)	HT-HEA-EXD-BO-7J-H7
ITEM NO.	QTY.	DESCRIPTION	PART NO.

HINDUSTHAN THERMOMETERS

5-INDUSTRIAL ESTATE AMBALA CANTT-133001 HARYANA (INDIA)
Email: htindia@gmail.com, www.htindia.in



	NAME	SIGNATURE	DATE	MATERIAL:
DRAWN	MOHAN		03-04-2026	
CHK'D	VIJAY		03-04-2026	WEIGHT:
APPV'D	ANKUR		03-04-2026	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS/INCHES TOLERANCES: ±0.0 MM/MINCH
			FAX NO:	0171-2971095
			SCALE: N.T.S	SHEET: 1 OF 1

TITLE: **HEA IGNITER SYSTEM
BATTERY OPERATED**

CUSTOMER: **CHENNAI PETROLEUM
CORPORATION LIMITED**

PROJECT:

DWG NO. **HT-7000237**

REVISION NO: 00

ENQ. NO:



Exploded View Dimensions:

- Overall length: 1735mm ± 15mm
- Spark rod length: 1500mm ± 5mm
- Spark rod diameter: $\phi 16 \pm 0.2$
- Adjustable stopper diameter: $\phi 15.2 \pm 0.2$

Assembled View Labels:

- A: HEA Exciter Box 230V AC (Size: 320*320*150mm)
- B: HEA Flexible Cable Assy (L=15meters)
- C: HEA Rigid Spark Rod (1557.5mm)
- D: HEA Spark Tip (L=177.5mm)

JB (EX-D IP-67 IIC T6) Labels:

- ON/OFF ON
- POWER ON
- PUSH SPARK

Armoured Cable: -2 CORE

Handle for Spark Rod:

Adjustable Stopper:

Specifications:

- ENERGY 18 JOULES
- SPARK RATE > 6 PER SECOND
- INPUT SUPPLY 230V AC

ITEM NO.	QTY.	DESCRIPTION	PART NO.
D	1	HEA SPARK TIP (L=177.5mm)	HT-ST-1012-A
C	1	HEA RIGID SPARK ROD (1557.5mm)	HT-RSR-1016-S
B	1	HEA FLEXIBLE CABLE ASSY (L=15meters)	HT-FCA-1029-
A	1	HEA EXCITER BOX 230V AC (SIZE=320*320*150mm)	HT-HEA-EXD-1

HINDUSTHAN THERMOMETERS
5-INDUSTRIAL ESTATE AMBALA CANTT-133001 HARYANA (INDIA)
Email: htindia@gmail.com, www.htindia.in

HEA IGNITOR ASSY 230V AC

CUSTOMER: CHENNAI PETRO CORPORATION
PROJECT:

DWG NO. HT-7000180
REVISION NO. 00
ENQ. NO.

NAME	SIGNATURE	DATE	MATERIAL:
DRAWN: MOHAN		03-04-2026	
CHK'D: VIJAY		03-04-2026	
APPV'D: ANKUR		03-04-2026	

SCALE: N.T.S **SHEET:** 1 OF 1 **A4**

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS/INCHES TOLERANCES: ± 0.5 MM/MINUS

"HINDUSTHAN THERMOMETERS". ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. ANY REPRODUCTION OR MODIFICATION OF THE DESIGN OR DRAWING IS PROHIBITED WITHOUT EXPLICIT WRITTEN CONSENT OF "HINDUSTHAN THERMOMETERS".

1. ENERGY 18 JOULES
2. SPARK RATE >6 PER SECOND
3. INPUT SUPPLY 230V AC

D	1	HEA SPARK TIP (L=177.5mm)	HT-ST-1012-A
C	1	HEA RIGID SPARK ROD (1557.5mm)	HT-RSR-1016-SWL
B	1	HEA FLEXIBLE CABLE ASSY (L=15meters)	HT-FCA-1029-GLJ2
A	1	HEA EXCITER BOX 230V AC (SIZE=320*320*150mm)	HT-HEA-EXD-1224-H7
ITEM NO.	QTY.	DESCRIPTION	PART NO.

5-INDUSTRIAL ESTATE AMBALA CANTT-133001 HARYANA (INDIA)
Email: htindia@gmail.com, www.htindia.in



CUSTOMER: CHENNAI PETROLEUM CORPORATION LIMITED

PROJECT:

HEA IGNITOR ASSY
230V AC

DWG NO. HT-7000180

REVISION NO: 00

ENQ. NO:

	NAME	SIGNATURE	DATE	
DRAWN	MOHAN		03-04-2026	MATERIAL:
CHK'D	VIJAY		03-04-2026	WEIGHT:
APP'VD	ANKUR		03-04-2026	UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS/INCHES TOLERANCES: ± 0.0 MM/0.001"
"HINDUSTHAN THERMOMETERS" ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. ANY REPRODUCTION OR MODIFICATION OF THE DESIGN OR DRAWING IS PROHIBITED WITHOUT EXPLICIT WRITTEN CONSENT OF HINDUSTHAN THERMOMETERS .			FAX NO:	0171-2971095
			SCALE: N.T.S	SHEET: 1 OF 1

A4