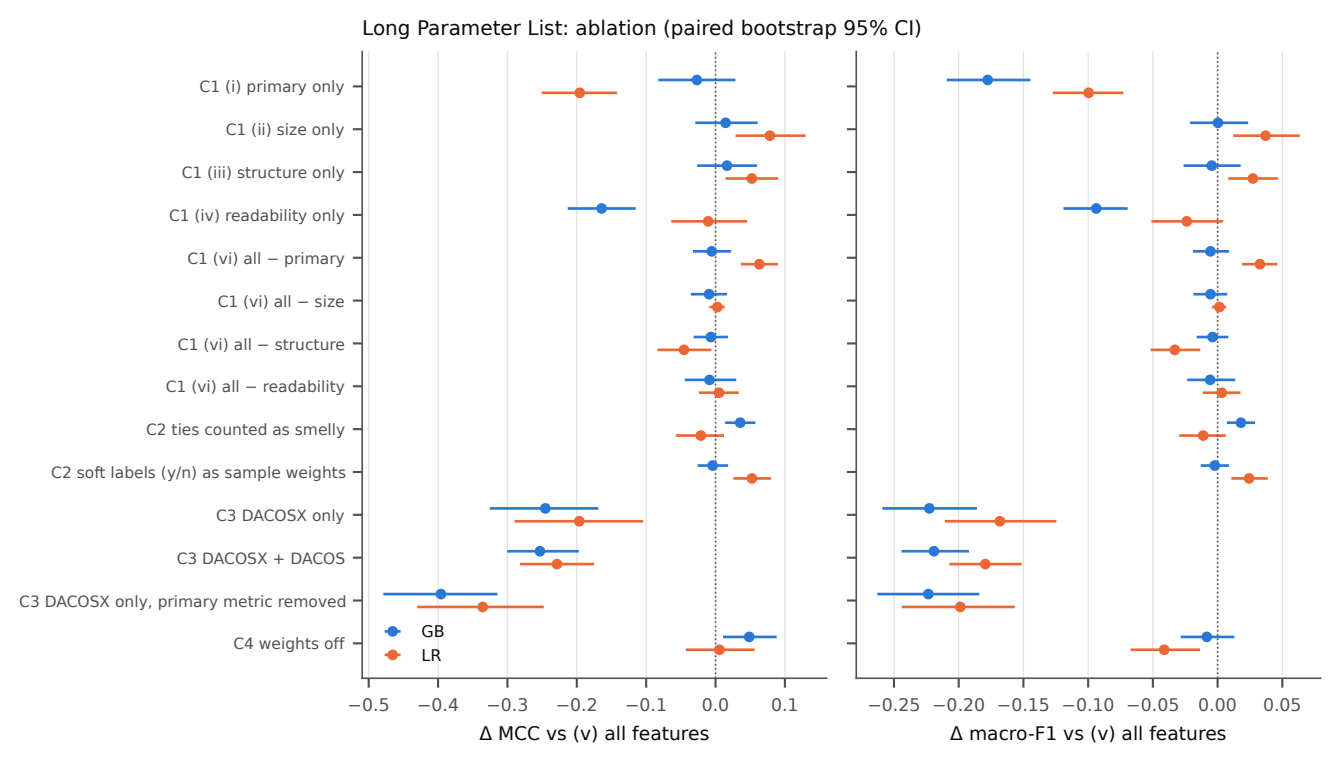
Long Parameter List: ablation (paired bootstrap 95% CI)
C1 (i) primary only
C1 (ii) size only
C1 (iii) structure only
C1 (iv) readability only
C1 (vi) all − primary
C1 (vi) all − size
C1 (vi) all − structure
C1 (vi) all − readability
C2 ties counted as smelly
C2 soft labels (y/n) as sample weights
C3 DACOSX only
C3 DACOSX + DACOS
C3 DACOSX only, primary metric removed
C4 weights off
GB
LR
−0.5
−0.4
−0.3
−0.2
−0.1
0.0
0.1
Δ MCC vs (v) all features
−0.25
−0.20
−0.15
−0.10
−0.05
0.00
0.05
Δ macro-F1 vs (v) all features