

AMENDMENT NO. 3 JULY 1980
TO
IS : 2750-1964 SPECIFICATION FOR
STEEL SCAFFOLDINGS

Alterations

(Page 4, clause 2.2.1) — Substitute the following for the existing clause:

'2.2.1 Independent Scaffold — The scaffolding supported on two rows of uprights, independent of the structure under construction but securely supported against collapse with the help of proper strutting or bracing and rigidly connected with the building or other structure unless so designed to ensure stability without such connection.'

'Note — Tall independent scaffoldings are usually tied to the structure at suitable intervals or otherwise supported at suitable intervals for additional stability.'

(Page 6, clause 2.3.14) — Substitute the following for the existing clause:

'2.3.14 Putlog, Ancillary or Intermediate (or Board Bearer) — A tube or other member spanning from ladder to the wall of a building which may have an attached coupler for the purpose of securing such tube or member to a ledger and which may have a specially formed end (which may be detachable) for the purpose of fixing into brickwork, and used between putlogs for the purpose of supporting scaffold boards at positions and spacing required.'

(Page 7, clause 4.1.1) — Substitute the following for the existing clause:

"4.1.1 Steel tubes for individual component types scaffolding shall be of heavy class welded or seamless tubes of 40 mm nominal bore and of grade not less than YST 22 of IS : 1161-1968 'Specification for Steel Tubes for Structural Purposes (Second Revision)'."

(Page 7, clause 4.1.2):

- a) Line 3 — Substitute ' IS : 1161-1968 ' for ' IS : 1161-1963 '.
- b) Line 5 — Substitute ' IS : 806-1968 Code of Practice for Use of Steel Tubes in General Building Construction (First Revision) ' for ' IS : 806-1957 Code of Practice for use of Steel Tubes in General Building Construction '.

(Page 13, clause 4.2) — Substitute the following for the existing clause:

Gr 1

“4.2 Steel Fittings — All fittings shall be manufactured from steel which when analysed in accordance with the relevant part of IS : 228 Methods of Chemical Analysis of Pig Iron, Cast Iron and Plain Carbon and Low Alloy Steels shall show not more than 0.06 percent of sulphur, and not more than 0.06 percent of phosphorous and shall also conform to steels of Schedule II of IS : 1570-1961 ‘Schedules for Wrought Steels for General Engineering Purposes’.”

(Page 13, clauses **4.3.1** and **4.3.2**) — Substitute the following for the existing clauses:

“4.3.1 Steel sections and bars shall conform to IS : 226-1975 ‘Specification for Structural Steel (Standard Quality) (Fifth Revision)’.

4.3.2 Rivet bars shall conform to IS : 1148-1975 ‘Specification for Hot Rolled Steel Rivet Bars (Up to 40 mm Diameter) for Structural Purposes (First Revision)’.”

(Page 14, clause **4.4**) — Substitute the following for the existing clause:

“4.4 Bolts and Nuts — Bolts and nuts shall have mechanical properties not less than those specified in Table 5 (4D) of IS : 1367-1967 ‘Technical Supply Conditions for Threaded Fasteners (First Revision)’ and shall also conform to the requirements of IS : 1362-1962 ‘Dimensions for Screw Threads for General Purposes (Diameter Range 1.6 to 39 mm) (Revised)’ where applicable.”

(Pages 14 and 15, clause **6.2**) — Substitute the following for the existing clause:

‘6.2 The manufacturer or supplier shall also produce sufficient evidence (either calculations or test data) in fulfilment of the design criteria (see 5.1 and 5.2). Where so required by the purchaser or user, the manufacturer or supplier shall furnish and wherever possible suitably exhibit on the scaffolding, the following particulars:

- a) Design load which may be imposed on the scaffolding as a whole, and the distribution of this load upon which the design of trestles, tripods or unit frames is based;
- b) Limitations of height, width or breadth in any direction, with or without supports derived from the structure;
- c) Maximum distance to which the scaffolding can be extended beyond a given dimension in any direction, and the type of support required for the purposes; and
- d) Any other restrictions on the usage or transportation of scaffoldings, fittings, prefabricated frames and components.’

(Page 15, clause **7.3.3.1**) — Delete and renumber subsequent clauses accordingly:

[Page 18, clause 7.3.5.1(a) and (b)] — Substitute the following for the existing matter:

- a) *Test for distortion* — The coupler, connecting two tubes at a 45° angle and suitably prevented from slipping on both tubes as shown in Fig. 9 shall be capable of supporting without distortion a load of 1.5 tonnes.
- b) *Test for slip* — The coupler, connecting two tubes at a 45° angle as shown in Fig. 10 shall be capable of sustaining a load of 1.25 tonnes applied to the vertical tube. During this test the coupler shall not rotate through an angle greater than 10° from the horizontal.

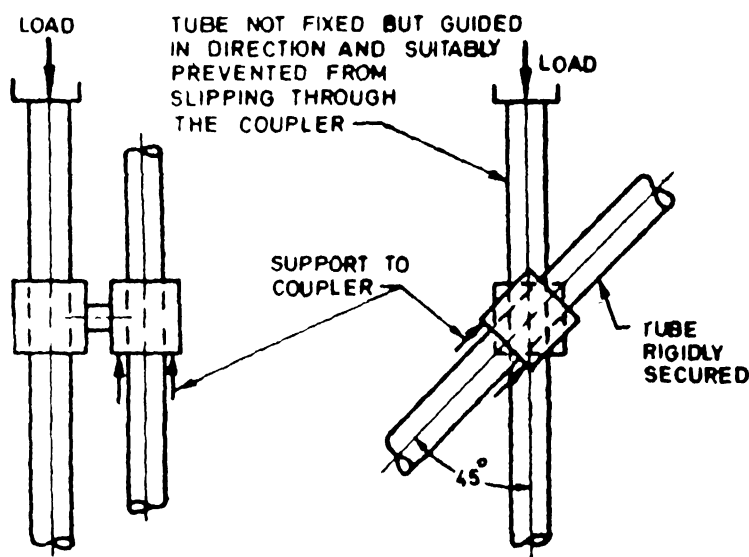


FIG. 9 TEST FOR DISTORTION OF SWIVEL COUPLERS

(Page 18, clause 7.3.6) — Substitute the following for the existing clause:

7.3.6 Putlog Couplers — The grip afforded by a putlog coupler shall offer adequate resistance to horizontal or axial rotation, slip or accidental displacement of a putlog. A putlog coupler shall be capable of passing the following test:

Test for Slip — The coupler connecting two tubes at right angles, as shown in Fig. 11 and assembled as recommended by the manufacturer, shall be capable of sustaining load of 130 kg applied to the horizontal putlog or transom.

NOTE — A putlog coupler shall be capable of satisfying the test for slip and shall be of such a shape as to be readily distinguishable from a right angle coupler.

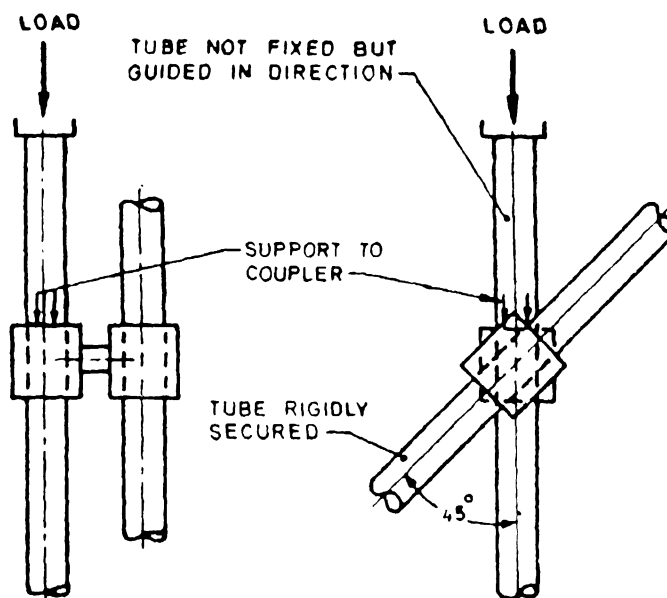


FIG. 10 TEST FOR SLIP OF SWIVEL COUPLER

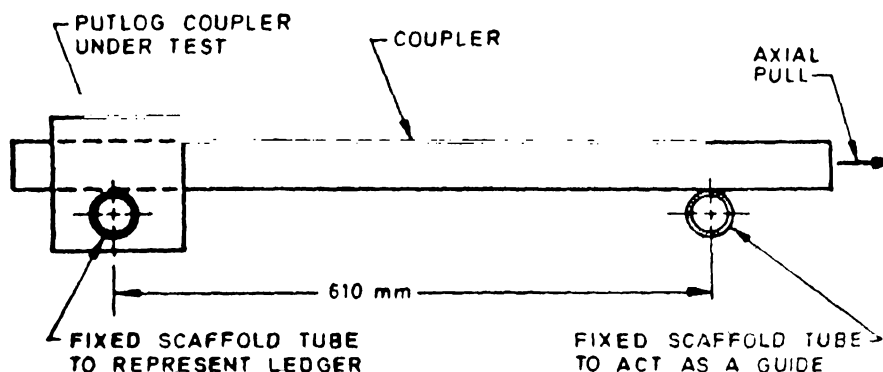


FIG. 11 RIG FOR SLIP TESTS ON PUTLOG COUPLERS

(Page 20, clause 7.3.10.3, line 2) — Substitute ' FIG. 12 ' for ' FIG 9 '.

(Page 20, Fig. 9, caption) — Substitute ' FIG. 12 ' for ' FIG. 9 '.

(Page 21, clause 7.4.4.1) — Substitute the following for existing clause:

‘7.4.4.1 Adjustment of height of tripod — Where tripods are capable of adjustment for height, the means of adjustment shall be such that when adjusted at any height, it shall be incapable of displacement under vibration or shock during normal conditions of usage.’

(Page 21, clause 7.4.5) — Substitute the following for the existing clause:

‘7.4.5 The shorter of the base dimensions of a trestle shall be at least one-fourth of the height of the trestle. In case of a trestle of adjustable height, the height for the purpose of this standard shall be maximum height to which the trestle can be adjusted.

7.4.5.1 Adjustment for the height of trestle — Where trestles are capable of adjustment for the height, the means of adjustment shall be such that when adjusted at any height, it shall be incapable of disturbance, or displacement under vibration or shock during normal conditions of usage.’

(Page 22, clause 7.4.7.2) — Substitute the following for the existing clause:

“7.4.7.2 Welding — Welding shall be carried out on steel tubes in accordance with IS : 6227-1971 ‘Code of Practice for Use of Metal Arc Welding in Tubular Structures’, and on other steel sections in accordance with IS : 816-1969 ‘Code of Practice for Use of Metal Arc Welding for General Construction in Mild Steel (First Revision)’ or IS : 1323-1966 ‘Code of Practice for Oxy-Acetylene Welding for Structural Work in Mild Steel (Revised)’.”

(Page 23, clause 9.1, line 1) — Substitute ‘ may ’ for ‘ shall ’.

Addenda

(Page 6, clause 2.3.23) — Add the following new clauses after 2.3.23:

‘2.3.24 Scaffolding — A temporary structure on which persons work, and which provides support for plant and materials used in building construction, maintenance, repair and demolition work.

2.3.25 Sleeve Coupler — An external fitting for connecting two tubes and to end.’

(Page 21, clause 7.3.12.2) — Add the following new clause after 7.3.12.2:

‘7.3.13 Sleeve Coupler — A sleeve coupler shall be selfcentring when plain ended tubes are being joined so that an equal length of sleeve shall engage both the tubes connected by the sleeve.

It shall have, in every position, a resistance to bending at least equal to that of the tube with which the sleeve coupler is intended to be used. When used in tension, it shall resist, without slipping, an axial load of not less than 635 kg.’

(8DC 28)