

**AMENDMENT NO. 2 NOVEMBER 2011
TO
IS 13049 : 1991 DIAPHRAGM TYPE (PLASTIC BODY)
FLOAT OPERATED VALVES FOR COLD WATER
SERVICES — SPECIFICATION**

(*Page 6, Annex E*) — Substitute following for the existing:

ANNEX E

FLOW TEST

E-1 LOW PRESSURE SEAT TEST

E-1.1 Apparatus

E-1.1.1 A test rig [*see Fig. 4(a)*] capable of maintaining 1 ± 0.1 m head of water at the seat of the valve under test, comprising a cistern, connected through 15 mm copper pipe work to the specimen valve via a controlling gate valve.

E-1.2 Procedure

Fit the float operated valve (installed with the LP seat) to be tested together with its discharge arrangement. Remove the float. Cause the valve to discharge water from cistern *A* into container *B* [*see Fig. 4(a)*] for a period of 140 ± 5 s whilst maintaining, for the duration of the test the water level in cistern *A* at a height of 1 ± 0.1 m above the centre of the inlet of the valve.

E-1.3 Result


Record the amount of water in container *B*.

E-2 HIGH PRESSURE SEAT TEST

E-2.1 Apparatus

E-2.1.1 A test rig [*see Fig. 4(b)*] capable of maintaining a constant pressure of 0.35 ± 0.01 MPa the inlet of the valve under test, connected through 15 mm copper pipe work to the specimen valve via a controlling gate valve.

Amend No. 2 to IS 13049 : 1991

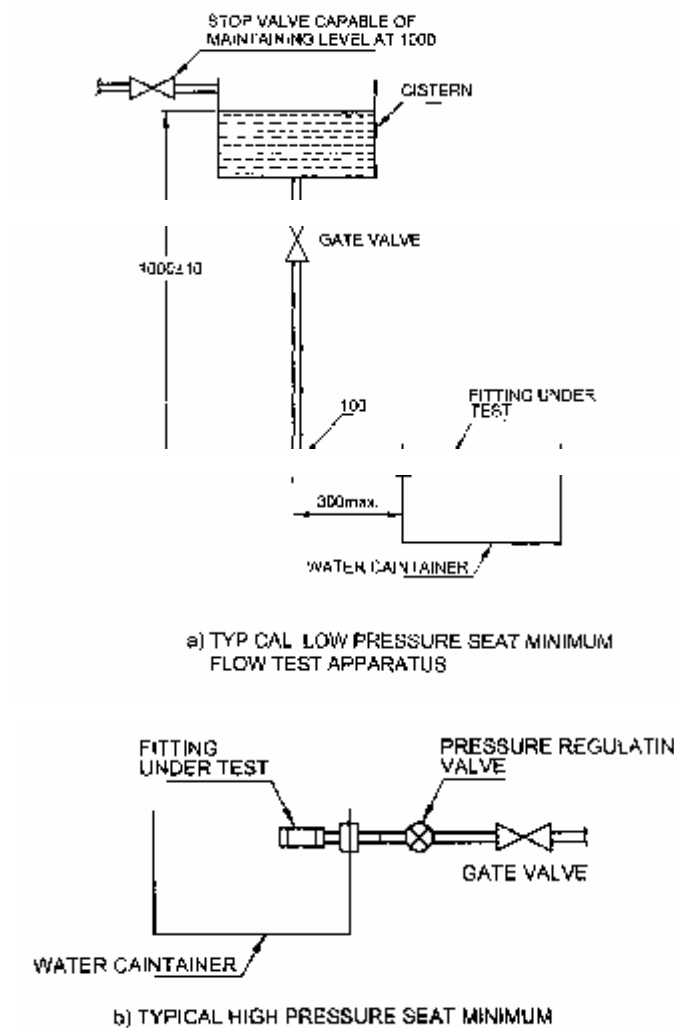

All dimensions in millimetres.
FIG. 4 FLOW TEST APPARATUS

Amend No. 2 to IS 13049 : 1991

E-2.2 Procedure

Fit the float operated valve (installed with HP seat) to be tested together with its discharge arrangement. Remove the float. Cause the valve to discharge water into container *B* for a period of 140 ± 5 s whilst maintaining, for the duration of the test the constant pressure of 0.35 ± 0.01 MPa at the seat.

E-3 RESULT

Record the amount of water in container *B*.