

AMENDMENT NO. 2 JUNE 2011
TO
IS 9537 (PART 3) : 1983 SPECIFICATION FOR CONDUITS FOR ELECTRICAL
INSTALLATIONS


PART 3 RIGID PLAIN CONDUITS OF INSULATING MATERIALS

(Page 10, clause 9.2.4) — Substitute the following for the existing matter:

‘9.2.4 The sample shall be kept inside the deep freezer the temperature of which is maintained at $-5 \pm 2^{\circ}\text{C}$ and the test shall be conducted when the samples have attained the temperature of the air within the freezer or after 2 h, whichever is longer period.’

(Amendment No. 1, page 1, clause 7.1.1) — Substitute the following for the existing matter:


7.1.1 Compliance to the dimension of the socket may be verified with the help of gauges as shown in Fig. 7 and Fig. 8.

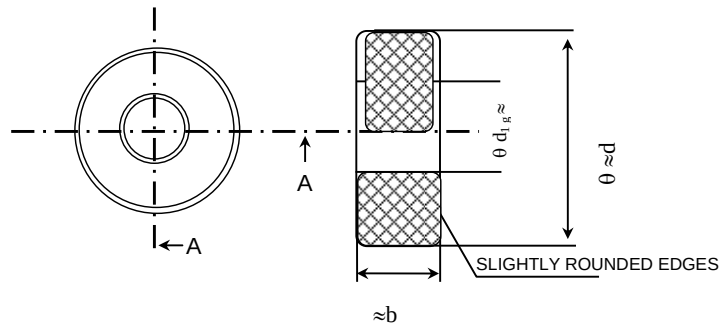

Size	Diameter, Max	b	d
16	20.1	12	45
20	24.5	12	45
25	29.8	16	60
32	37.8	18	70
40	46.1	18	70
50	57.3	20	85
63	69.6	20	100

FIG. 7 GAUGE FOR CHECKING MAXIMUM OUTSIDE DIAMETER OF SOCKET-END

Amend No. 2 to IS 9537 (Part 3) : 1983

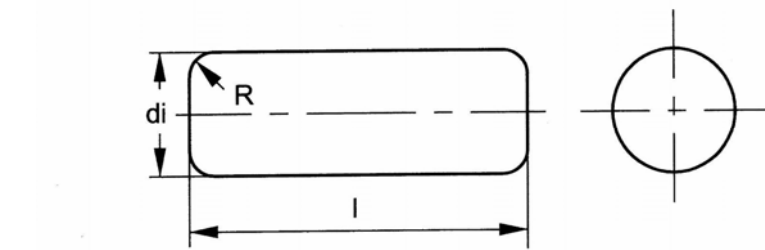

Size	Diameter, d_i	l , Min	R
16	16.1+0.2	45	3
20	20.1+0.2	45	3
25	25.1+0.3	45	3
32	32.1+0.3	55	3
40	40.1+0.4	65	3
50	50.1+0.4	65	3
63	63.1+0.5	65	3

FIG. 8 GAUGE FOR CHECKING MAXIMUM INSIDE DIAMETER OF SOCKET-END

(ET 14)

Reprography Unit, BIS, New Delhi, India