

AMENDMENT NO. 1 JUNE 2024
TO
IS 3370 (PART 2) : 2021 CONCRETE STRUCTURES FOR RETAINING AQUEOUS LIQUIDS — CODE OF PRACTICE
PART 2 PLAIN AND REINFORCED CONCRETE
(Second Revision)

[Page 3, clause 4.4.1.2(b), line 1] — Substitute the following for the existing:

‘At the surface of member the maximum calculated transverse crack width’.

[Page 3, clause 4.4.1.2(b)] — Insert the following paragraph at the end:

‘The crack width at the surface of concrete shall be estimated even if reinforcement is provided in multiple layers. Where bars in a particular direction are provided in multiple layers (for example, longitudinal bars of beams), for calculating ‘ a_{cr} ’ the centre of gravity (1st moment of area) of total steel area (in multilayers) in the same direction, shall be considered. The value of ‘ C_{Min} ’ is the clear cover to the outer most layer of bars in particular direction being considered.

However, where bars are provided in layers in different directions (as in a two-way slab), crack width shall be estimated separately for bars in each of the two directions, by taking clear cover to outer most bar in the direction being considered. A specified clear cover is provided to the bars in outer most layer, and for next layer clear cover increases by bar size in outer most layer.’

(Page 5, clause 4.5.2) — Insert the following clause at the end:

‘4.6 Poisson’s ratio of concrete can be assumed to be 0.2 for analysis of members of container where required.’

(Page 7, clause 8.1.1, Table 5) — Substitute the following for the existing:

‘Table 5 Minimum Percentage of Reinforcement

(Clause 8.1.1)

SI No.	Grade of Reinforcement	Elevated Tank with Length (see Note 1)			Ground Supported Tank with Length (see Note 1)		
		≤ 14 m	22 m	30 m	≤ 14 m	22 m	30 m
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
i)	Fe 250	0.40 Percent	0.50 Percent	0.65 Percent	0.40 Percent	0.63 Percent	0.80 Percent
ii)	Fe 415	0.24 Percent	0.30 Percent	0.39 Percent	0.24 Percent	0.38 Percent	0.48 Percent

NOTES

1 Length is the horizontal length of continuous reinforced concrete members in between full movement joints (if provided) or end of structure along the direction of the reinforcement whichever is small. For significantly long lengths (> 30 m) higher percent of steel may be required.

2 For intermediate lengths, minimum percentage of reinforcement required shall be linearly interpolated.

Price Group 1

(Page 9, Fig. 3) — Substitute the following for the existing:

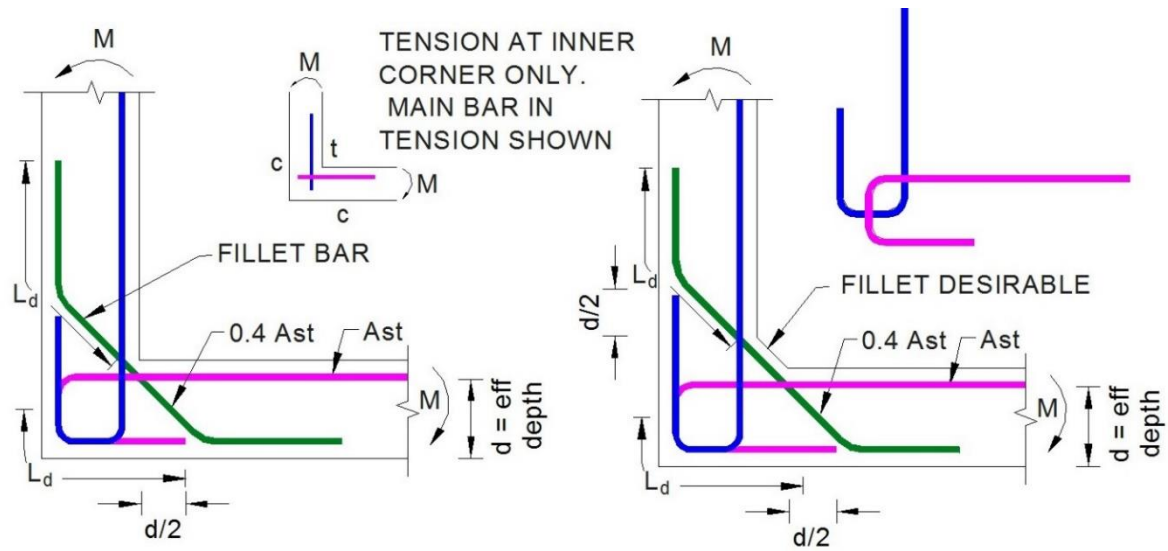


FIG. 3 DETAILING AT THE RIGHT ANGLED JUNCTION

(CED 02)

Publication, BIS, New Delhi