

AMENDMENT NO. 1 JUNE 2023

TO

**IS 17505 (PART 1) : 2021 SPECIFICATION FOR THERMOSETTING INSULATED FIRE SURVIVAL
CABLES FOR FIXED INSTALLATION HAVING LOW EMISSION OF SMOKE AND CORROSIVE
GASES WHEN AFFECTED BY FIRE FOR WORKING VOLTAGES UPTO AND INCLUDING
1100 V A.C AND 1500 V D.C**


PART 1 REQUIREMENTS FOR ARMOURED CABLES

[(Page 7, Table 1, Sl No. (vii)] — Volume resistivity — Substitute 'Min' in place of 'Max'.

[(Page 13, Table 9, Sl No. (iv) (m), col (3)] — Assessment of Halogen — Substitute 'Table 1 and 2' in place of 'Table 2'.

[Table 9, NOTE] — Delete.

[(Page 19, Fig. E-3)] — Substitute the following Fig. in place of existing:

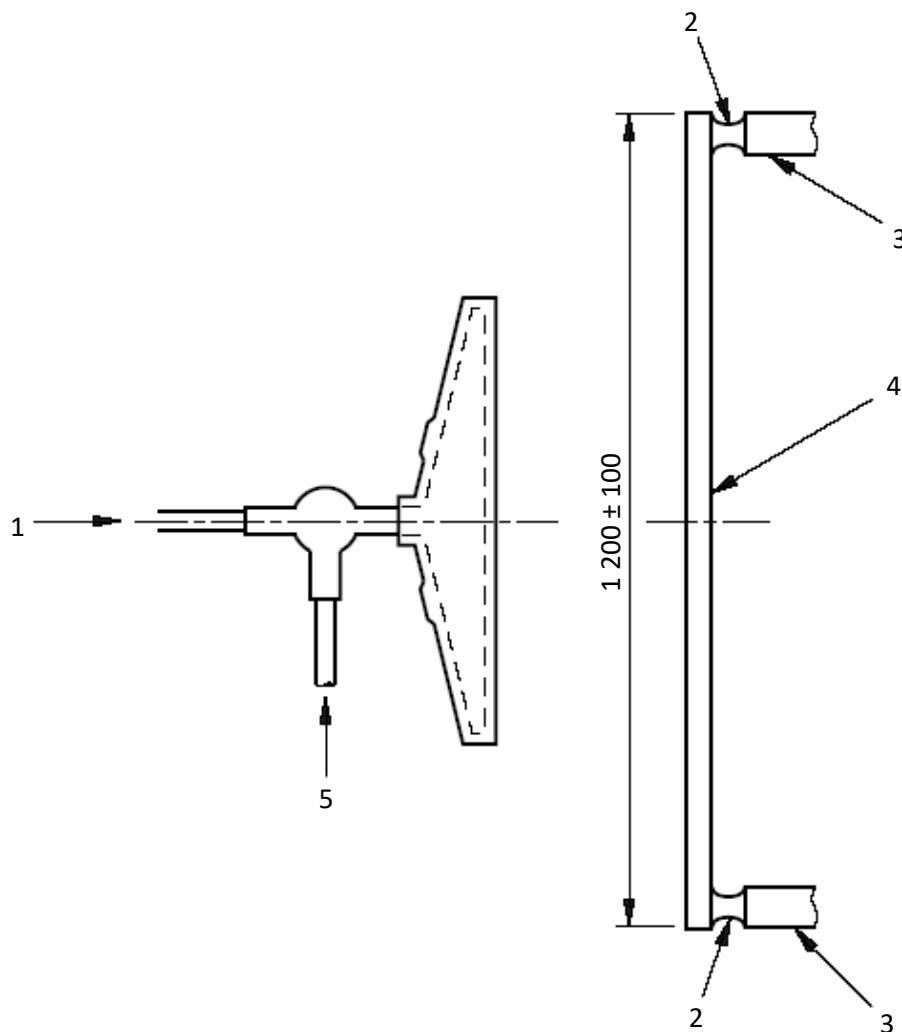

Key

1 entry for air

2 rubber bush

3 rigid support framework

4 horizontal steel test ladder

5 entry for propane gas