



ATLANTIC
PACIFIC
COMMUNITIES

PERMIT SET

COMMUNITY CENTER - FLOOR PLAN


Rev #	Revision Description	Date
1	Bldg Review Cmt	09/30/20
2	County Comments	11/20/20
3	County Comments	01/08/21
4	County Comments	03/22/21
5	County Comments/ Owner VE	04/03/23
7	Pre-con RFIs/Coord.	05/03/24
9	Coordin.	07/19/24
10	Coordin./Bulletin #6	09/20/24



THIS DRAWINGS IS THE PROPERTY OF CORWILL ARCHITECTS INC.
UNLESS OTHERWISE PROVIDED FOR BY CONTRACT, THE
CONTENTS OF THIS DRAWINGS ARE CONFIDENTIAL AND
SHALL NOT BE TRANSMITTED TO ANY OTHER PARTY
EXCEPT AS AGREED TO BY THE ARCHITECT/ENGINEERS.

DATE: 5-18-2020
JOB No.: 2019-20
DRAWN BY: MA, CM, JM, JW, FG
APPR BY: AMC
PRINTED: 11/13/2024

A-2.08

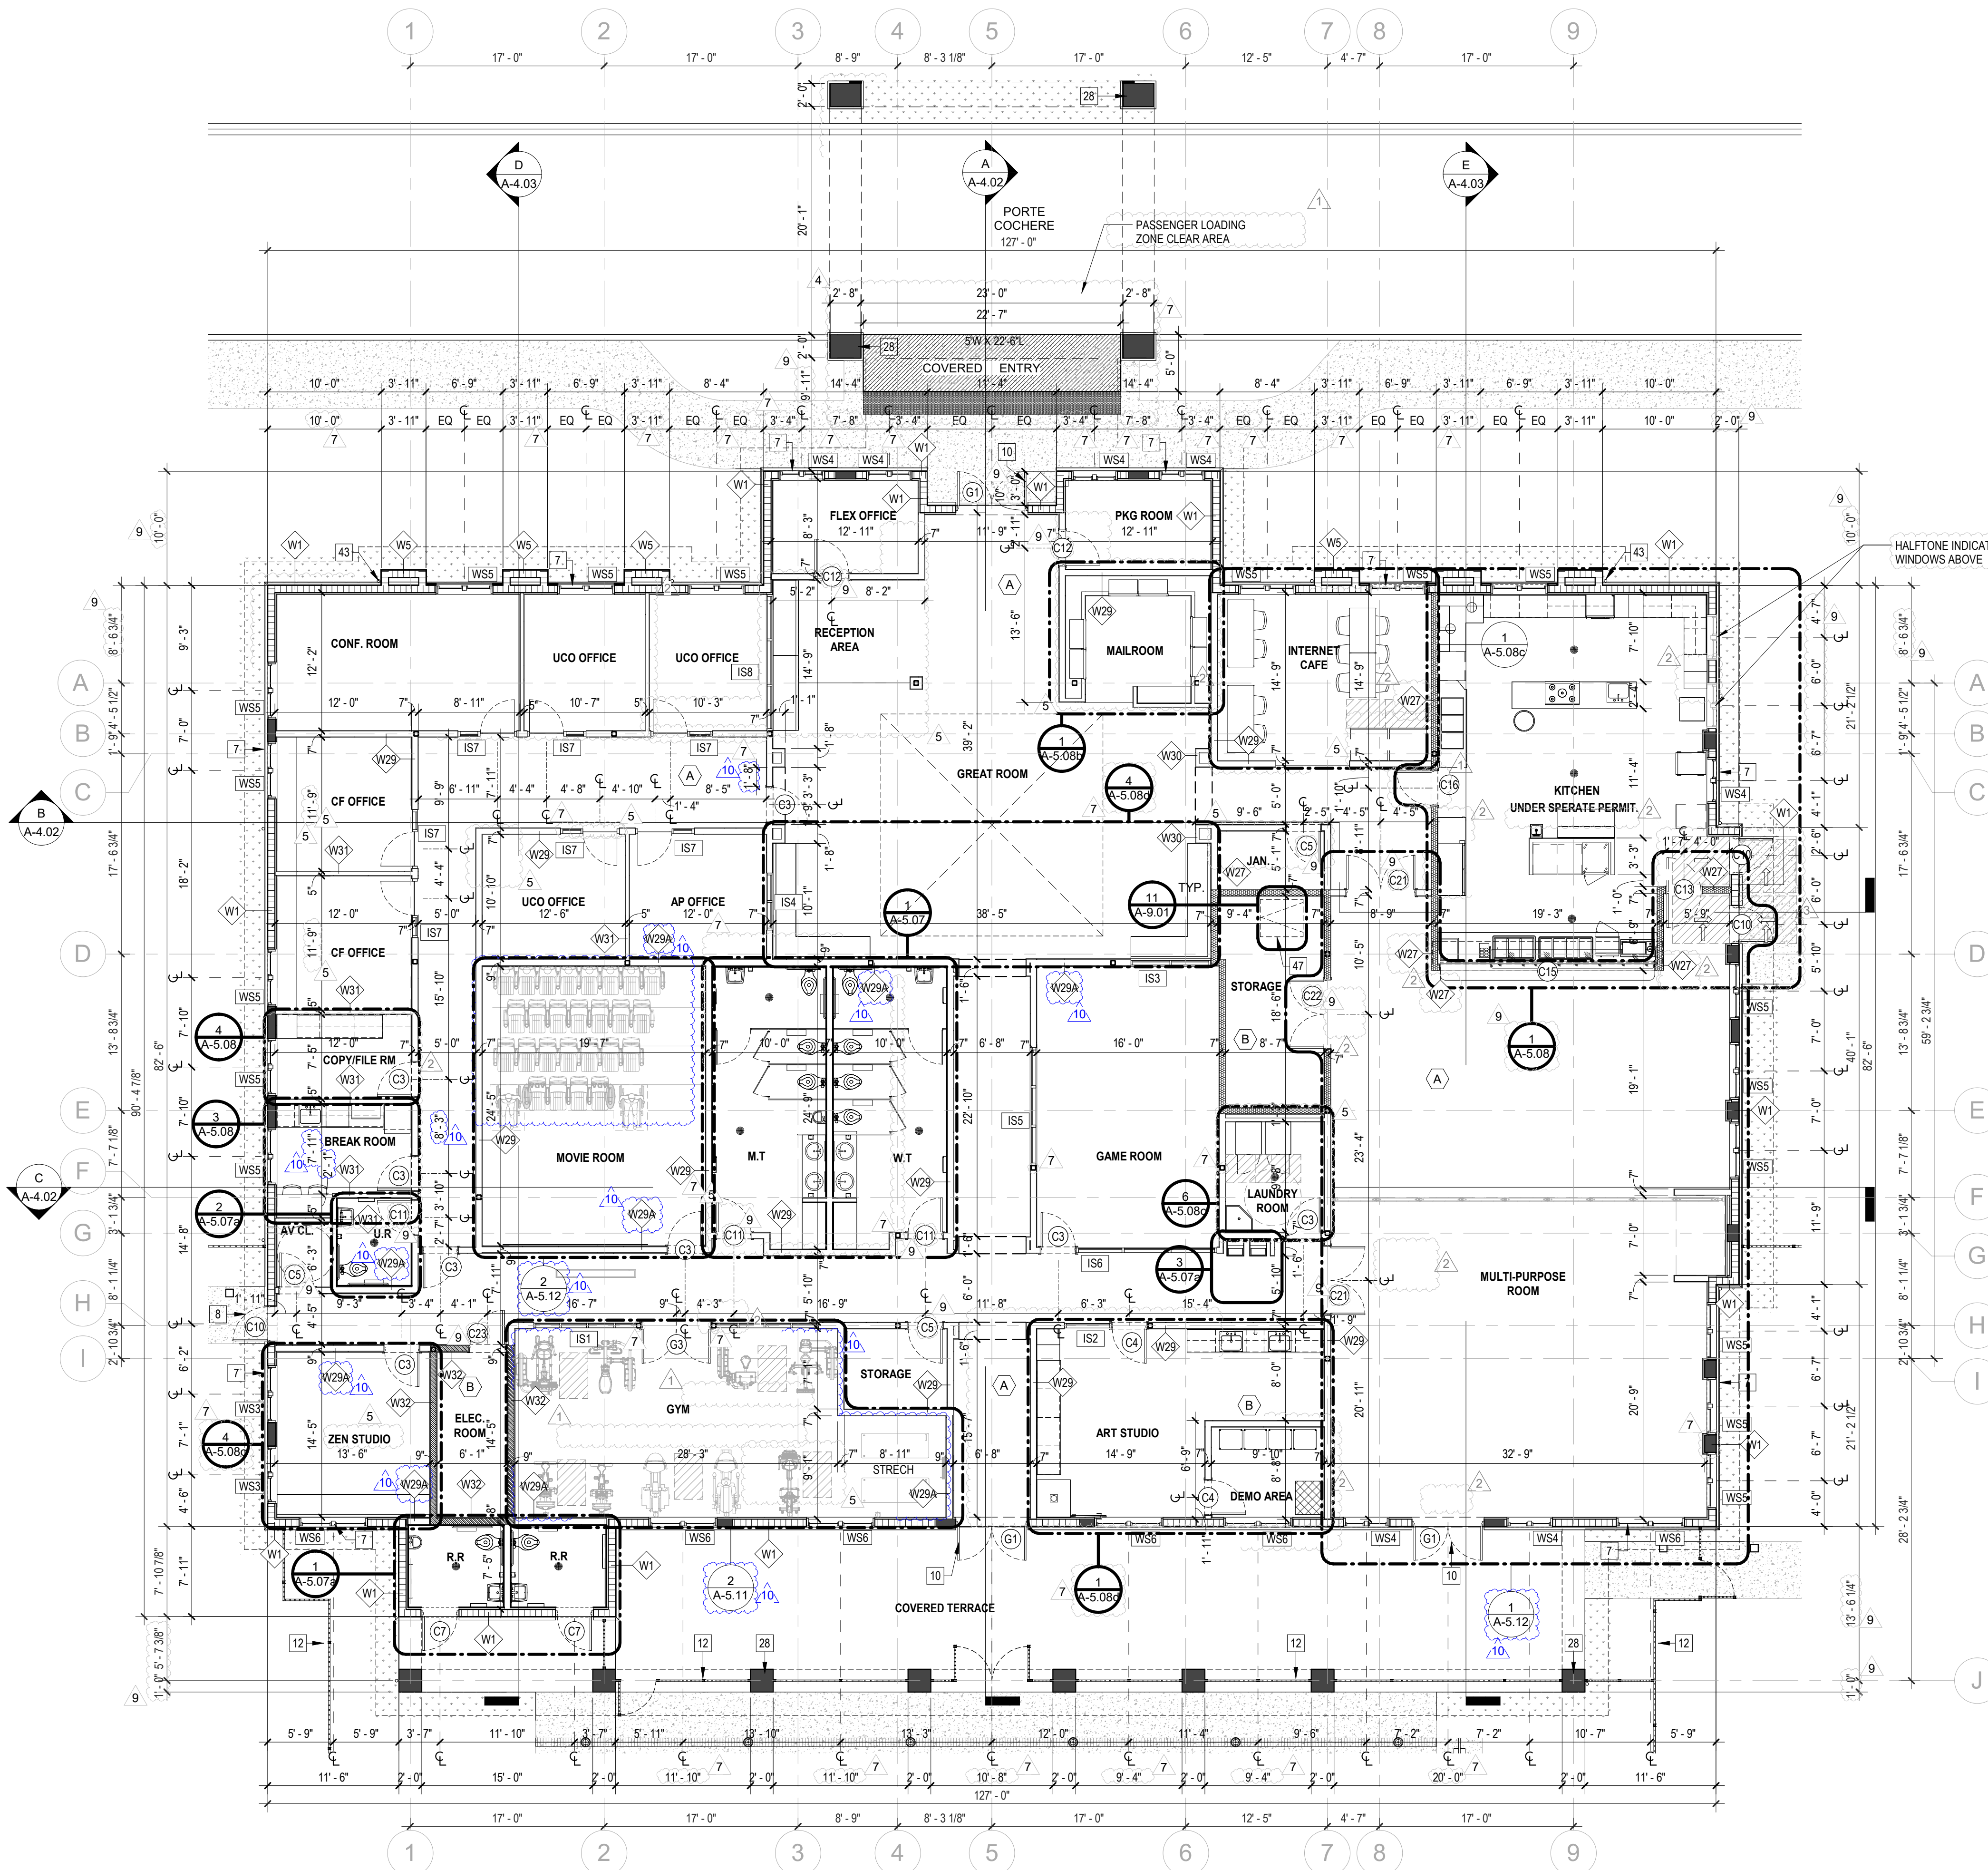

COMMUNITY CENTER - FLOOR PLAN

SCALE: 1/8" = 1'-0"

WALL & SYMBOL LEGEND



- | | | | |
|---|--|---|---|
|  | REIN. CMU WALL W/O FURRING |  | WINDOW TYPE. REFER TO WINDOW SCHEDULE |
|  | REIN. CMU WALL W/O FURRING (2 HOUR RATED) |  | DOOR NUMBER. REFER TO DOOR SCHEDULE |
|  | REIN. CMU WALL W/O FURRING (3 HOUR RATED) |  | KEYNOTE NUMBER. REFER TO KEYNOTE LEGEND |
|  | REIN. SHEAR WALL (2 HOUR RATED) |  | STOREFRONT TYPE / LOUVER TYPE |
|  | 8" LOW WALL @ 42" MIN. |  | CENTER LINE |
|  | TYP. METAL STUD PARTITION WALL |  | WALL TYPE. SEE SHEET A-8.1 |
|  | TYP. 1 HOUR TENANT SEPARATION/SMOKE BARRIER METAL STUD PARTITION WALL - REFER TO OVERALL FLOOR PLAN FOR WALL |  | PAVEMENT STRIPED ZONE - NO PARKING, NO DRIVING & NO STANDING AREA |
|  | 2 HOUR UL RATED SHAFT WALL |  | DENOTES QUANTITY |
|  | DENOTES AREA OF GYPSUM WALLBOARD DROP DOWN CEILING OR GWB SOFFIT AREA 7'-6" MIN. (UNLESS OTHERWISE NOTED) |  | DENOTES 1/2" MAX. F.F. THRESHOLD |

WATERPROOFING LEGEND

- | | |
|-----|---|
| (A) | STEGO WRAP 15-MIL VAPOR BARRIER BELOW SLAB |
| (B) | POLYIMIDE HS EPOXY COATING (WALLS) AND EUCLID CHEMICAL EUCOPOXY TUFF COAT ON FLOORS |
| (C) | EUCLID TAMOSEAL CEMENTITIOUS WATERPROOFING |
| (D) | PROVIDED PROTECTIVE COATING (VULKEM 350/351 OVER MSPR PRIMER SANDED TO REDUCE SKID. SYSTEM TRANSITION 6" UP PERIMETER WALLS) PROVIDE TREMCO'S DYMONIC 100 CANT BEAD AT ALL SUBSTRATE TRANSITIONS. |
| (E) | TREMCO VULKEM 350/351 COATING, SANDED TO REJECTION. TERMINATE 6" UP PERIMETER WALLS. |
| (F) | TREMCO AMPHIBIA MEMBRANE WATERPROOFING ENCAPSULATING ELEVATOR PIT |
| (G) | TREMCO TREMPLY SINGLE PLY ROOFING MEMBRANE OVER LIGHT WEIGHT CONCRETE 60 MILS MIN. |
| (H) | XYPEX CRYSTALLINE CEMENTITIOUS WATERPROOFING |
| (I) | MASTERPROTECH H1000 BASF CLEAR SEALER |

GYM NOTE

PER FBC ACCESSIBILITY 1004.1, EXERCISE MACHINES AND EQUIPMENT SHALL HAVE A CLEAR FLOOR SPACE OF 30" X 48" POSITIONED FOR TRANSFER OR FOR USE BY AN INDIVIDUAL SEATED IN A WHEELCHAIR.

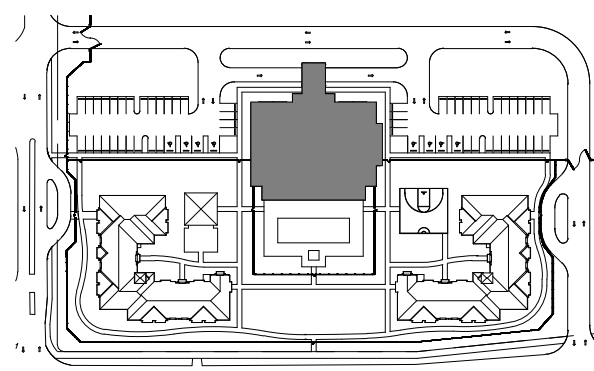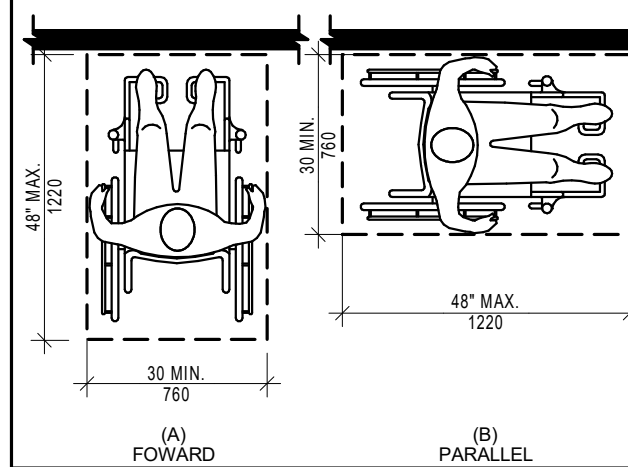

COMMUNITY CENTER KEY PLAN

N.T.S.

LEGEND

- | | | |
|-----|--|---|
| 1. | CMU WALL WITH 5/8" MIN. EXT. STUCCO FINISH ON ALL EXPOSED SIDES. | |
| 2. | CONCRETE SIDEWALK | |
| 3. | SLAB ON GRADE W/ 15 MIL VAPOR BARRIER SYSTEM. | |
| 4. | BALCONY/ TERRACE CONCRETE SLAB PROPERLY SLOPED TO EXTERIOR. PROVIDE WATERPROOFING AT ALL ELEVATED BALCONIES/ TERRACES AND CONCRETE SLABS OR AS OTHERWISE INDICATED BY DRAWINGS. EXTEND VERTICALLY A MIN. 6" AT ALL ADJACENT WALLS. REFER TO DETAILS A-9.01 (REFER TO STRUCT. DWGS FOR DETAILS) | |
| 5. | PARAPET WALL (42" A.F.F. MIN. TAKEN FROM INTERIOR SLAB) | 1 |
| 6. | CAT II IMPACT RESISTANT STOREFRONT SYSTEM. REFER TO SHEETS A-10.00 TO A-10.00B FOR ELEVATIONS AND DETAILS. | |
| 7. | CAT II IMPACT RESISTANT ALUM. / GLASS ROLLER/ SINGLE HUNG/ FIXED WINDOW. REFER TO SHEET A-10.00- A-10.00B FOR ELEVATIONS & DETAILS | |
| 8. | IMPACT RESISTANT METAL DOOR. REFER TO DOOR SCHEDULE ON SHEET A-9.00. | |
| 9. | SWING DOOR SYSTEM W/ DARK BRONZE COATED ALUMINUM FRAME. SUBMIT SHOP DRAWINGS FOR REVIEW AND APPROVAL. | |
| 10. | SWING DOOR SYSTEM W/ DARK BRONZE COATED ALUMINUM FRAME & IMPACT RESISTANT GRAY TINTED GLASS (TYP.) SUBMIT SHOP DRAWINGS FOR REVIEW AND APPROVAL. | 1 |
| 11. | 42" HIGH DARK BRONZE COATED ALUMINUM PICKET RAILING. PICKETS SHALL REJECT MAX. 4" DIA. OBJECTS AND REJECT 2" DIA. OBJECTS AT BOTTOM (TYP.) REFER TO SHEET A-9.01 DTL #4 & #7 FOR MORE INFO. | |
| 12. | ALUMINUM GATE. | |
| 13. | R-30 INSULATION IN TRUSSES ABOVE CONDITIONED SPACES CEILING. | |
| 14. | WALL MOUNTED BACK FLOW. REFER TO CIVIL DWGS. | |
| 15. | CONTINUOUS ALUMINUM GUTTER TYPICAL THROUGHOUT PERIMETER OF GABLE ROOF PROVIDE DOWNSPOUTS. | |
| 16. | UNIT INTAKE / EXHAUST VENT. REFER TO MECHANICAL DWGS. | |
| 17. | MECHANICAL LOUVER. REFER TO MECHANICAL DWGS. & ARCHITECTURAL SHEET A-10.00 FOR SIZES. | |
| 18. | DECORATIVE ALUMINUM SCREEN - COPPER COLOR. | |
| 19. | PAINTED SMOOTH PRECAST MOLDING. COLOR TO BE GRAY MATTERS SW 7066 FROM SHERWIN WILLIAMS OR APPROVED EQUAL. | 2 |
| 20. | ROOF TILE OVER UNDERLAYMENT FASTENED TO PLYWOOD SHEATHING, SECURELY ATTACHED TO PRE-ENGINEERED FIRE RETARDANT WOOD TRUSS SYSTEM. | |
| 21. | TYP. 12" WIDE X 2" DEPTH DECORATIVE CONTINUOUS PRE-CAST TRIM. COLOR TO BE GRAY MATTERS SW 7066 FROM SHERWIN WILLIAMS OR APPROVED EQUAL. | |
| 22. | ROOF PARAPET. REFER TO ARCHITECTURAL & STRUCT. DWG FOR DTLS. | |
| 23. | WALL MOUNTED, EXTERIOR GRADE LIGHT FIXTURE, TO BE SELECTED BY OWNER, REFER TO ELECTRICAL DWGS. | |
| 24. | CONC. PAVERS. REFER TO HARDSCAPE PLAN ON LANDSCAPE DWGS. | |
| 25. | STRUCTURAL CONCRETE BEAM. REFER TO STRUCTURAL DWG. FOR DTLS. | |
| 26. | STRUCTURAL SLAB. REFER TO STRUCTURAL DRAWINGS. PROVIDE STUCCO FINISH & PAINT AT ALL EXPOSED UNDERSIDE OF SLABS. | |
| 27. | STRUCTURAL WALL (SHEARWALL). REFER TO STRUCT. DWG. FOR DTLS. | |
| 28. | STRUCTURAL COLUMN. REFER TO STRUCTURAL DWG. FOR DTLS. <u>PROVIDE LIGHT TEXTURE CEMENT PLASTER FINISH (TYP. THROUGHOUT UNLESS OTHERWISE NOTED).</u> | |
| 29. | STRUCTURAL STEEL COLUMN WITH FIRE RATED INTUMESCENT PAINT. REFER TO STRUCT. DRAWINGS. | |
| 30. | RETAINING WALL- REFER TO STRUCTURAL DWG. FOR DTLS. | |
| 31. | TRASH CHUTE. | |
| 32. | INTERIOR STOREFRONT SYSTEM. REFER TO SHEETS A-10.00 & A-10.00B FOR ELEVATIONS AND DETAILS. | |
| 33. | MECHANICAL EQUIPMENT. REFER TO MEP DRAWINGS FOR DTLS. | |
| 34. | CONDENSING UNIT (TYP.) REFER TO MECHANICAL PLANS FOR DETAILS (KYNAR 500 FINISH OR EQUAL) | |
| 35. | TRENCH DRAIN (TYP.) REFER TO PLUMBING DRAWINGS. | |
| 36. | FLOOR DRAIN (TYP.) <u>SLOPE 1/4" MAX. PER 12" MIN. TYP. 1/10.</u> | |
| 37. | ROOF DRAIN (TYP.) | |
| 38. | EMERGENCY OVERFLOW FLOOR DRAIN (TYP.) | |
| 39. | SINGLE PLY MEMBRANE ROOFING OVER LIGHTWEIGHT INSULATING CONCRETE SLOPED TO DRAINS. | |
| 40. | LANDSCAPING. REFER TO LANDSCAPE DWGS. | |
| 41. | DRAFTSTOP (EXTEND TO UNDERSIDE OF SHEATHING) WITH BABCOCK DAVIS SELF CLOSING AND SELF LATCHING ACCESS PANEL. PROVIDE ACCESS FROM BOTH SIDES. SEE SHEET A-9.00b DTL 3 & SHEET A-9.01 DTL 10 FOR MORE INFORMATION. | |
| 42. | OHAGIN LOW PROFILE MODEL FLAT ROOF VENTS - (98.75 SQ. IN. NFVA INSTALL AS PER MANUFACTURER RECOMMENDATIONS. FLASHING & WATERPROOF AS REQUIRED. PROVIDE SHOP DWGS. AND NOA. | 2 |
| 43. | ALUMINUM DOWNSPOUT PAINTED SAME COLOR AS BACKGROUND WALL- REFER TO PLUMBING P-100. DWGS FOR DETAILS. | |
| 44. | PRE-ENGINEERED FIRE-RETARDANT TREATED WOOD TRUSS @ 24" O.C. MAX. TYP. REFER TO STRUCTURAL DRAWINGS. | |
| 45. | PROVIDE BATT INSULATION (R-30 VALUE) IN TRUSSES ABOVE CEILING (TYP. ALL AREAS ABOVE CONDITIONED SPACES. | |
| 46. | BABCOCK DAVIS COASTAL ZONE IMPACT RESISTANT HATCH & BABCOCK DAVIS FIRE RATED ACCESS PANEL WITH SELF CLOSING & SELF LATCHING. COORDINATE ROOF TRUSS LAYOUT WITH DOOR LOCATION & SUBMIT SHOP DRAWINGS PRIOR TO INSTALLATION FOR APPROVAL. SHEET SHEET A-9.01 DTL 9 & 10 FOR MORE INFORMATION | |
| 47. | BABCOCK DAVIS ROOF HATCH & BABCOCK DAVIS NON RATED ACCESS PANEL WITH SELF CLOSING & SELF LATCHING. SUBMIT SHOP DRAWINGS PRIOR TO INSTALLATION FOR APPROVAL. SHEET SHEET A-9.00 DTL 11 & SHEET A-9.01 DTL 11 FOR MORE INFORMATION. | 3 |
| 48. | FIRE RATED DEMISING WALL FROM GROUND ALL THE WAY UP TO ROOF SHEATHING. PROVIDE BABCOCK DAVIS FIRE RATED ACCESS PANEL AT DEMISING WALL OR APPROVED EQUAL. REFER TO SHEET A-9.01 DTL 10. | |
| 49. | HUFCOR FOLDING PARTITION. SUBMIT SHOP DRAWINGS FOR APPROVAL PRIOR TO INSTALLATION. | |

A-2.08