




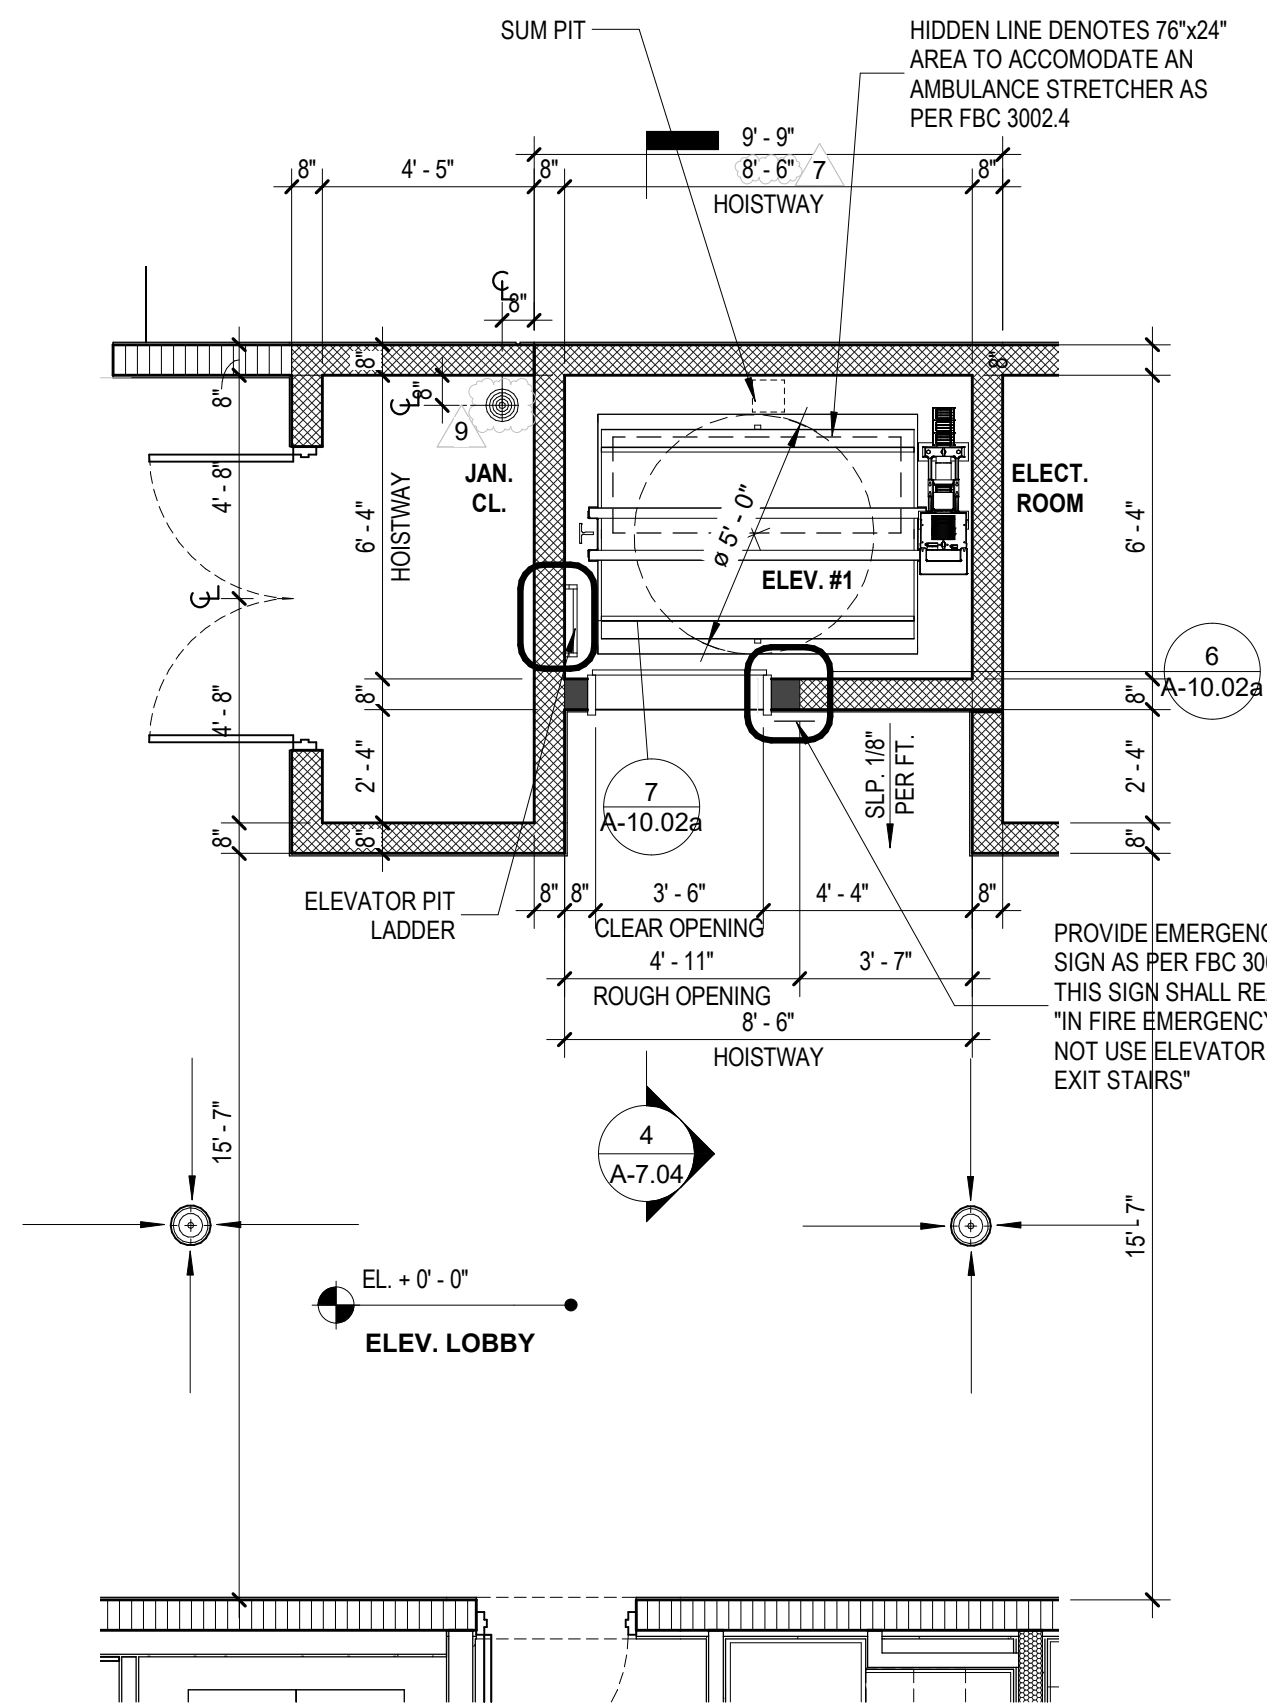


1 BLDG A - ELEV. @ GROUND FLOOR
SCALE: 1/4" = 1'-0"

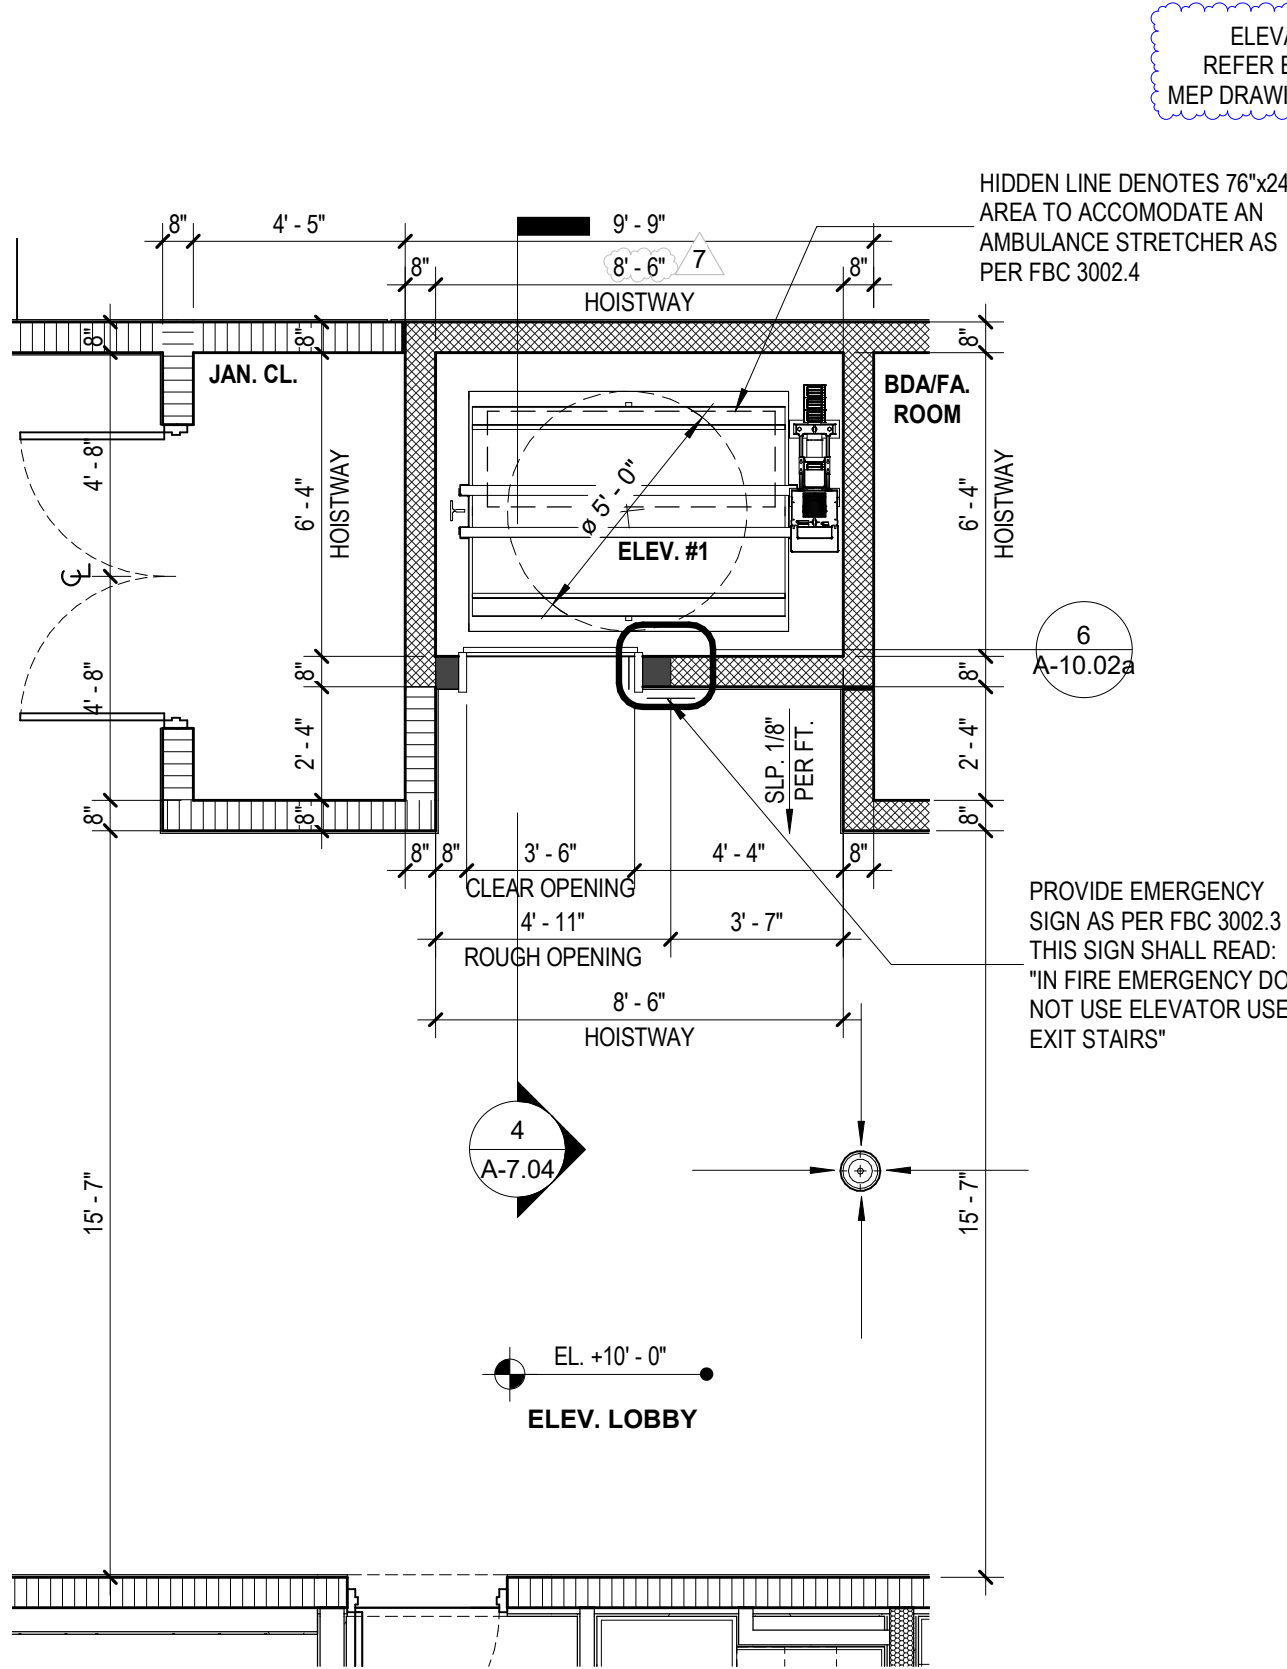


2 BLDG A - ELEV. - 2ND LEVEL
SCALE: 1/4" = 1'-0"

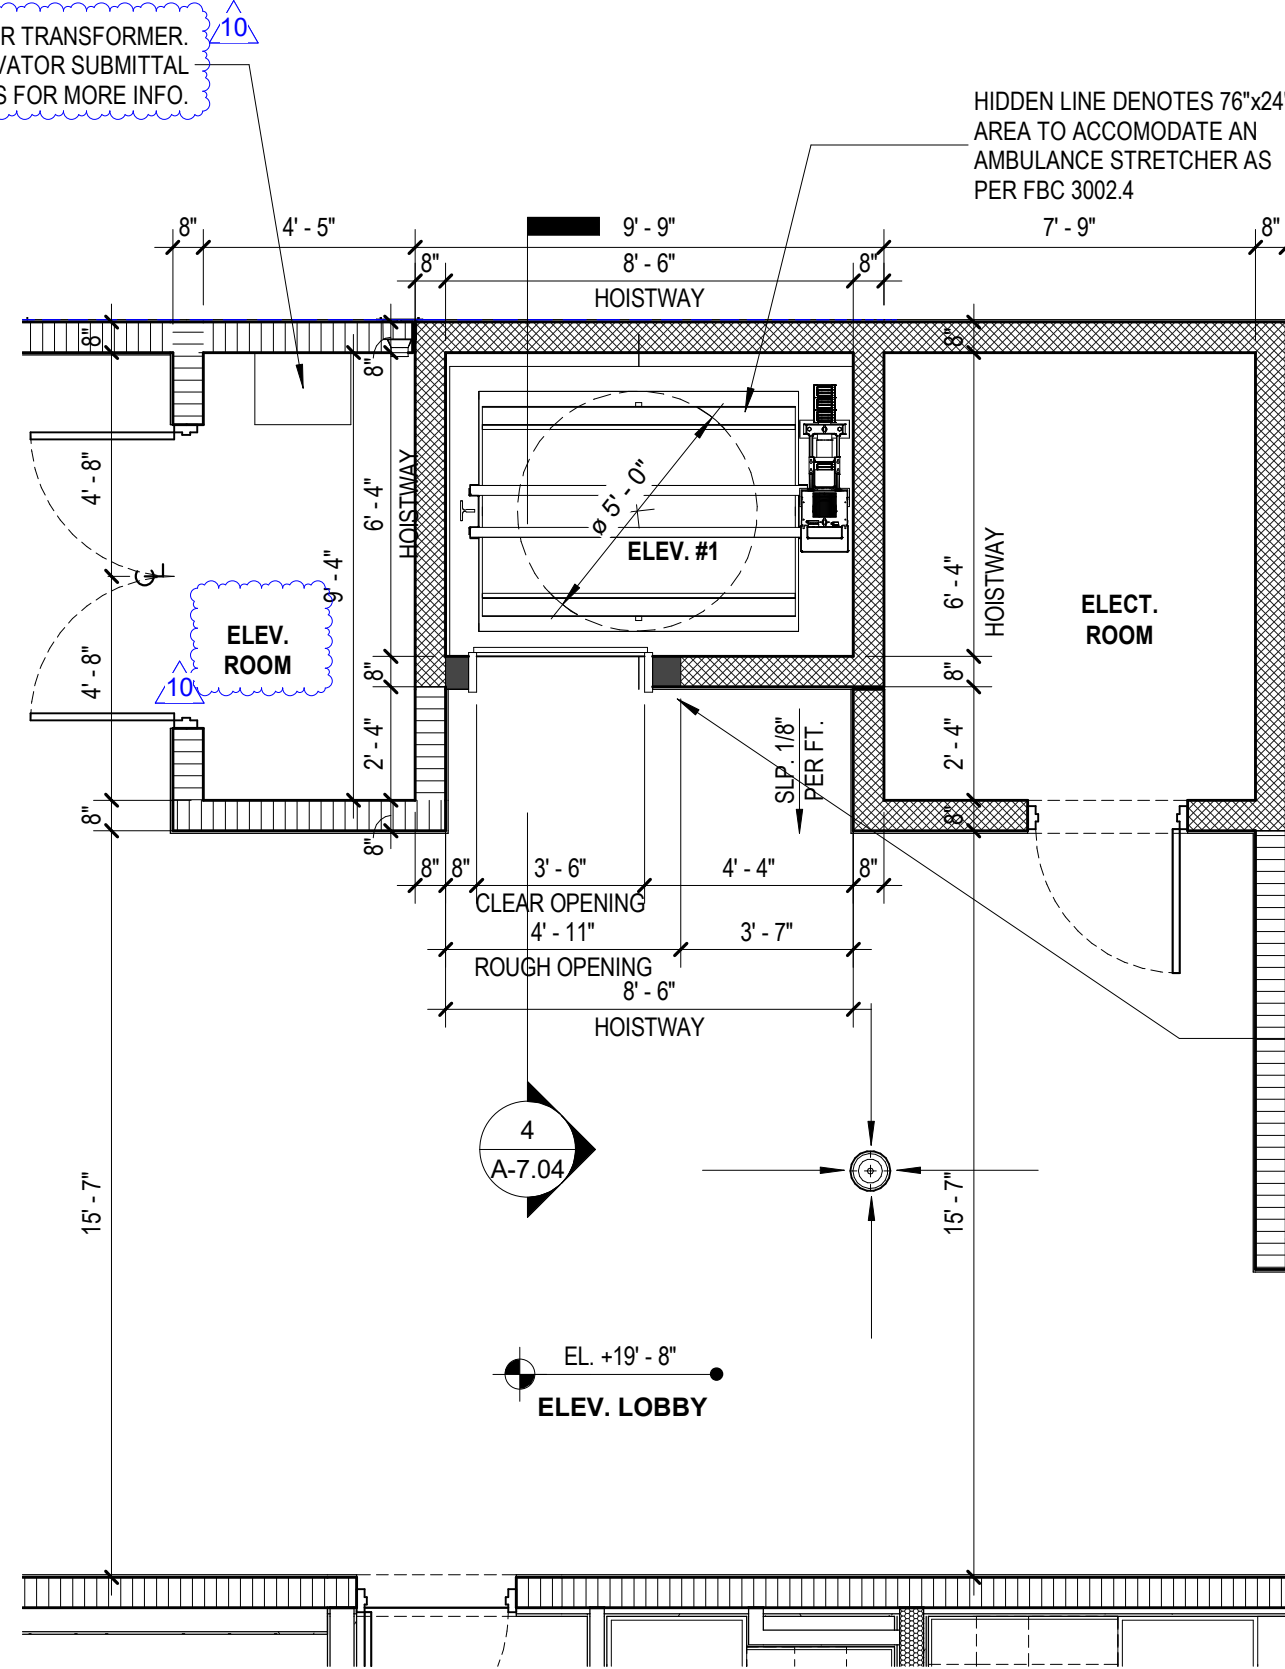


2A BLDG A - ELEV. - 3RD LEVEL
SCALE: 1/4" = 1'-0"

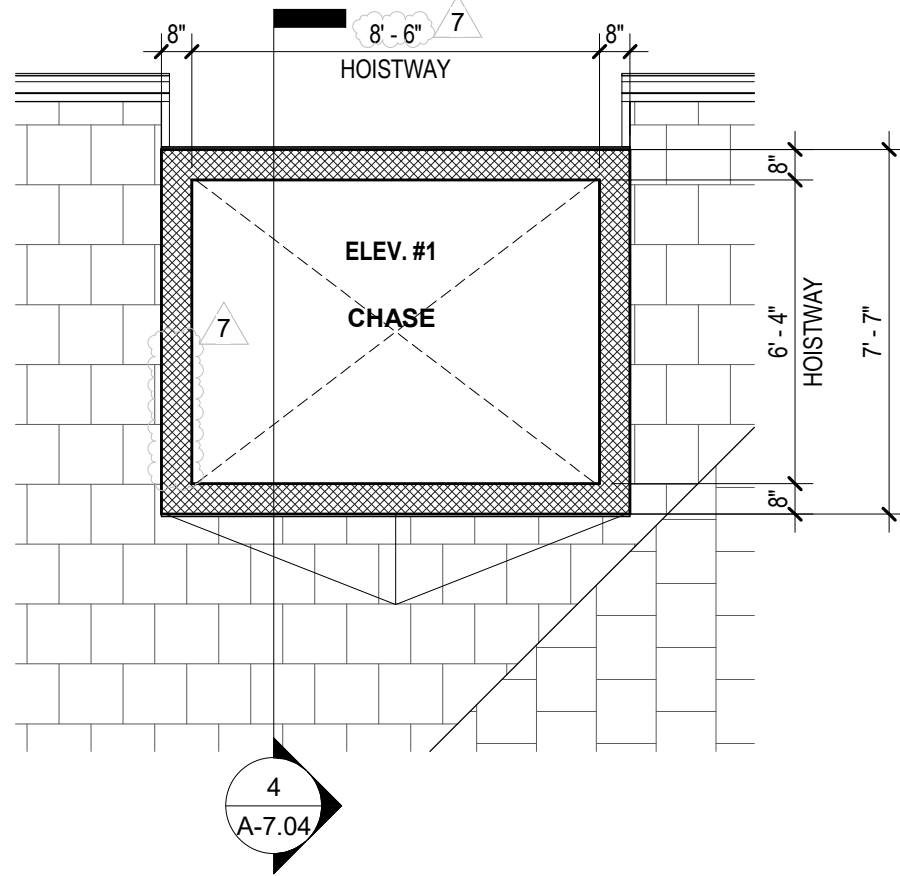

3 BLDG A - ELEV. @ ROOF
SCALE: 1/4" = 1'-0"

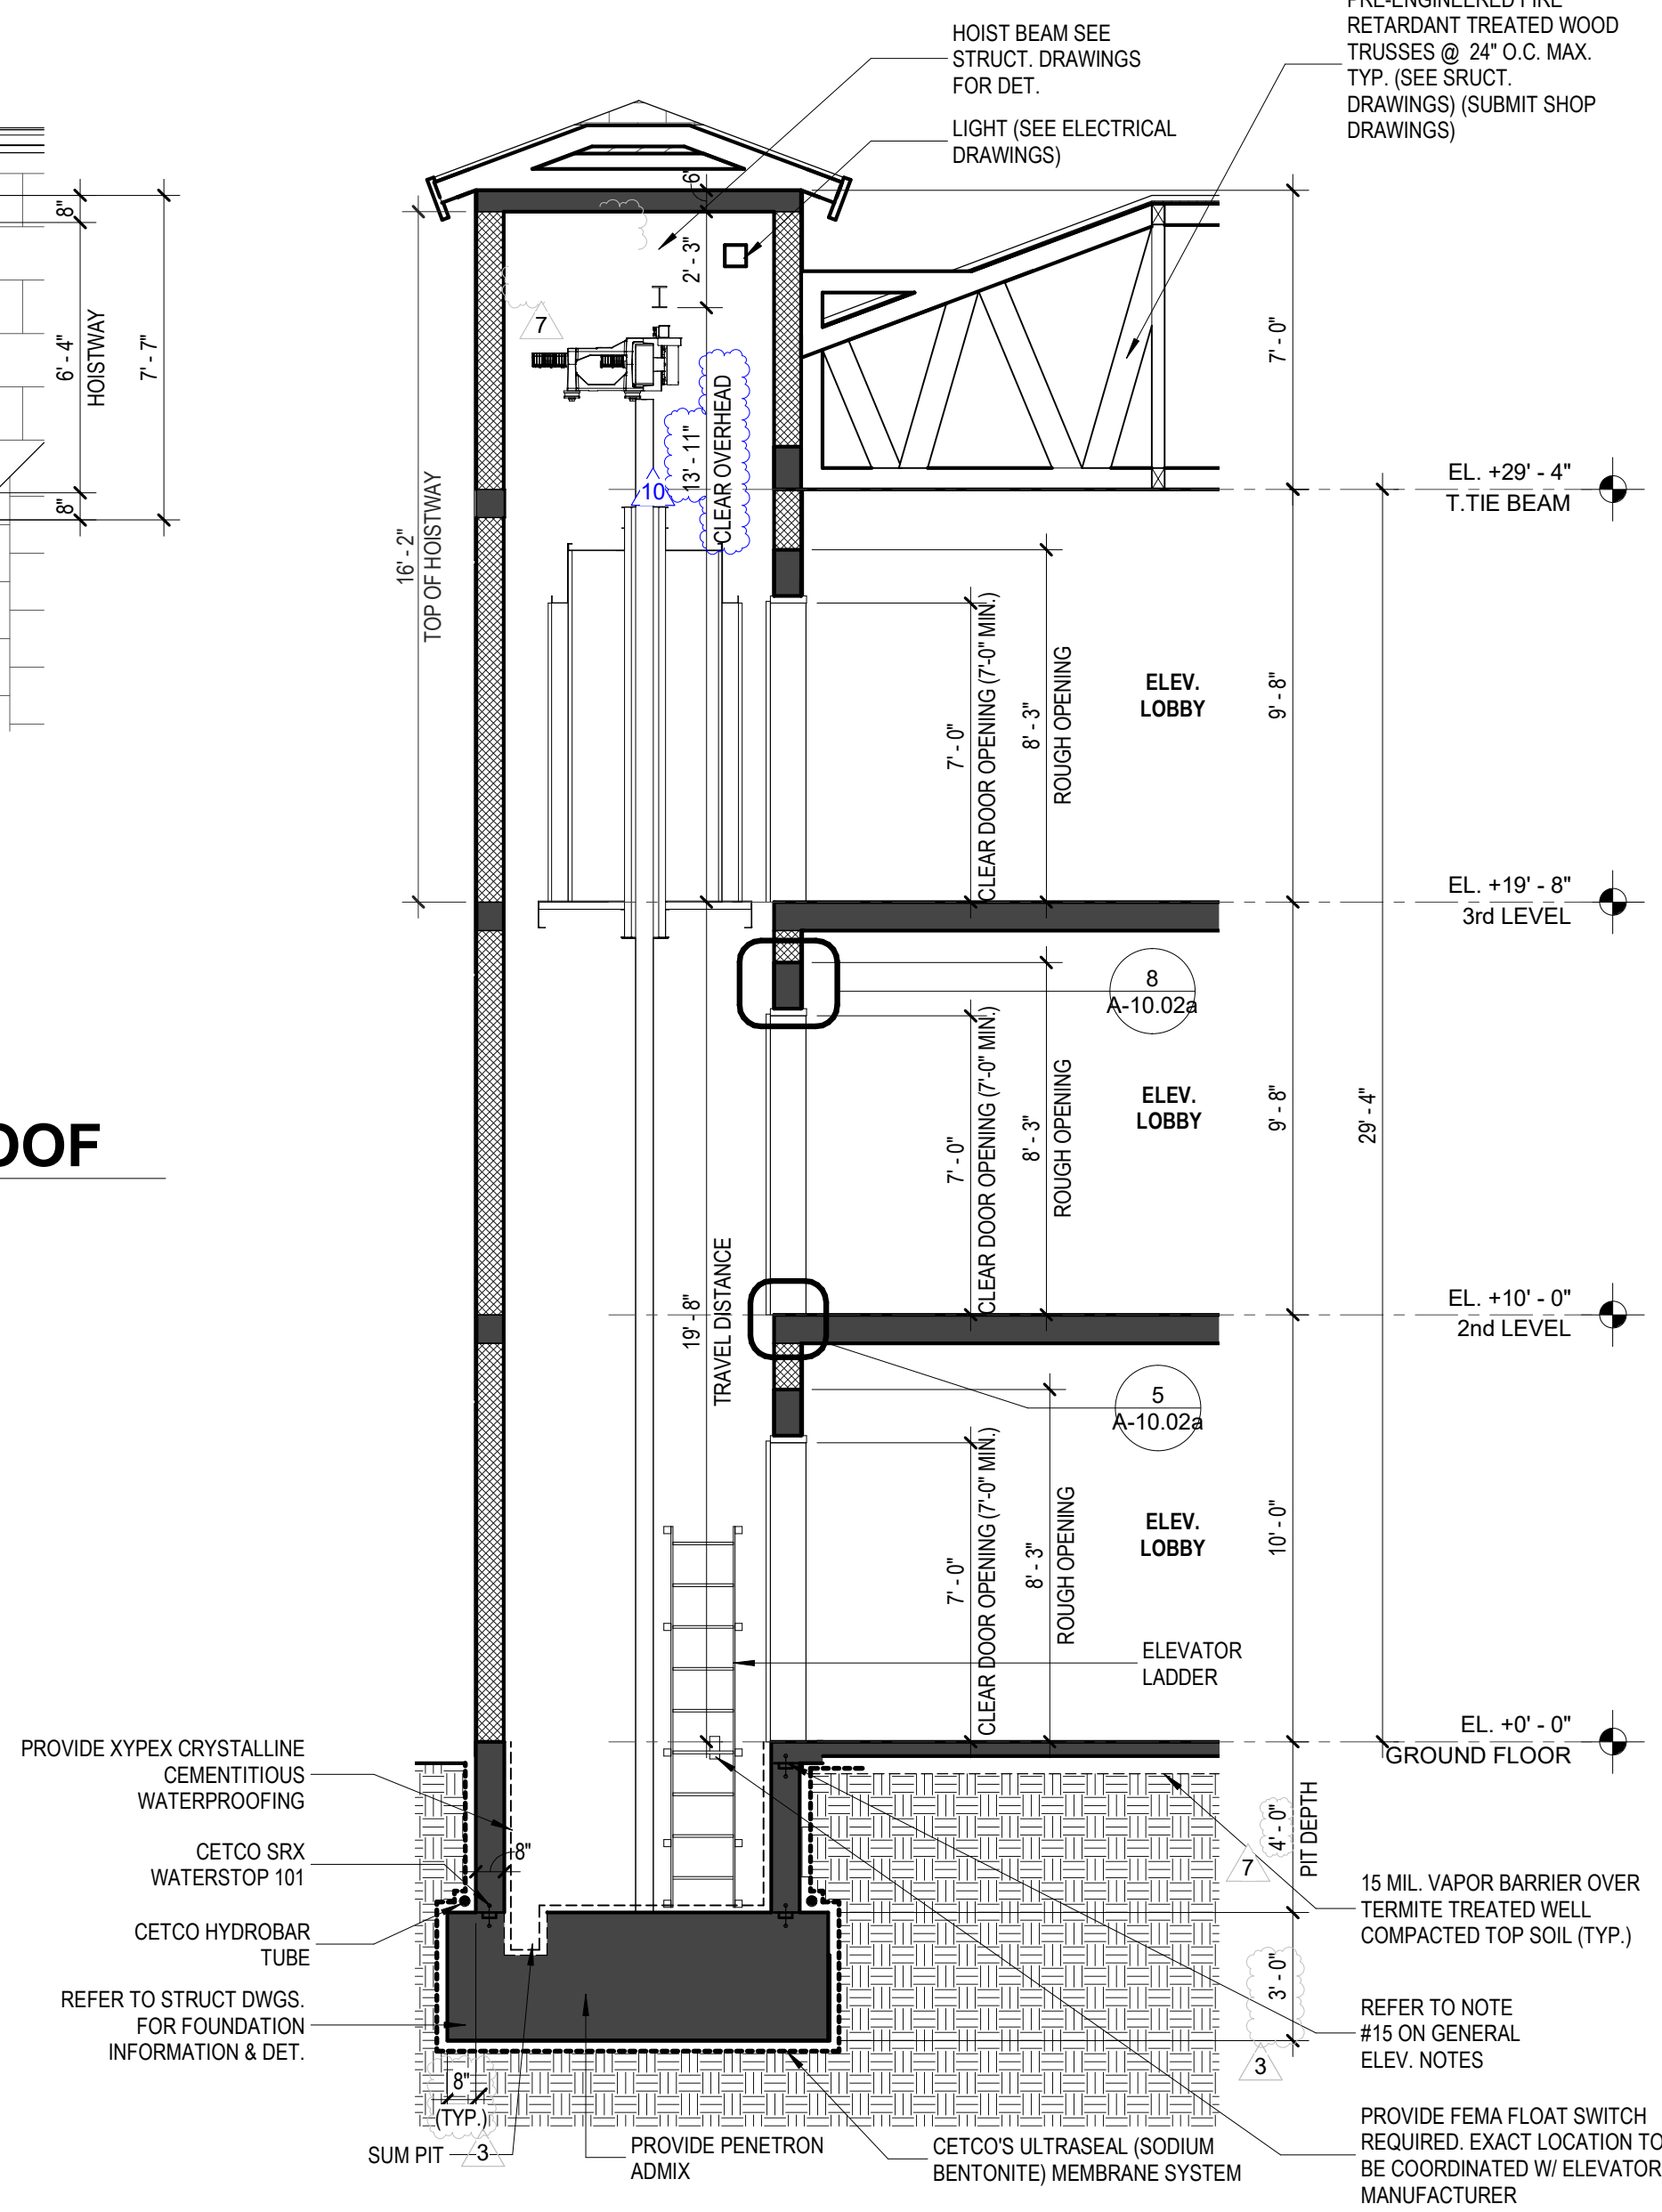

4 BLDG A ELEV. SECTION
SCALE: 1/4" = 1'-0"

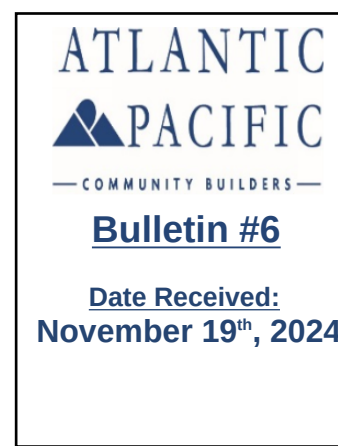

WALL & SYMBOL LEGEND

	REINF. CMU WALL W/O FURRING (2 HOUR RATED)		WINDOW TYPE. REFER TO WINDOW SCHEDULE
	REINF. CMU WALL W/O FURRING (3 HOUR RATED)		DOOR NUMBER. REFER TO DOOR SCHEDULE
	REINF. SHEAR WALL (2 HOUR RATED)		KEYNOTE NUMBER. REFER TO KEYNOTE LEGEND
	8" LOW WALL @ 42" MIN.		STOREFRONT TYPE / LOUVER TYPE
	TYP. METAL STUD PARTITION WALL		CENTER LINE
	TYP. 1 HOUR TENANT SEPARATION/SMOKE BARRIER METAL STUD PARTITION WALL - REFER TO OVERALL FLOOR PLAN FOR WALL		WALL TYPE. SEE SHEET
	2 HOUR UL RATED SHAFT WALL		PAVEMENT STRIPED ZONE - NO PARKING, NO DRIVING NO STANDING AREA
	DENOTES AREA OF GYPSUM WALLBOARD DROP DOWN CEILING OR GWB SOFFIT AREA 7'-6" MIN. (UNLESS OTHERWISE NOTED)		DENOTES QUANTITY
			DENOTES 1/2" MAX. F.F. THRESHOLD

GENERAL ELEV. NOTES

- CLEAR AND PLUMB HOISTWAY, WITH VARIATIONS NOT TO EXCEED 1" AT ANY POINT. PIT CORNERS TO BE FREE OF DEBRIS. PIT FLOOR TO BE SMOOTH AND FREE OF BUMPS.
- HOISTWAY ENCLOSURE TO BE 2 HOUR FIRE RATED AS PER FBC 2017.
- 75° BEVEL GUARDS ON ALL PROJECTIONS, RECESSES, OR SETBACKS OVER 4" EXCEPT ON SIDE USED FOR LOADING/UNLOADING. (RULE 2.1.6)
- SELF-FLASHING GALVANIZED LOUVERS SHALL BE PROVIDED AT SHAFT WALL AT ROOF LEVEL TO PROVIDE MINIMUM REQUIRED VENTILATION AS PER FBC 2017 (MOST CURRENT EDITION).
- ADEQUATE SUPPORT FOR RAIL BRACKETS AT EACH FLOOR, IN OVERHEAD, AND/OR INTERMEDIATE LOCATIONS (INCLUDING DIVIDER BEAMS FOR MULTIPLE ELEVATORS IN A COMMON HOISTWAY). REFER TO ELEVATOR MANUFACTURER FOR ALL REQUIREMENTS FOR SUPPORT AND INSTALLATION.
- CONTRACTOR SHALL COORDINATE BLOCKOUT/CUTOUT THRU WALL AS REQUIRED TO ACCOMMODATE HALL BUTTON BOXES, SIGNAL FIXTURES, HATCH DUCT, ETC...
- SEAL AROUND OPENING TO MAINTAIN FIRE RESISTANT RATING AT WALL.
- CONVENIENCE OUTLET AND LIGHT FIXTURE IN PIT - MINIMUM LIGHTING 100 LUX (10 FC) (RULE 2.2.5), GFI TYPE PER N.E.C. 620-65.
- PROVIDE PIT LADDER FOR EACH ELEVATOR.
- ACCESS TO THE MACHINE ROOM AND MACHINERY SPACE, INCLUDING CONTROL ROOM AND CONTROL SPACE. MINIMUM DOOR SIZE 36" X 80".
- LIGHTING, VENTILATION, & HEATING OF CONTROL SPACE & MACHINERY SPACE. CONTROL SPACE TEMPERATURE TO BE MAINTAINED BETWEEN 55°F AND 90°F. OVERHEAD MACHINERY SPACE TEMPERATURE AT TOP OF HOISTWAY TO BE MAINTAINED BELOW 122°F WHEN MACHINE IS IN OVERHEAD.
- PROVIDE TELEPHONE OUTLET FOR EACH ELEVATOR ON CONTROL PANEL AND CONTROL ROOM.
- PROVIDE CLASS "ABC" FIRE EXTINGUISHERS IN ELECTRICAL MACHINERY AND CONTROL SPACES. EXTINGUISHERS SHALL BE LOCATED CONVENIENTLY TO THE ACCESS DOOR.
- PROVIDE SUMP PIT LOCATED IN REAR CENTER OF PIT FLOOR, DRAINS AND SUMP PUMPS, WHERE PROVIDED, SHALL COMPLY WITH THE APPLICABLE PLUMBING CODE, AND THEY SHALL BE PROVIDED WITH A POSITIVE MEANS TO PREVENT WATER, GASES AND ODOORS FROM ENTERING THE HOISTWAY. SUMPS AND SUMP PUMPS IN PITS, WHERE PROVIDED, SHALL BE COVERED. THE COVER SHALL BE SECURED AND LEVEL WITH THE PIT FLOOR. (RULES 2.2.2.4 & 2.2.2.6)
- PROVIDE ADEQUATE SEALING OF PIT WITH WATERPROOF SEALANT. EFFECTIVE PREVENTION OF PIT EXPOSURE TO STORM WATER OR GROUND WATER SHALL BE PROVIDED.
- CONTRACTOR SHALL COORDINATE WITH ARCHITECT/OWNER LOCATION OF SERVICE ELEVATOR AND PROVIDE ALL NECESSARY PADDING, FLOOR SHIELD, CONNECTIONS, ETC. ADDITIONAL HEIGHT OF SERVICE ELEVATOR SHALL BE COORDINATED WITH MANUFACTURER'S GUIDELINE. ALL ITEMS SHALL BE INSTALLED AS PER MANUFACTURER'S RECOMMENDATIONS.
- INTERIOR CAB FINISHES SHALL BE SELECTED BY ARCHITECT/OWNER. SHOP DRAWINGS TO BE PROVIDED SHOWING ALL ITEMS AND LOCATIONS. CONTROLS AND SIGNAGE SHALL BE AS REQUIRED BY ADA GUIDELINES.
- HOISTWAY DIMENSIONS SHALL BE VERIFIED WITH ELEVATOR MANUFACTURER PRIOR TO COMMENCING WORK UNDER THIS PERMIT. ALL REQUIREMENTS FOR ELEVATORS SHALL BE VERIFIED AND SHOP DRAWINGS SHALL BE PROVIDED TO ARCHITECT/ENGINEER FOR APPROVAL. ANY DISCREPANCIES SHALL BE NOTIFIED TO THE ARCHITECT PRIOR TO COMMENCING ANY WORK.
- CONTRACTOR TO COORDINATE SIZE AND LOCATION OF SLAB OPENINGS WITH ELEVATOR MANUFACTURER.
- MANUFACTURER TO CONSIDER AT LEAST 1100 LBS FOR INTERIOR FINISHES WEIGHT FOR THE ELEVATOR CAB.
- CONTRACTOR TO COORDINATE LOCATION AND PROVISIONS FOR OVERHEAD BEAMS, SUPPORT PLATES, AND BEARING PLATES AS PER MANUFACTURER RECOMMENDATIONS.
- ELEVATOR CONTROL ROOM: ALL EQUIPMENT, RELAYS, INVERTERS, ETC. SHOULD BE ISOLATED FROM THE STRUCTURE USING NEOPRENE ISOLATION EQUAL TO MASON INDUSTRIES TYPE BR HAVING 0.2 INCHES OF STATIC DEFLECTION.
- ELEVATOR CABS THAT DESCEND BELOW THE DESIGN FLOOD ELEVATION MUST BE EQUIPPED WITH CONTROLS THAT PREVENT THE CABS FROM DESCENDING INTO FLOODWATERS. ELEVATORS SHAFT MUST BE DESIGNED TO RESIST FLOOD LOADS (ASCE-2414 FLOOD RESISTANT DESIGN AND CONSTRUCTION).
- ELEVATOR CAR SHALL BE ABLE TO ACCOMMODATE AN AMBULANCE STRETCHER (FBC 3002.4).
- WHERE A REQUIRED ACCESSIBLE FLOOR IS 4 OR MORE STORIES ABOVE LEVEL OF EXIT DISCHARGE, THEN AT LEAST ONE REQUIRED ACCESSIBLE MEANS OF EGRESS SHALL BE AN ELEVATOR.

ELEVATOR SECURITY SYSTEM

- ELEVATOR CCTV: (1) RG59U COAX CABLE FOR VIDEO SIGNAL AND (1) 18 GAUGE 2 CONDUCTOR CABLE FOR CAMERA POWER.
- CARD READER: (1) 22 GAUGE 6 CONDUCTOR WIRE, SHIELDED.
- INTERCOM: (1) 18 GAUGE 2 CONDUCTOR WIRE.

ECOSPACE OR APPROVED EQ.

ELECTRIC TRACTION - GEARLESS - ELEVATOR CONTROL ROOM AT 3RD LEVEL FLOOR PLAN	
TYPE OF ELEVATOR:	PASSENGER (8'8" CABIN) 7
MACHINE LOCATION:	ELEVATOR ROOM AT 3RD LEVEL FLOOR PLAN 10
CONTROL LOCATION:	ELEVATOR ROOM AT 3RD LEVEL FLOOR PLAN 3
DOOR OPENING:	STANDARD NON CENTERED
CAPACITY:	2500 LBS.
RATED SPEED:	150 FPM
TRAVEL:	19'-8"
PIT DEPTH:	4'-0" MIN. 7
MIN. OVERHEAD:	15'-0" MIN.
POWER SUPPLY:	480V 3PH 60CYC 10, 7

CONTRACTOR SHALL VERIFY ALL ELEVATOR INFORMATION AND REQUIREMENTS PRIOR TO COMMENCING ANY WORK. SHOP DRAWINGS SHALL BE PROVIDED.

- ALL THE ELEVATOR ASSEMBLY MUST COMPLY WITH CURRENT ACCESSIBILITY CODES.
- WIRES OR CABLES THAT ARE LOCATED OUTSIDE OF THE ELEVATOR HOISTWAY AND MACHINE ROOM AND THAT PROVIDE NORMAL OR STANDBY POWER, CONTROL SIGNALS, COMMUNICATION WITH THE CAR, LIGHTING, HEATING, AIR CONDITIONING, VENTILATION AND FIRE-DETECTING SYSTEMS TO FIRE SERVICE ACCESS ELEVATORS SHALL BE PROTECTED BY CONSTRUCTION HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 2 HOURS. SHALL BE A CIRCUIT INTEGRITY CABLE HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 2 HOURS OR SHALL BE PROTECTED BY A LISTED ELECTRICAL PROTECTIVE SYSTEM HAVING A FIRE-RESISTANCE RATING OF NOT LESS THAN 2 HOURS.



CORWILARCHITECTS
4210 LAGUNA ST. CORAL GABLES FL 33146
LIC. NO. AA-C002151 T.305.448.7383

PROJECT:



**10951 SW 84th ST,
MIAMI-DADE, FLORIDA 33173**

OWNER:



**161 NW 6th ST, Ste. 1020
Miami, Florida 33136**

PHASE:


PERMIT SET

**BLDG A - ELEVATOR PLANS &
SECTIONS**

REVISIONS

Rev #	Revision Description	Date
3	County Comments	01/08/21
7	Pre-con RFIs/Coord.	05/03/24
8	Bulletin #4	05/29/24
9	Coordin.	07/19/24
10	Coordin./Bulletin #6	09/20/24

SEAL:

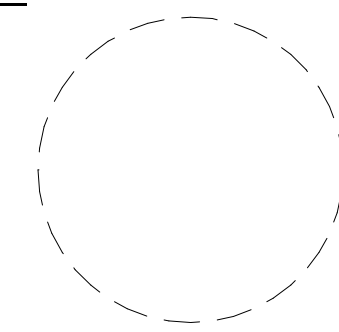

THIS DRAWINGS IS THE PROPERTY OF CORWIL ARCHITECTS INC.
UNLESS OTHERWISE PROVIDED FOR BY CONTRACT, THE
CONTENTS OF THIS DRAWINGS ARE CONFIDENTIAL AND
SHALL NOT BE TRANSMITTED TO ANY OTHER PARTY
EXCEPT AS AGREED TO BY THE ARCHITECT/ENGINEERS.

DATE: 5-18-2020
JOB No.: 2019-20
DRAWN BY:MA,CM,JM,JW,FG
APPR BY: AMC
PRINTED: 11/13/2024

A-7.04