

DOOR SCHEDULE - COMMON AREAS

DOOR No.	DOOR SIZE WIDTH	HEIGHT	THICKNESS	MAT.	TYPE	FRAME	THRESHOLD	HARDWARE SET NUMBER	FIRE RATING	REMARKS
C1	3' - 0"	8' - 0"	0' - 1 3/4"	18	A	20	16	2	90 MIN.	(1) (2) (4) (5) (7) (9)
C2	3' - 0"	7' - 0"	0' - 1 3/4"	18	A	20	16	4	90 MIN.	(1) (2) (4) (5) (6) (7)
C3	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	6	-	(2) (5) (7) (12) (22) (24) (28)
C4	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	5	-	(2) (5) (7) (12) (22) (24) (28)
C5	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	5	-	(2) (5) (7) (12) (28)
C6	3' - 0"	7' - 0"	0' - 1 3/4"	18	D	20	16	5	20 MIN.	(1) (2) (4) (5) (7) (11) (28)
C7	3' - 0"	8' - 6"	0' - 1 3/4"	18	A	20	16	5	20 MIN.	(1) (2) (4) (5) (7) (28)
C8	3' - 0"	7' - 0"	0' - 1 3/4"	18	A	20	16	6	20 MIN.	(1) (2) (4) (5) (7) (11) (28)
C9	3' - 0"	7' - 0"	0' - 1 3/4"	18	D	20	16	6	20 MIN.	(1) (2) (4) (5) (7) (11) (28)
C10	3' - 0"	8' - 0"	0' - 1 3/4"	18	A	20	16	2	90 MIN.	(1) (2) (4) (5) (6) (7) (28)
C11	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	6	-	(2) (5) (7) (9) (24) (28)
C12	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	5	-	(2) (5) (7) (12) (24) (28)
C13	3' - 0"	8' - 0"	0' - 1 3/4"	17	A	17	16	6	45 MIN.	(2) (5) (6) (7) (9) (28) *PROVIDE PUSH/ PULL PLATES ON BOTH SIDES
C14	8' - 0"	8' - 0"	0' - 3"	18	G	20	16	-	90 MIN.	(1) (2) (4) (5) (7) *MOTORIZED OPERATION
C15	18' - 10"	5' - 0"	0' - 1 3/4"	18	G	20	16	-	20 MIN.	(2) (5) (28) *MOTORIZED OPERATION
C16	3' - 0"	8' - 0"	0' - 1 3/4"	18	A	20	16	4	45 MIN.	(2) (5) (6) (7) (28)
C17	6' - 0"	8' - 0"	0' - 1 3/4"	18	B	20	16	1 9	45 MIN.	(1) (2) (4) (5) (7) (9) (11)
C18	6' - 0"	7' - 0"	0' - 1 3/4"	18	E	20	16	2 9	20 MIN.	(1) (2) (4) (5) (7) (28)
C19	6' - 0"	6' - 0"	0' - 1 3/4"	18	E	20	16	1 9	90 MIN.	(1) (2) (4) (5) (7) (9)
C20	6' - 0"	7' - 0"	0' - 1 3/4"	18	B	20	16	1 9	90 MIN.	(1) (2) (4) (5) (7) (28)
C21	6' - 0"	8' - 0"	0' - 1 3/4"	13	I	20	16	6	-	(2) (5) (7) (14) (24) (28) *REFER TO INTERIOR DESIGN DRAWINGS
C22	6' - 0"	8' - 0"	0' - 1 3/4"	13	B	20	16	5	20 MIN.	(2) (5) (7) (14) (28) *REFER TO INTERIOR DESIGN DRAWINGS
C23	3' - 0"	8' - 0"	0' - 1 3/4"	18	A	20	16	4	90 MIN.	(2) (5) (6) (7)
S1	3' - 0"	7' - 0"	0' - 1 3/4"	18	C	20	16	3 8	90 MIN.	(1) (2) (4) (5) (6) (7) (9) (30) (11)
S2	3' - 0"	7' - 0"	0' - 1 3/4"	18	C	20	16	3 8	90 MIN.	(1) (2) (4) (5) (6) (7) (30)

DOOR TYPES - COMMON AREAS

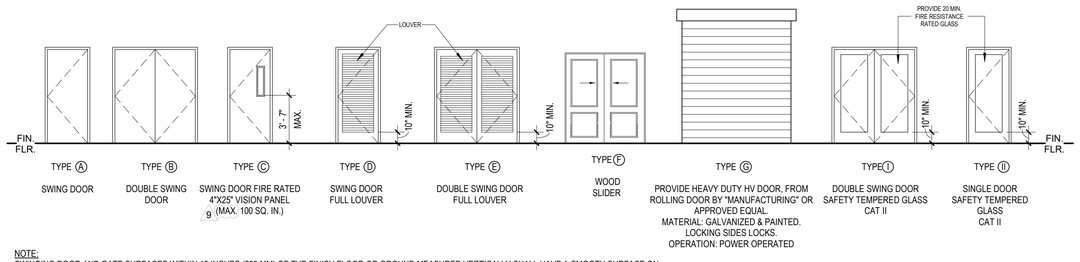


NOTE:
SWINGING DOOR AND GATE SURFACES WITHIN 10 INCHES (255 MM) OF THE FINISH FLOOR OR GROUND MEASURED VERTICALLY SHALL HAVE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR OR GATE. PARTS CREATING HORIZONTAL OR VERTICAL JOINTS IN THESE SURFACES SHALL BE WITHIN 1/16 INCH (1.6 MM) OF THE SAME PLANE AS THE OTHER. CAVITIES CREATED BY ADDED KICK PLATES SHALL BE CAPPED.

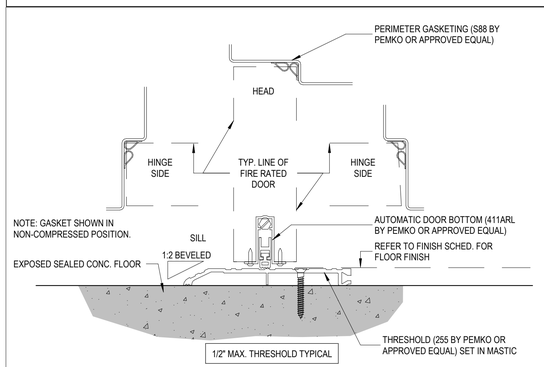


TWO HOUR RATED ASSEMBLY

** CONTRACTOR TO VERIFY UL RATED ASSEMBLY AND INSTALL AS PE MANUF. RECOMMENDATIONS

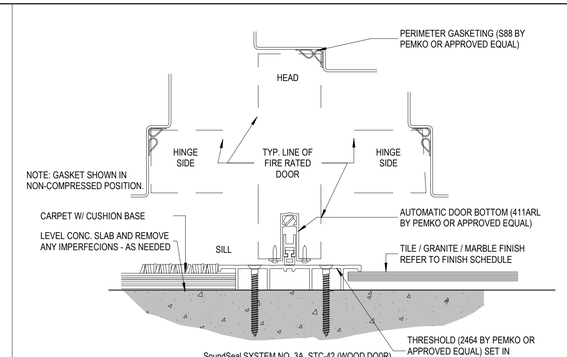

ONE HOUR RATED ASSEMBLY

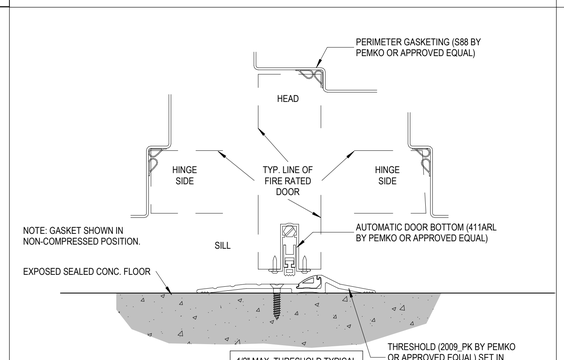

TWO HOUR RATED ASSEMBLY

DOOR SCHEDULE LEGEND

(1) WEATHER SEAL THROUGHOUT
(2) REFER TO MANUFACTURER SPECS.
(3) REFER TO STOREFRONT ELEVATIONS. SHEET A-10.00
(4) EXTERIOR IMPACT RESISTANT (NOA #)
(5) SMOKE PROOF ENCLOSURE
(6) PANIC HARDWARE(W.CONCEALED LOCKS SEE #8 ON HARDWARE LEGEND)
(7) SELF CLOSER DEVICE.
(8) ONE HOUR RATED "FIRELITE" SYSTEM, SEE NOTE 10.
(9) PROVIDE STAINLESS STEEL KICK PLATES (12"X36") - BOTH SIDES.
(10) PROVIDE MAGNETIC DOOR HOLDER - (BOTH DOORS) SHALL BE INTEGRATED WITH FIRE ALARM SYSTEM.
(11) PROVIDE 180° DEGREE HINGES.
(12) APPLY FIRE RETARDANT PRIMER TO DOOR PRIOR TO FINAL PAINT. NO LOCKING DEVICE.
(13) ALUMN./ GLASS
(14) SAFETY TEMPERED GLASS (CAT II)
(15) ALUMINUM. (E.S.P.) COLOR TO BE SELECTED BY ARCHITECT
(16) ALUMINUM (1/2" MAX LEVEL DIFFERENCE)
(17) SOLID CORE WOOD
(18) HOLLOW METAL
(19) GALVANIZED METAL, PAINTED
(20) METAL
(21) FIBERGLASS METAL CLAD, PAINTED
(22) ADA WIRELESS PUSH PLATE SWITCH
(23) WOOD/MASONITE (HARDBOARD)
(24) ACCESS CONTROL (COORDINATE WITH OWNER'S SECURITY CONSULTANT)
(25) REFER TO HARDWARE NOTES.
(26) PANIC HARDWARE
(27) DOOR ONLY FOR EGRESS, SHALL BE INTEGRATED WITH ALARM SYSTEM
(28) SPECS MIGHT CHANGE BASED ON INTERIOR DESIGNER PACKAGE. REFER TO ID DRAWINGS.
(29) GATE BY MANUFACTURER PROVIDE SHOP DRAWINGS FOR APPROVAL
(30) 43" MAX. TO VISION GLASS.

HARDWARE LEGEND

1. SECURITY DOUBLE DOORS WITH LOCK SET, SELF CLOSER, & CLOSING COORDINATOR WALL/FLOOR MOUNTED DOORSTOP (WHERE NEEDED).
2. SECURITY EXTERIOR DOOR WITH LOCK SET, SURFACE MOUNTED SELF CLOSER. WALL/FLOOR MOUNTED DOOR STOP (WHERE NEEDED) FLUSH THRESHOLD AT INTERIOR WITH FINISH FLOOR LEVEL.
3. PANIC HARDWARE @ GROUND LEVEL. SELF CLOSING WITH SECURITY HARDWARE AT ALL LEVELS IN BETWEEN GROUND AND ROOF. KEY LESS RE-ENTRY AT ROOF LEVEL.
4. ENTRY LOCK SETS, WITH CLOSER AND WALL OR FLOOR MOUNTED DOOR STOP.
5. SECURITY LOCK SET WITH SELF CLOSER, DOOR STOP AT WALL OR FLOOR.
6. PASS THRU LOCK SET WITH SELF CLOSER.
7. PROVIDE DEADBOLT LOCK. BY SCHLAGE. (FINISH AND COLOR TO BE SELECTED BY ARCHITECT / OWNER)
8. ALL PANIC HARDWARE WITH CONCEALED LOCKS. SURFACE MOUNTED LOCKS WITHIN THE BOTTOM 10 INCHES OF THE DOOR IS NOT PERMITTED.
9. WHEN DOUBLE DOOR, AT LEAST ONE LEAF TO BE 32" MIN. CLEAR.
10. PROVIDE HASP LOCK. BY SCHLAGE. (FINISH AND COLOR TO BE SELECTED BY ARCHITECT / OWNER)

FORCED ENTRY PREVENTION NOTES :

1. PROVIDE INTRUSION AND BURGLARY SECURITY DEVICES IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2010 AND ALL PREVAILING REVISIONS.
2. ALL LOCKS FOR EXTERIOR DOORS SHALL BE CAPABLE OF RESISTING A FORCE OF 300 LBS. APPLIED IN ANY MOVABLE DIRECTION AND IN ACCORDANCE W/ RESISTANCE STANDARD SET FORTH IN THE SOUTH FLORIDA BUILDING CODE 2010.
3. ALL SINGLE EXTERIOR SWING DOORS SHALL HAVE A LOCK TO BE KEY OPERATED FROM THE EXTERIOR WITH A MINIMUM OF 600 POSSIBLE KEY CHANGES OR LOCKING AUXILIARY SINGLE DEAD BOLT WITH HARDENED BOLT INSERTS.
4. THE ACTIVE LEAF OF EXTERIOR SWING DOORS SHALL HAVE SAME LOCK AS REQUIRED FOR SINGLE EXTERIOR SWING DOORS. THE INACTIVE LEAF SHALL HAVE MULTIPLY POINTS OF LOCKS WITH 5/8" MIN. THROW BOLTS WITH INSERTS.
5. JAMBS OF ALL EXTERIOR OFFSET TYPE IN SWING DOORS SHALL BE RABBETED OR OF SIMILAR FABRICATION TO PREVENT DEFEATING THE PURPOSE OF THE STRIKE AND THE INTEGRITY OF THE LOCKS AND LATCHES.
6. HINGES ON EXTERIOR OUT SWINGING DOORS SHALL HAVE NON-REMOVABLE PINS AND NON-EXPOSED SCREWS.
7. GLASS AND EXTERIOR DOORS SHALL COMPLY WITH THE AMERICAN NATIONAL STANDARDS INSTITUTE 297.1.
8. VISION PANEL EXTERIOR DOORS OTHER THAN GLAZING WITHIN 40 OF THE INSIDE LOCKING ACTIVATING DEVICE OF LOOSE AND SWING DOORS SHALL COMPLY W/ THE AMERICAN NATIONAL STANDARD INSTITUTE 297.1.
9. WINDOWS SHALL BE INSTALLED AND CONSTRUCTED SO THAT NO PANEL CAN BE LIFTED FROM THE TRACKS WHEN IN THE LOCKED POSITION AND SO AS TO COMPLY WITH THE ARCHITECTURAL ALUMINUM MAGS.

NOTES

1. REFER TO MECHANICAL PLANS FOR DOORS REQUIRING VENTILATION LOUVERS.
2. COORDINATE FIRE RATING WITH LIFE SAFETY DRAWINGS.
3. ALL GLAZING @ FIRE RATED DOORS GREATER THAN 100 S.I. SHALL BE FIRE LITE GLAZING. PROVIDE GLAZING TO MEET FIRE RATING, HOSE STREAM REQUIREMENTS AND TEMPERATURE AS PER SEC. 715 FBC (OPENING PROTECTIVES).
4. RATED DOORS SHALL INCLUDE ENTIRE ASSEMBLY, INCLUDING UL RATED HARDWARE, GASKETS, CLOSERS, ETC.
5. ALL EXTERIOR DOORS SHALL BE IMPACT RESISTANT AND HAVE NOA APPROVAL. REFER TO STRUCTURAL DRAWINGS FOR WIND PRESSURES.
6. ALL DOORS SHALL BE PROVIDED WITH SELF CLOSER & WALL STOPS AS REQUIRED.
7. ALL DOORS IN THE PATH OF EGRESS MUST BE OPERABLE WITH NOT MORE THAN ONE RELEASING OPERATION. DOORS EXITING ASSEMBLY AREAS, STAIRWAYS AND CORRIDORS MUST BE PROVIDED WITH PANIC DEVICE HARDWARE.
8. DIFFERENCE IN FLOOR LEVEL BETWEEN OPPOSITE SIDES OF EGRESS DOORS MUST BE A MAXIMUM OF 1/4" (1/2" IF BEVELED).
9. ALL GLAZING IN DOORS & WITHIN 48" OF DOORS TO BE MIN. CATEGORY II SAFETY GLASS IN ACCORDANCE WITH FBC SECT. 2411.4.3
10. ALL VISION PANELS SHALL HAVE BOTTOM OF PANEL LOCATED AT 43" AFF MAX. TO MEET ACCESSIBILITY REQUIREMENTS.
11. ALL DOORS TO PROVIDE 32" MIN. CLEAR WHEN ONE DOOR LEAF IS OPEN 90 DEGREES MEASURED BETWEEN THE FACE OF THE DOOR AND THE OPPOSING DOOR STOP.
12. RE-ENTRY FROM THE STAIR ENCLOSURE TO THE INTERIOR OF THE BUILDING SHALL BE PROVIDED, PER N.F.P.A. 101 - SECT. 7.2.1.5.7
13. SWINGING DOOR AND GATE SURFACES WITHIN 10 INCHES OF THE FINISH FLOOR OR GROUND MEASURED VERTICALLY SHALL HAVE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR OR GATE. PER F.B.C. SECT. 404.2.10
14. DOORS AND HARDWARES MUST COMPLY WITH FFPC 101 TABLE 8.3.4.2 FOR DOORS IN FIRE RESISTANCE-RATED ASSEMBLIES
15. DOORS AND HARDWARES MUST PROVIDE SELF-CLOSING DEVICE PER FFPC 101:8.3.3.3.
16. DOORS MUST SWING IN THE DIRECTION OF EGRESS TRAVEL PER FFPC 101:7.2.1.4.2.
17. DOORS AND HARDWARES MUST BE PROVIDED WITH PANIC HARDWARE OR EXIT HARDWARE WHEN SERVING MORE THAN 100 OCCUPANTS IN ASSEMBLY PER FFPC 101:12.2.2.2.3.
18. PROVIDE POWER OPERATED DOOR TO COMPLY WITH FFPC 101:7.2.1.9. (TO BE CONFIRMED BY OWNERSHIP VIA SHOP DRAWING).
19. PROVIDE DOORS WHOSE THRESHOLDS PERMIT A 1/2" MAXIMUM CHANGE IN ELEVATIONS PER FFPC 101:7.1.6.2.
20. THRESHOLD AT DOORWAYS SHALL COMPLY WITH 2017 FBC:1010.1.7.
21. PROVIDE PARKING GARAGE AUTOMATIC DOOR OPENERS LISTED IN ACCORDANCE WITH UL-325 INFORMATION COMPLYING WITH 2017 FBC B:406.3.6.
22. ACCESSS-CONTROLLED EGRESS DOORS MUST COMPLY WITH 2017 FBC:1010.1.9.8.
23. FIRE DOORS AND SHUTTER ASSEMBLIES SHALL COMPLY WITH 2017 FBC: TABLE 716.5.


HARDWARE NOTES

1. CONTRACTOR SHALL PROVIDE ALL HARDWARE INCLUDING BUT NOT LIMITED TO: BUTTS, LOCKS, SELF-CLOSERS, HOLDERS, DOOR STOPS, THRESHOLDS, KICK PLATES, PUSH PLATES, PULLS AND TEMPLATES AS APPLICABLE. DOOR LOCKS SHALL BE MANUFACTURED BY SCHLAGE OR APPROVED EQUAL. CONTRACTOR SHALL PROVIDE A COMPLETE HARDWARE SCHEDULE TO BE SUBMITTED TO ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO PROCUREMENT OF ITEMS.
2. ALL HARDWARE SHALL BE LEVER TYPE AND SHALL MEET ALL REQUIREMENTS ACCORDING TO SECTION 404.2.7 OF THE FLORIDA ACCESSIBILITY CODE.
3. PROVIDE CLOSING COORDINATOR FOR ALL DOOR PAIRS EQUIPPED WITH SELF CLOSING DEVICE.
4. BIFOLD DOOR 2'-10" OR LESS IN WIDTH SHALL BE EQUIPPED W/ HARDWARE SYSTEM, WHERE 32" CLEAR DOOR OPENING IS REQUIRED BY CODE FOR ACCESSIBILITY.
5. ALL HARDWARE SHALL BE BRUSHED. STAINLESS STEEL GRADE II -RESIDENTIAL EXTERIOR ENTRY DOORS SHALL BE EQUIPPED WITH A KEY LOCK, DEADBOLT, PEEPHOLE, KNOCKER.
6. ELECTRICAL ROOMS WITH EQUIPMENT RATED 1,200 AMPERES OR MORE AND OVER 6 FEET (1829 MM) WIDE, AND THAT CONTAIN OVERCURRENT DEVICES, SWITCHING DEVICES OR CONTROL DEVICES WITH EXIT OR EXIT ACCESS DOORS, SHALL BE EQUIPPED WITH PANIC HARDWARE OR FIRE EXIT HARDWARE. THE DOOR SHALL SWING IN THE DIRECTION OF EGRESS TRAVEL ACCORDING TO FBC 2017 SECTION 1010.1.10


ALL ALUMINUM COMPONENTS TO BE FINISHED WITH AN INHIBITIVE THERMO-CURED PRIMER AND A THERMO-CURED FLUOROCARBON COATING CONTAINING "KYNAR 500" RESIN OR APPROVED EQUAL, EXCEPT FOR EXTERIOR PERFORATED RAILINGS AND PRIVACY PANELS. COMPLY WITH NAAMM "METAL FINISHES MANUAL" FOR FINISH DESIGNATIONS AND APPLICATION RECOMMENDATIONS.

RESTROOM SIGN DETAIL

TACTILE CHARACTERS ON SIGNS SHALL BE LOCATED 48 INCHES MINIMUM ABOVE FLOOR, MEASURED FROM THE BASELINE OF THE LOWEST TACTILE CHARACTER AND 60 INCHES MAXIMUM ABOVE THE FINISHED FLOOR MEASURED FROM THE BASELINE OF THE HIGHEST TACTILE CHARACTER



WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE LOCATED ALONGSIDE THE DOOR AT THE LATCH SIDE. SIGN CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR SPACE OF 18 INCHES MINIMUM BY 18 INCHES MINIMUM, CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION.



PER FBC ACCESSIBILITY 703.4 SIGN INSTALLATION HEIGHT AND LOCATION

ATLANTIC PACIFIC COMMUNITY BUILDERS
Bulletin #6
Date Received:
November 19th, 2024

CORWILARCHITECTS
4210 LAGUNA ST. CORAL GABLES FL. 33146
LIC.NO. AA-C002151 T.305.448.7383

PROJECT:
Casa Familia
Exceptional Housing for Exceptional People
10951 SW 84th ST, MIAMI-DADE, FLORIDA 33173

OWNER:
ATLANTIC PACIFIC COMMUNITIES
161 NW 6th ST, Ste. 1020 Miami, Florida 33136

PHASE:
PERMIT SET

COMMON AREA DOOR SCHEDULE

REVISIONS		
Rev #	Revision Description	Date
1	Bldg Review Cmt	09/30/20
2	County Comments	11/20/20
7	Pre-con RFIs/Coord.	05/03/24
9	Coordin.	07/19/24
10	Coordin./Bulletin #6	09/20/24

SEAL:

THIS DRAWINGS IS THE PROPERTY OF CORWIL ARCHITECTS INC.. UNLESS OTHERWISE PROVIDED FOR BY CONTRACT, THE CONTENTS OF THIS DRAWINGS ARE CONFIDENTIAL AND SHALL NOT BE TRANSMITTED TO ANY OTHER PARTY EXCEPT AS AGREED TO BY THE ARCHITECT/ENGINEERS.

DATE: 5-18-2020
JOB No.: 2019-20
DRAWN BY: MA,CM,JM,JW,FG
APPR BY: AMC
PRINTED: 11/13/2024

A-8.00