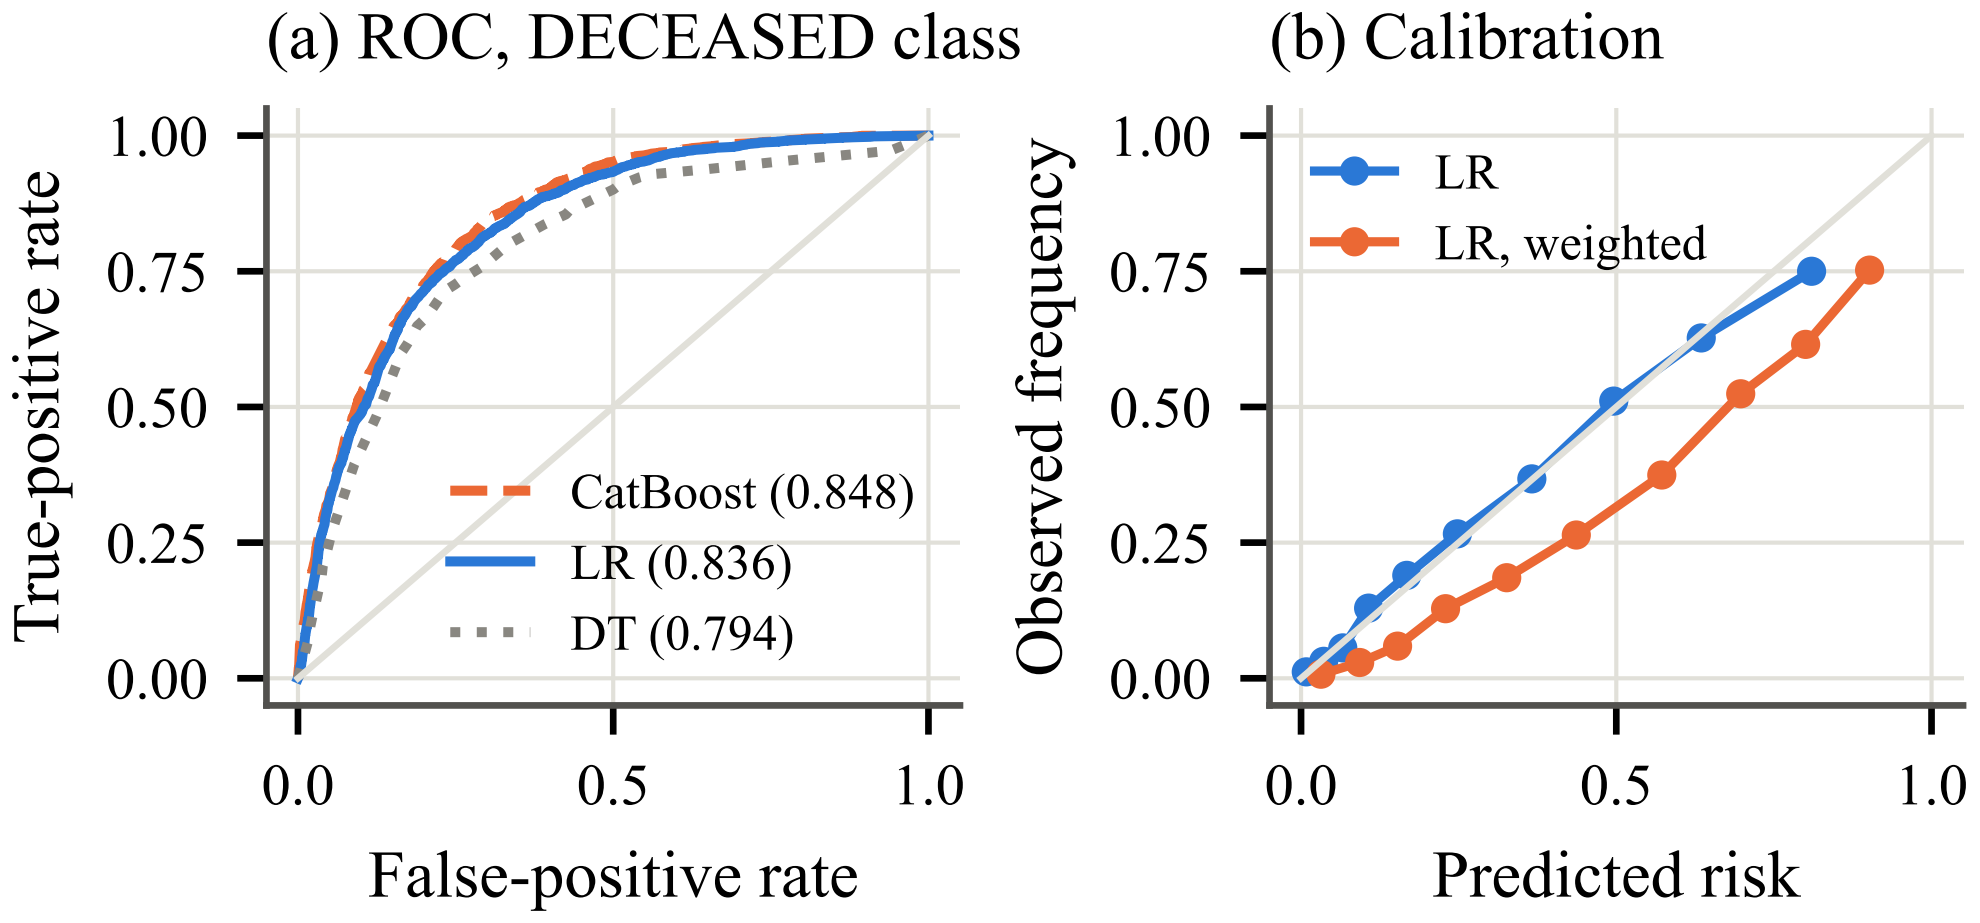
(a) ROC, DECEASED class
True-positive rate
1.00
0.75
0.50
0.25
0.00
0.0
0.5
1.0
False-positive rate
CatBoost (0.848)
LR (0.836)
DT (0.794)
(b) Calibration
Observed frequency
Predicted risk
LR
LR, weighted