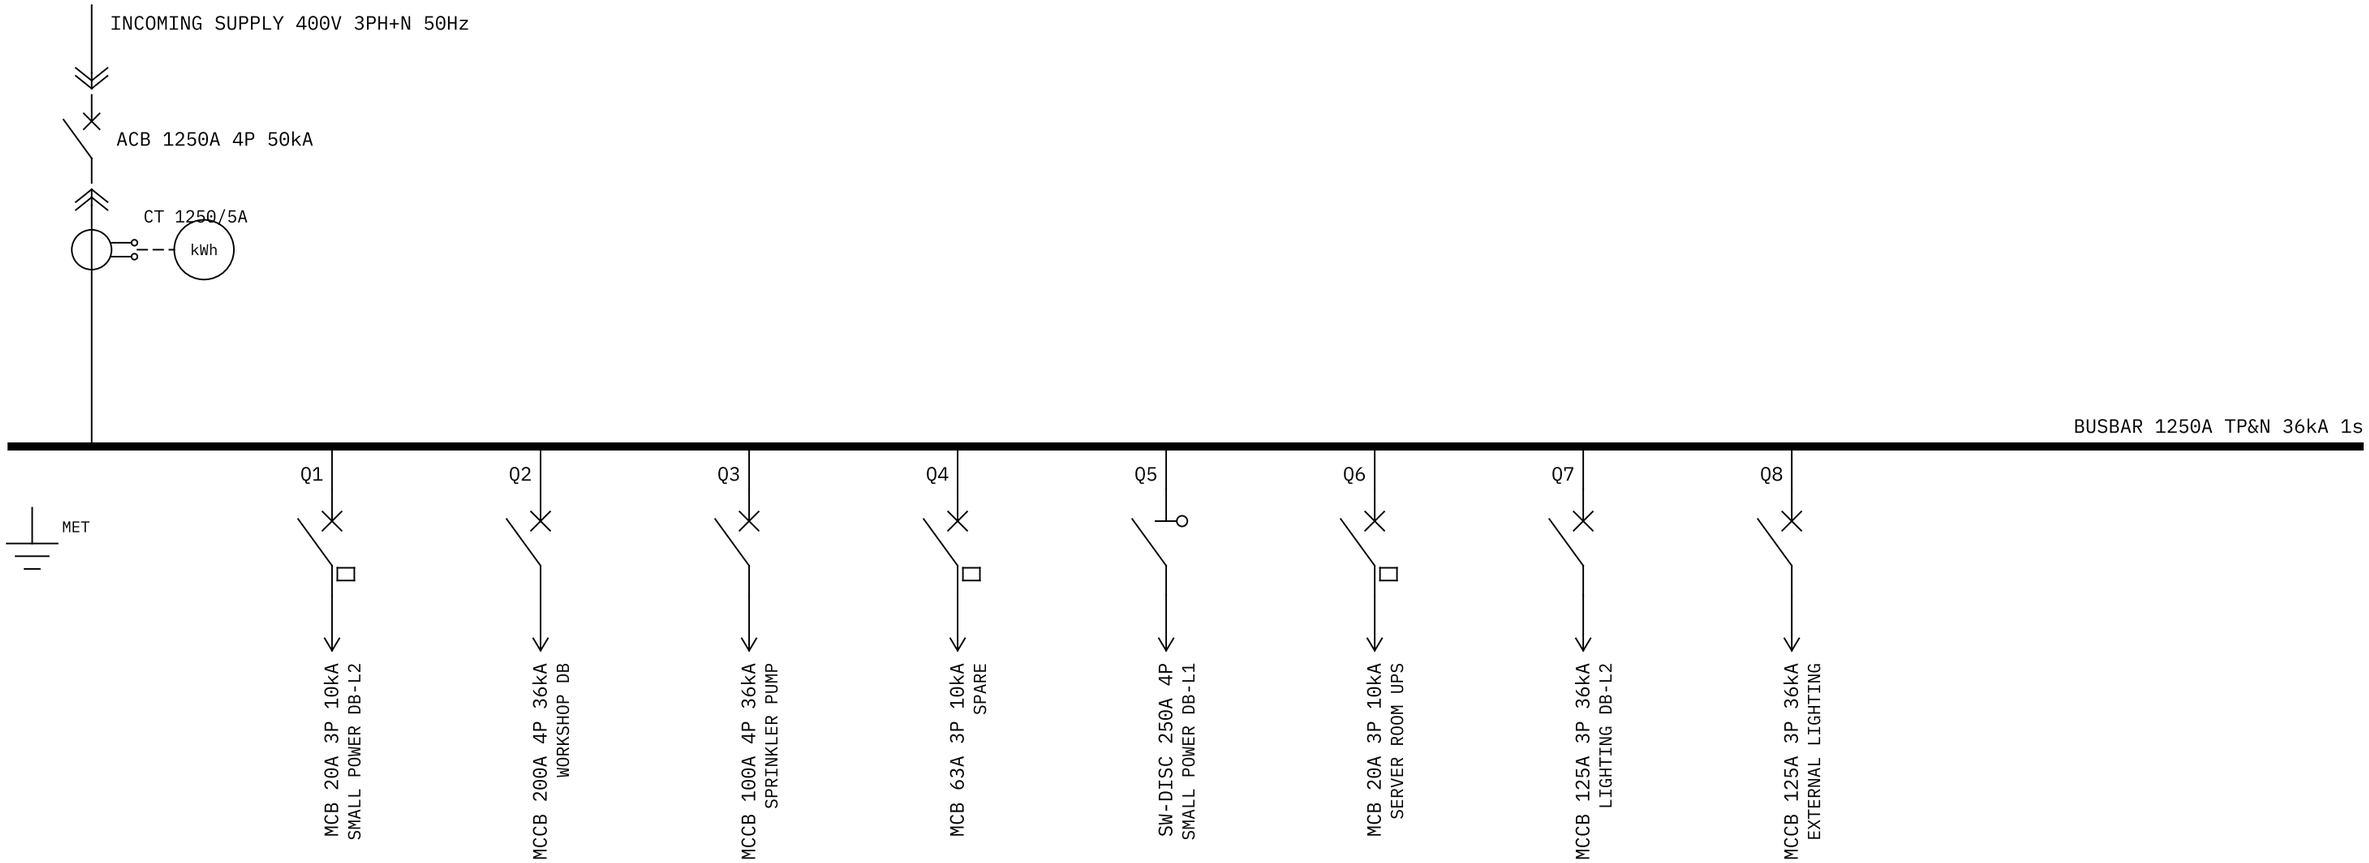


NOTES:

1. FORM OF SEPARATION: FORM 4a
2. DEGREE OF PROTECTION: IP54
3. CABLE ENTRY: BOTTOM
4. EARTHING SYSTEM: TN-C-S
5. ALL DIMENSIONS IN mm UNLESS STATED
6. DO NOT SCALE FROM THIS DRAWING

CABLE SCHEDULE

WAY	DESCRIPTION	DEVICE	CABLE	LEN (m)
Q1	SMALL POWER DB-L2	MCB	4C 4 mm2 SWA	23
Q2	WORKSHOP DB	MCCB	4C 120 mm2 SWA	89
Q3	SPRINKLER PUMP	MCCB	4C 35 mm2 SWA	17
Q4	SPARE	MCB	4C 16 mm2 SWA	11
Q5	SMALL POWER DB-L1	SW-DISC	4C 120 mm2 SWA	41
Q6	SERVER ROOM UPS	MCB	4C 4 mm2 SWA	59
Q7	LIGHTING DB-L2	MCCB	4C 50 mm2 SWA	32
Q8	EXTERNAL LIGHTING	MCCB	4C 50 mm2 SWA	28

REV	DATE	DESCRIPTION	BY
B	2026-05-12	UPDATED TO CLIENT COMMENTS	JM
A	2026-05-01	FIRST ISSUE FOR TENDER	JM


Example Panels Ltd

SINGLE LINE DIAGRAM

MSB-2 Ingleby Example Housing Ltd

DRAWING No. EPL-SHOWCASE-SLD
REV B DATE 2026-05-12

DRAWN JM SHEET 1 OF 2 SCALE NTS
CHECKED RT

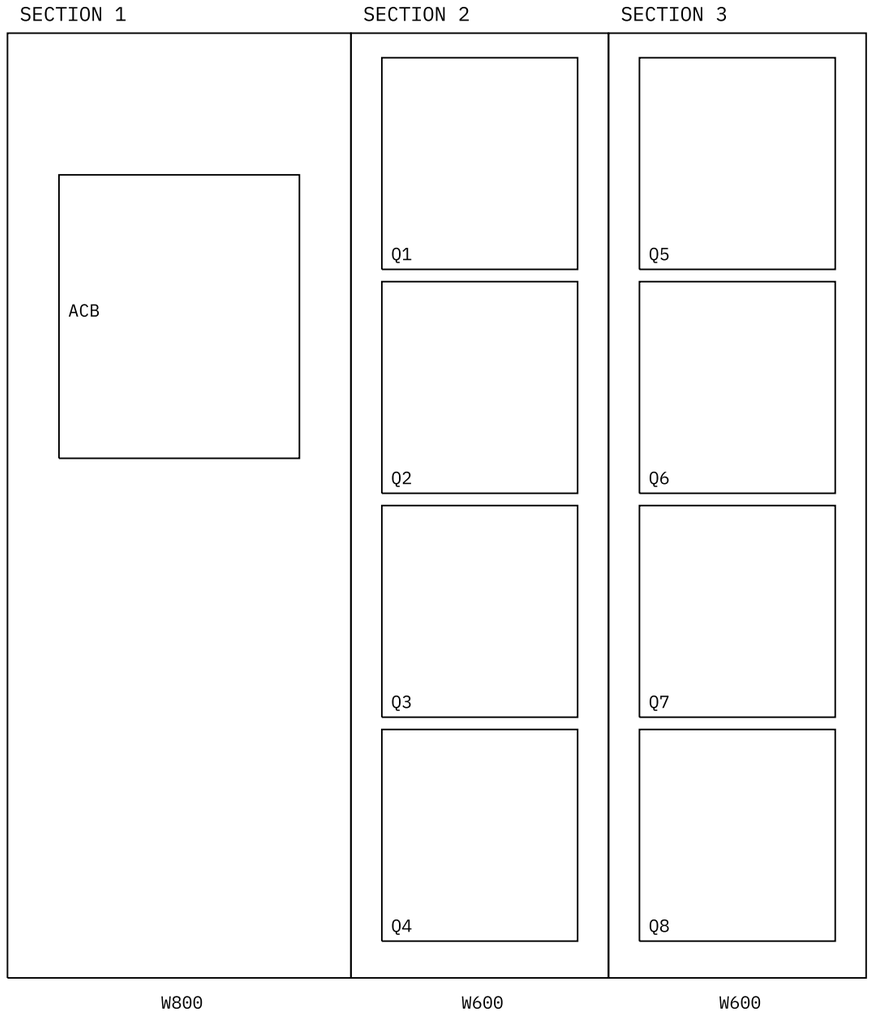

OVERALL WIDTH 2000 mm - 3 SECTIONS

HEIGHT 2200 mm

REV	DATE	DESCRIPTION	BY
B	2026-05-12	UPDATED TO CLIENT COMMENTS	JM
A	2026-05-06	FIRST ISSUE FOR TENDER	JM

Example Panels Ltd

GENERAL ARRANGEMENT - FRONT VIEW

MSB-2 Ingleby Example Housing Ltd

DRAWING No. EPL-SHOWCASE-SLD

REV B DATE 2026-05-12

DRAWN JM SHEET 2 OF 2 SCALE NTS

CHECKED RT