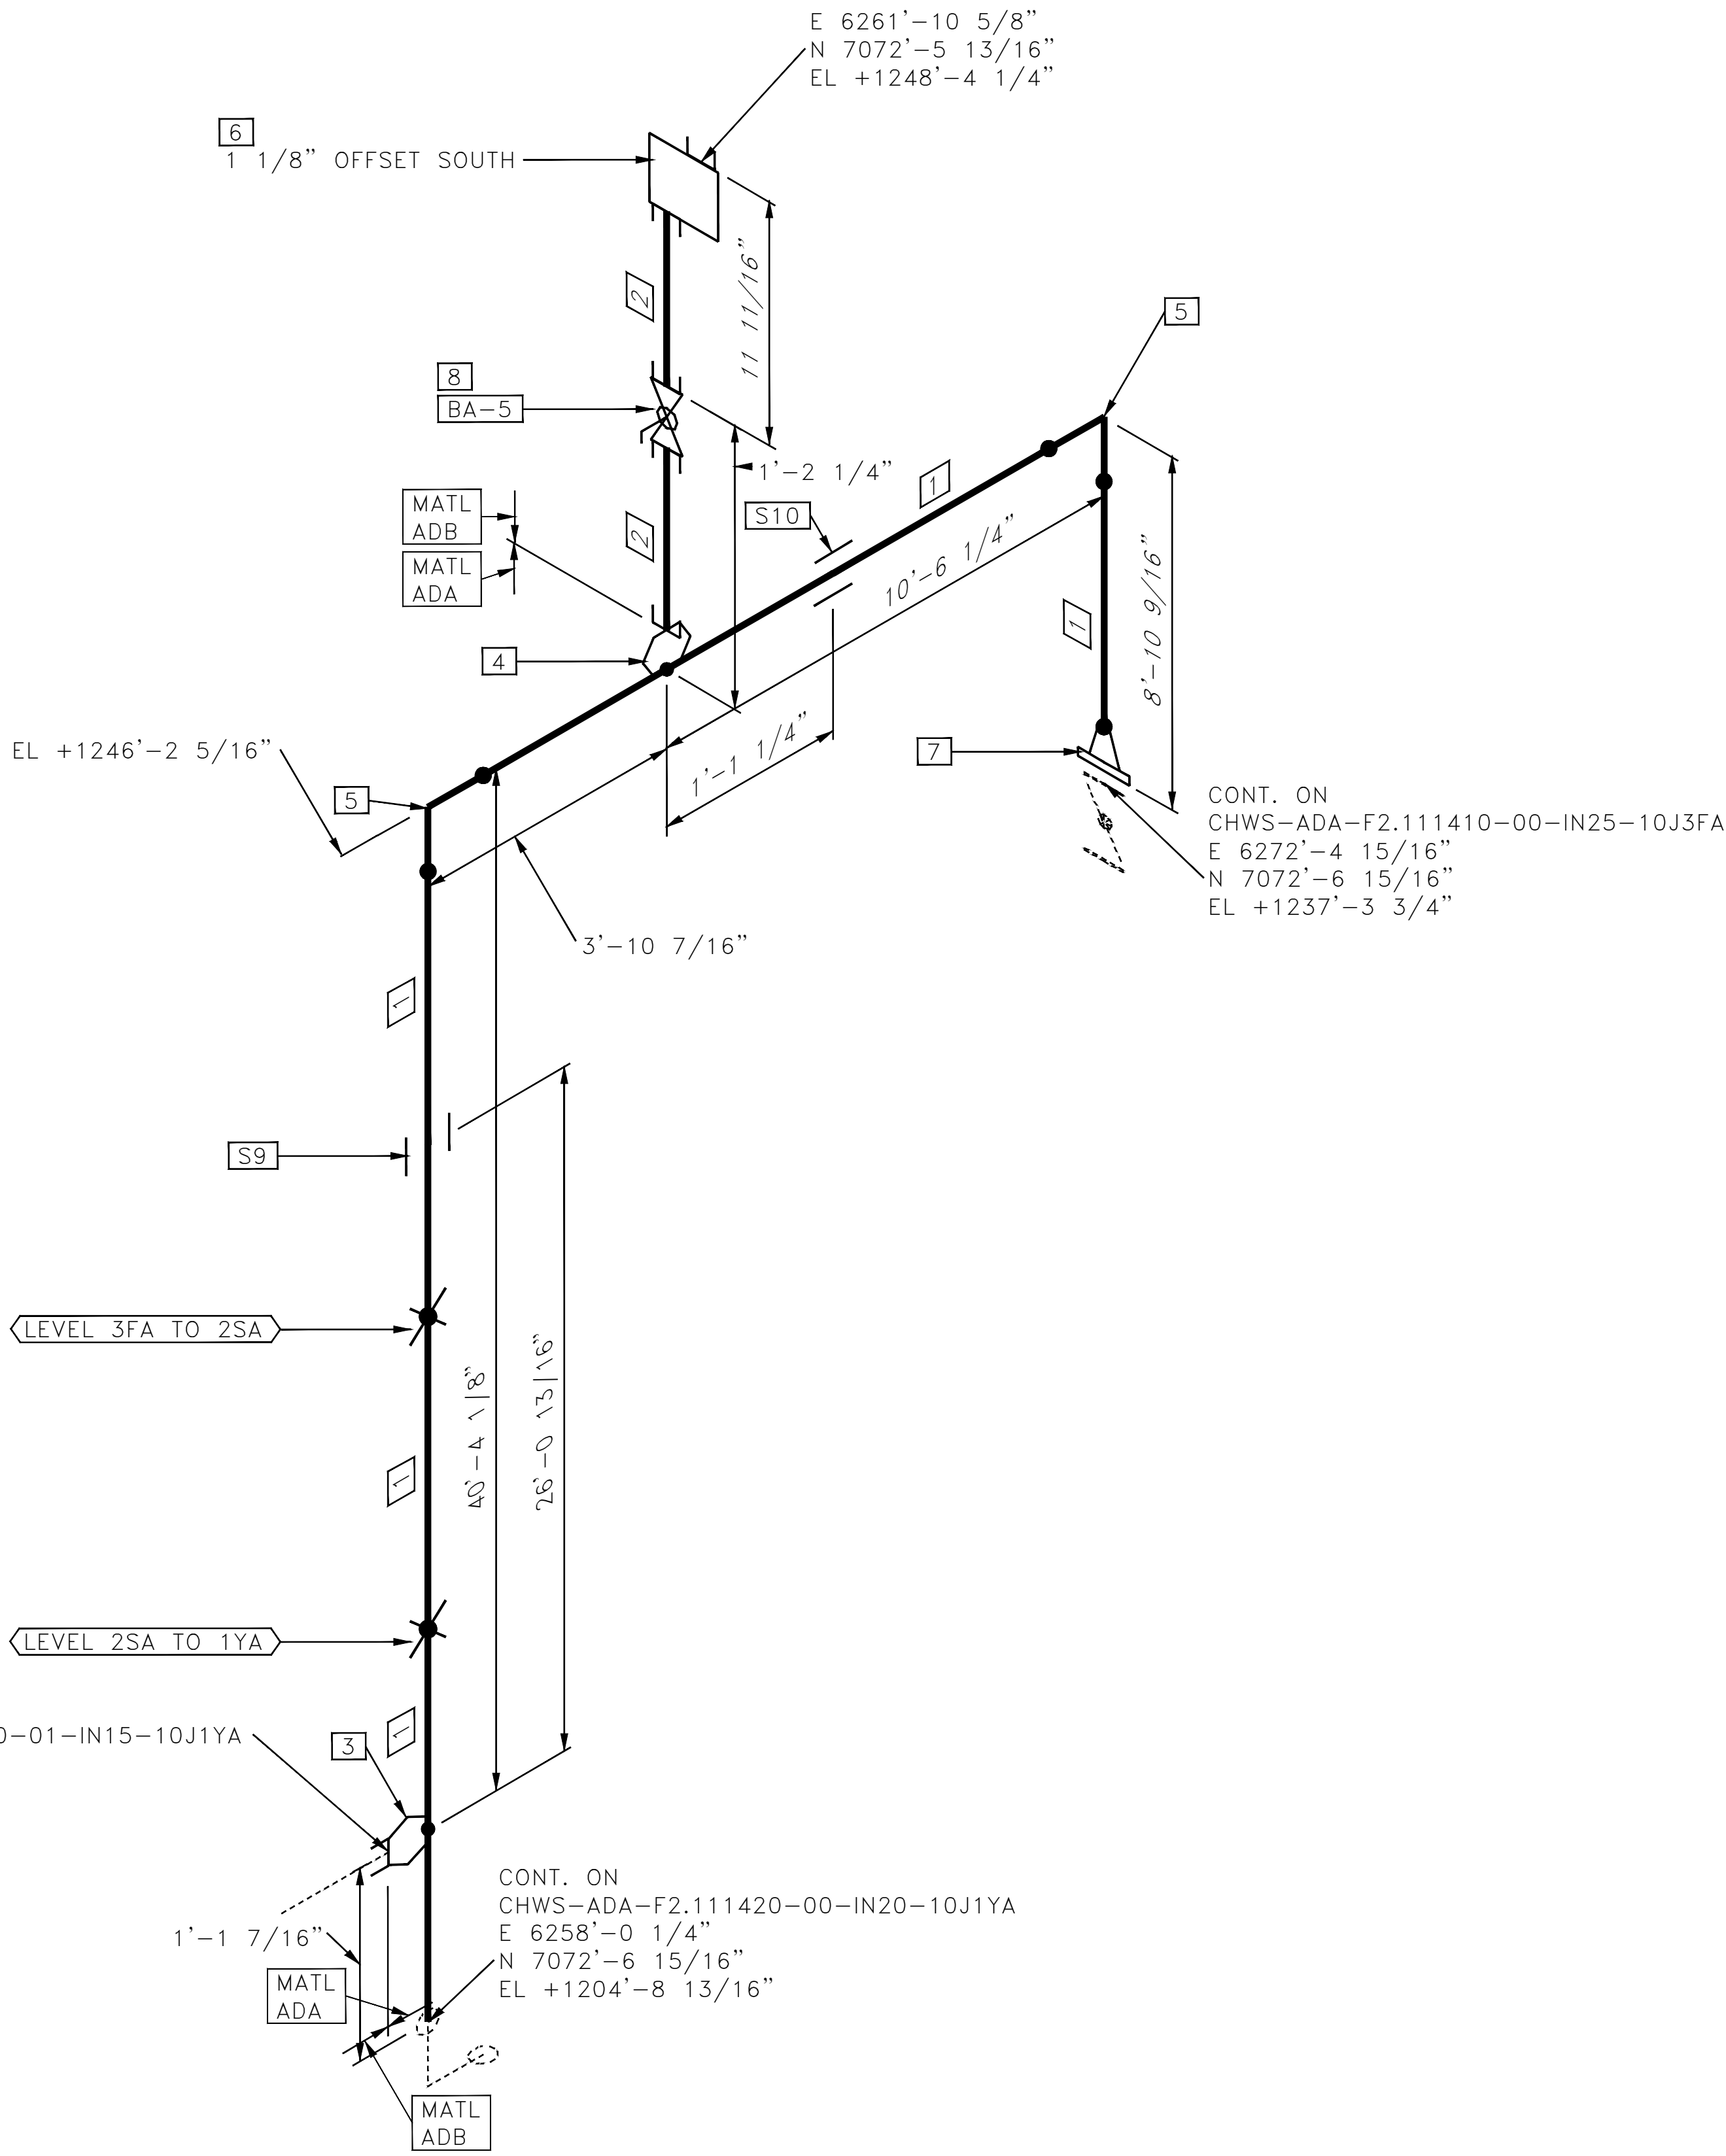


[illegible]

**ISSUED FOR
CONSTRUCTION**

NOTES:

1. FFW- LEAVE 1'-0" EXTRA LENGTH OF PIPE.
2. VERIFY ALL SUPPORT LOCATIONS AND TYPES.
3. VERIFY ALL DIMENSIONS BEFORE FINAL CUTS.

PIPE LOCATION		PIPE INFO				MARK	DATE	REVISION	BY	AP		INTEL PROJECT MOD 2 PIPING ISOMETRIC			
☒ YARD PIPE	WP #	SERVICE	CHWS	DESIGN CODE	ASME B31.3 - CAT D	0	1/28/25	ISSUED FOR CONSTRUCTION	QD	JB		WORK GROUP: MECH		UPN: CHILLED WATER SUPPLY	
☐ TRESTLE PIPE		PIPE SPEC	ADA	NDE REQUIREMENTS	N/A							DES: QD	DATE: 01/12/25	UPN #: 111	
CONSTRUCTION ZONE: 10J		DESIGN PRESSURE	125 PSI	COATING SPEC	NONE							DR: JL	SCALE: N.T.S.	DWG. 1 OF 1	
LEVEL: 3FA		DESIGN TEMP.	-20°F / 350°F	INSULATION SPEC	TYPE I							CH: RJ	DWG. NO.:		REV. 0
LOCATION: JUNGLE SHIM		TEST PRESSURE	188 PSI	INSULATION THICKNESS	2"							AP: CK	CHWS-ADA-F2.111420-00-IN20-10J3FA-1		