


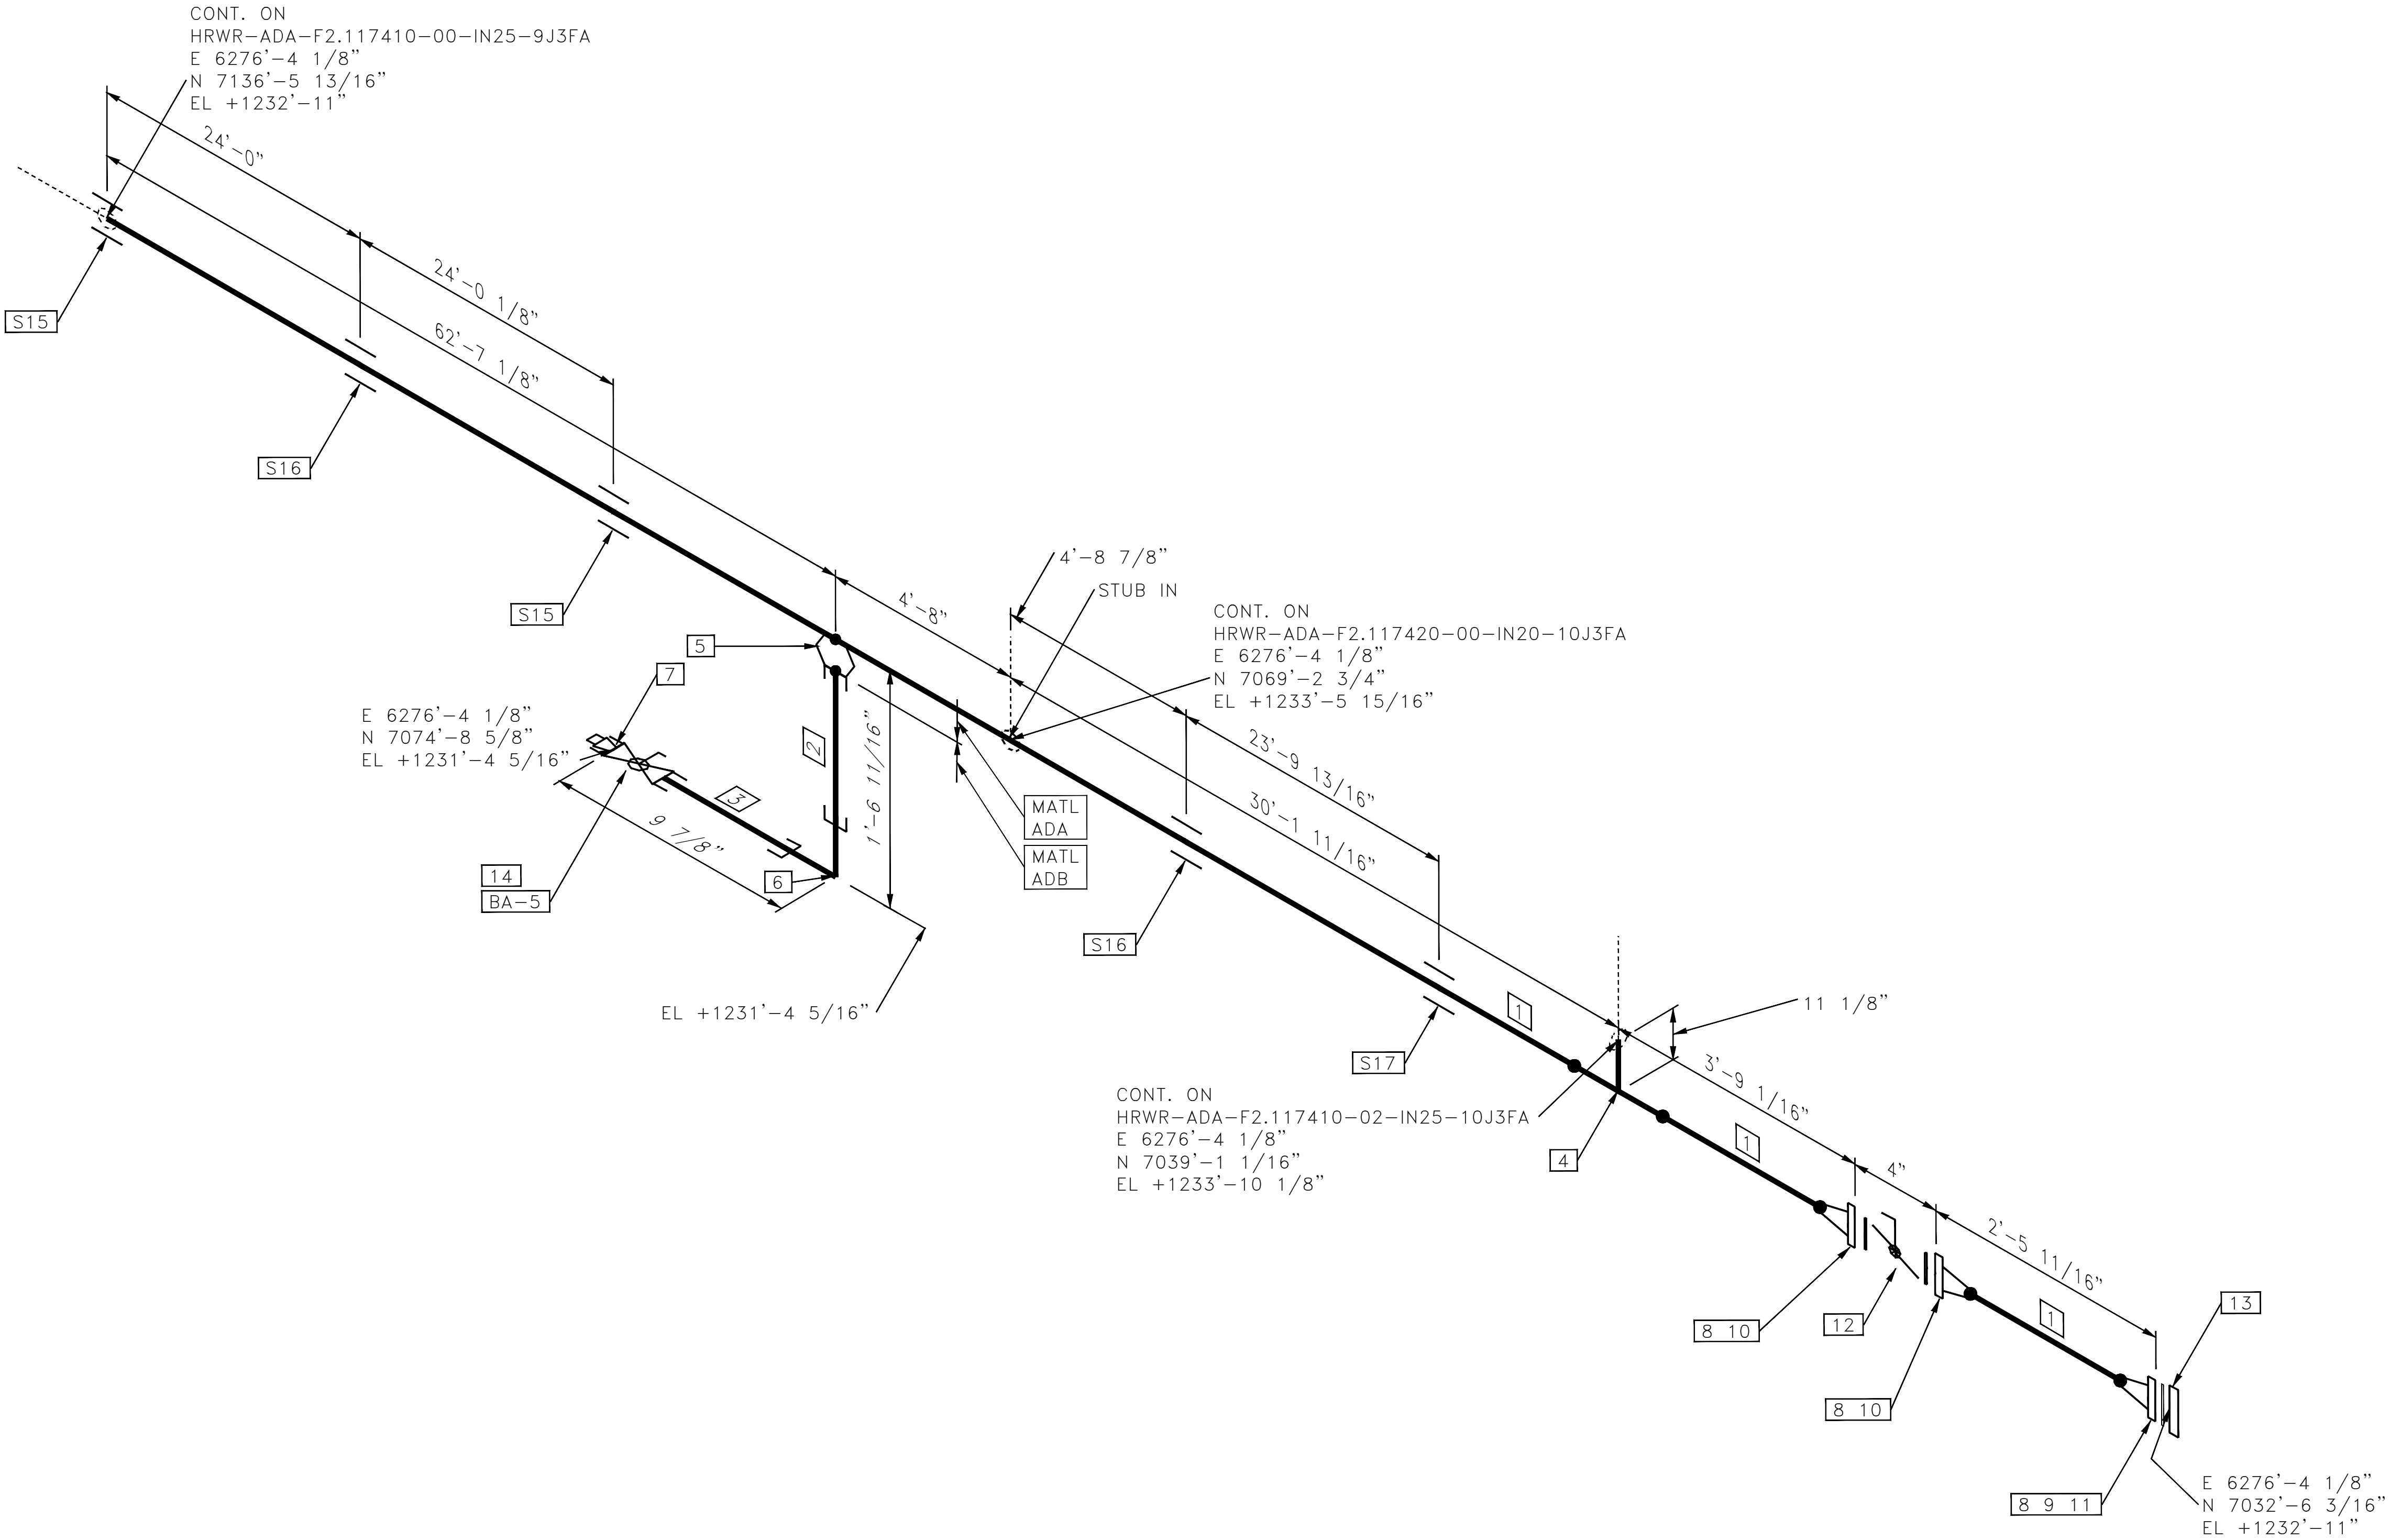

NOTES:

1. FFW- LEAVE 1'-0" EXTRA LENGTH OF PIPE.
2. VERIFY ALL SUPPORT LOCATIONS AND TYPES.
3. VERIFY ALL DIMENSIONS BEFORE FINAL CUTS.

[illegible]

PIPE LOCATION		PIPE INFO				MARK	DATE	REVISION	BY	AP
☒ YARD PIPE	WP#	SERVICE	HRWR	DESIGN CODE	ASME B31.3 - CAT D	0	1/28/2025	ISSUED FOR CONSTRUCTION	JL	JB
☐ TRESTLE PIPE		PIPE SPEC	ADA	NDE REQUIREMENTS	N/A					
<u>CONSTRUCTION ZONE:</u> 10J		DESIGN PRESSURE	125 PSI	COATING SPEC	NONE					
<u>LEVEL:</u> 3FA		DESIGN TEMP.	-20°F / 350°F	INSULATION SPEC	TYPE I					
<u>LOCATION:</u> JUNGLE SHIM		TEST PRESSURE	188 PSI	INSULATION THICKNESS	2.5"					

SUMMIT
INDUSTRIAL

INTEL PROJECT MOD 2 PIPING ISOMETRIC					
WORK GROUP: MECH		UPN: HEAT RECOVERY WATER RETURN			
DES: QD	DATE: 01/29/25	UPN#: 117			
DR: JL	SCALE: N.T.S.	DWG. 1	OF	1	
CH: RJ	DWG. NO.:				REV. 0
AP: CK	HRWR-ADA-F2.117410-00-IN25-10J3FA-1				