


CEDAR RIDGE SOLAR + STORAGE

SINGLE-LINE DIAGRAM (SLD) · INTERCONNECTION EXHIBIT

Project: 120 MWAC Solar | POI Voltage: 138 kV | County: Example, IN | Rev: A

GRIDPILOT DEMO DRAWING

Intentional deficiencies for audit demo

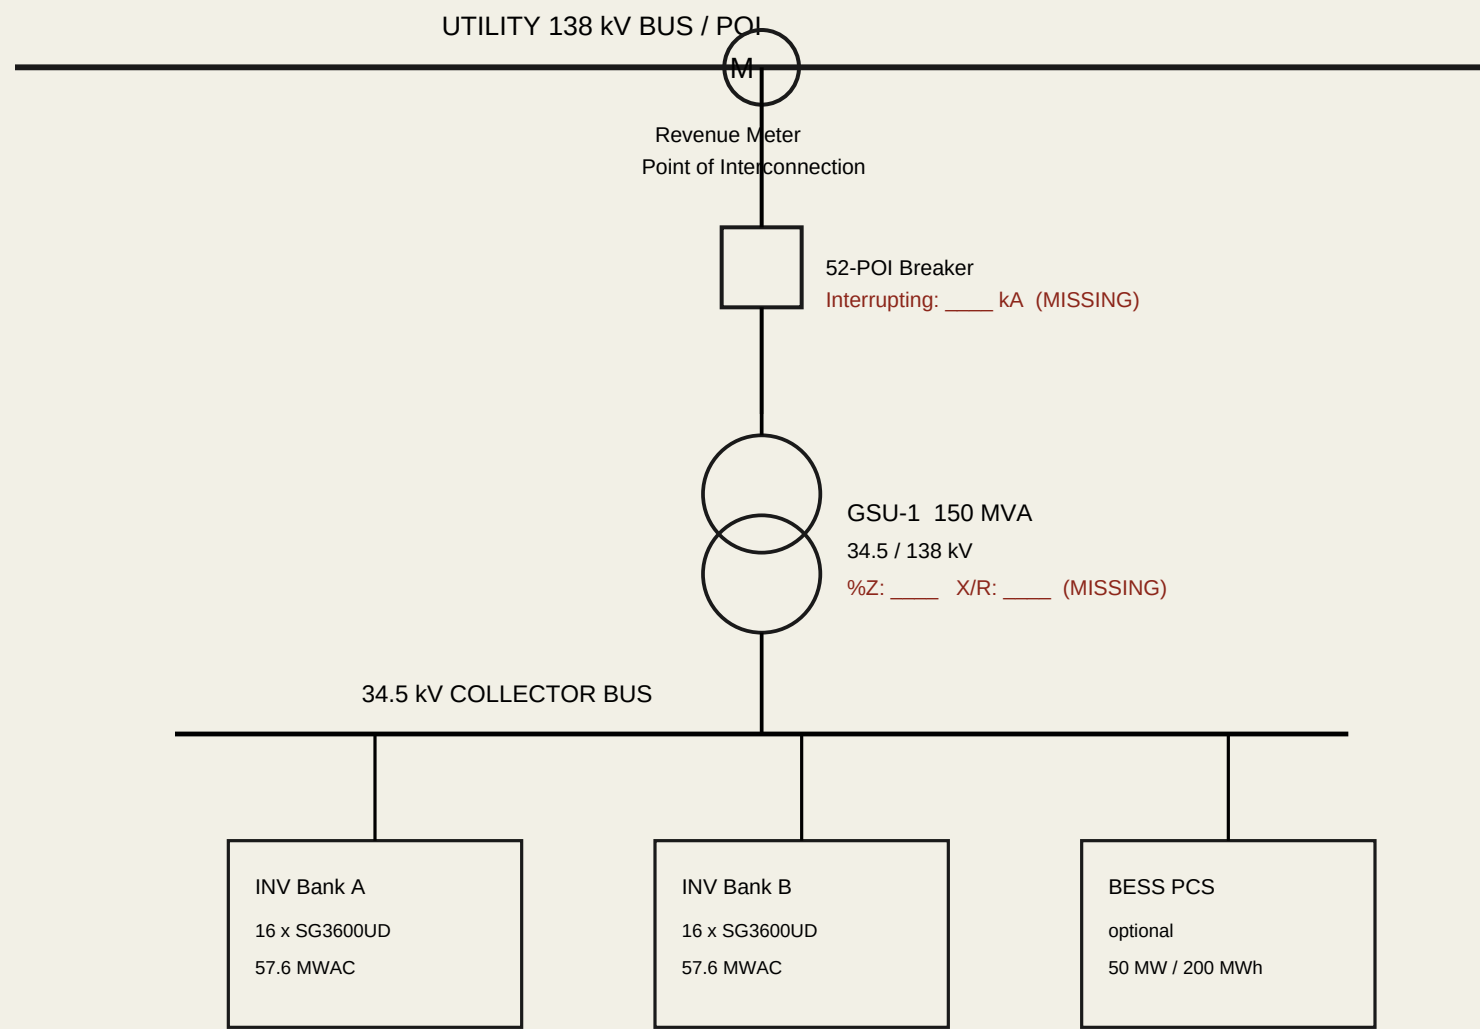

NOTES:

- Ownership demarcation at high-side of 52-POI.
- Inverter LVRT / HVRT setpoints: NOT SHOWN (intentional demo gap).
- SCADA / RTU / ICCP telemetry path: NOT SHOWN (intentional demo gap).
- Grounding transformer: NOT SHOWN (intentional demo gap).
- Standards: (IEEE 1547 citation intentionally omitted).