


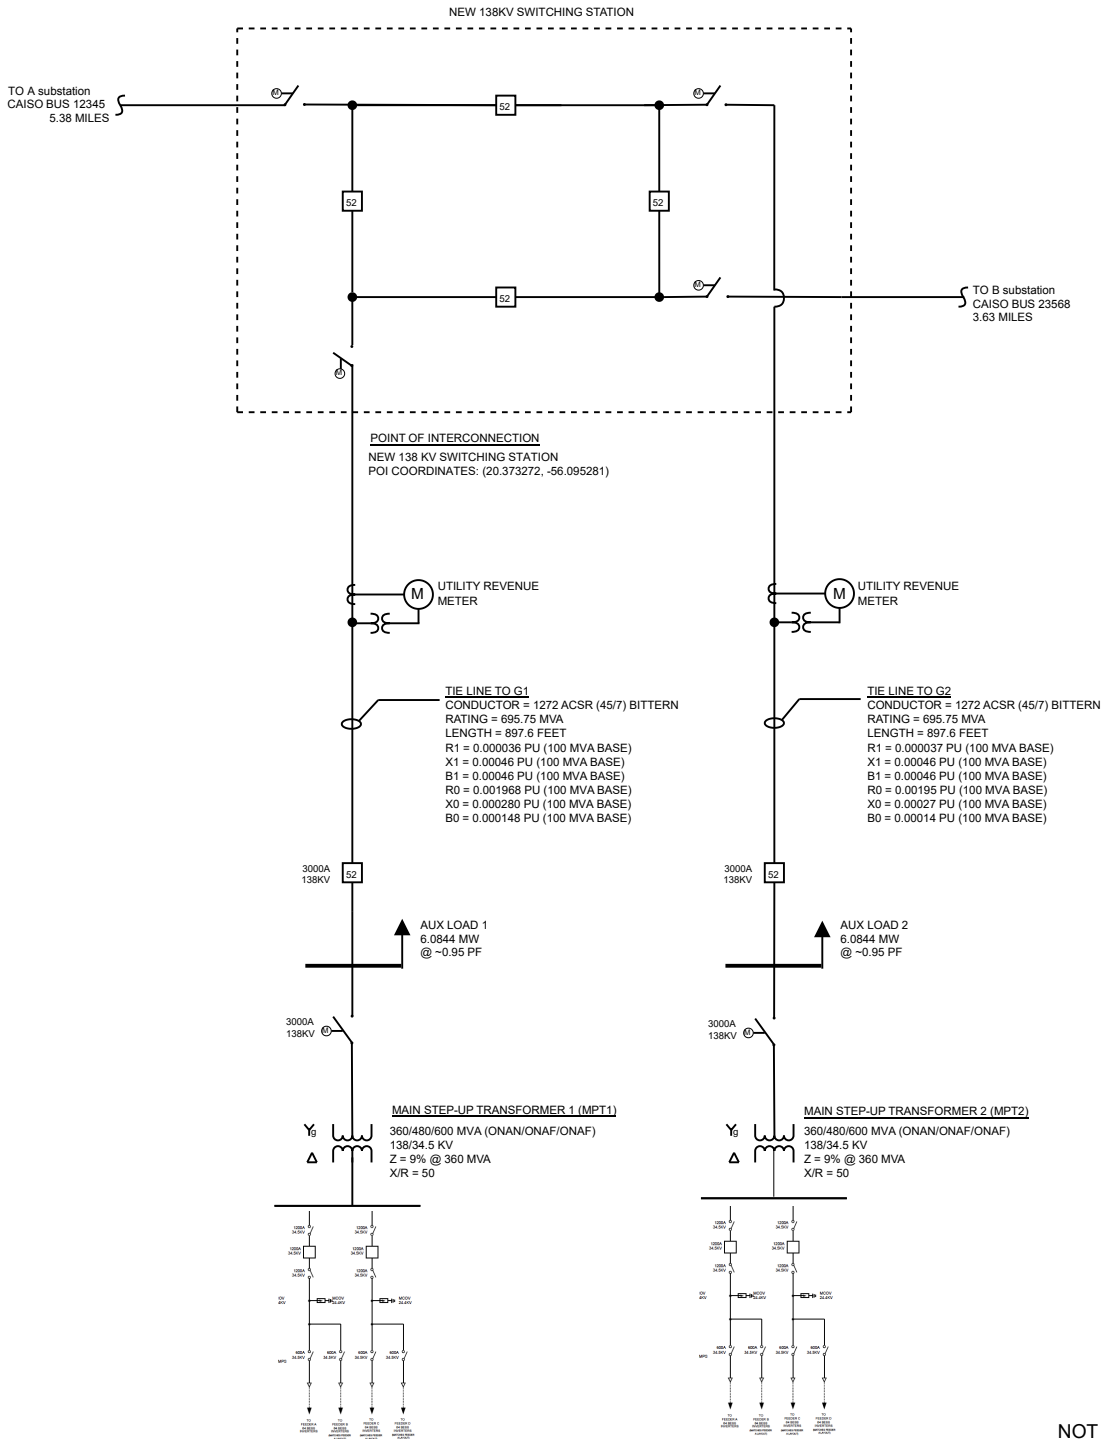

GENERAL NOTES

- 1 MAXIMUM NET FACILITY OUTPUT LIMITED TO 900 MW @ ± 0.95 PF
- 2 FACILITY CAPABLE OF 900 MW @ ± 0.95 PF GRID VOLTAGE AT RANGE OF 0.90 PU TO 1.10 PU
- 3 FACILITY EQUIPMENT SPECIFICATIONS ARE PROVIDED FOR INTERCONNECTION STUDY PURPOSES. ACTUAL EQUIPMENT SPECIFICATIONS ARE SUBJECT TO CHANGE BASED ON ENGINEERING AND PROCUREMENT CONSTRAINTS.

SYMBOLS AND LEGEND

	TRANSFORMER		ABOVE GROUND
	POTENTIAL TRANSFORMER, PT		UNDERGROUND CABLE
	CURRENT TRANSFORMER, CT		UNDERGROUND CABLE TERMINATION
	REVENUE METER		SIMPLE CYCLE NATURAL GAS TURBINE
	AC CIRCUIT BREAKER		GROUND
	SWITCH		
	FUSED SWITCH		

Add Engineering firm logo

Rev	Issued For	Date Issued
0	CAISO Interconnection Request	12/12/2024

Project Name
Town Name, TX (20.373439, -56.094008)

Drawing Title
CONCEPTUAL ELECTRICAL SINGLE-LINE DIAGRAM
Drawing by: Engineer Name

Revision	Page
0	1

NOT FOR CONSTRUCTION: FOR INTERCONNECTION APPLICATION ONLY