



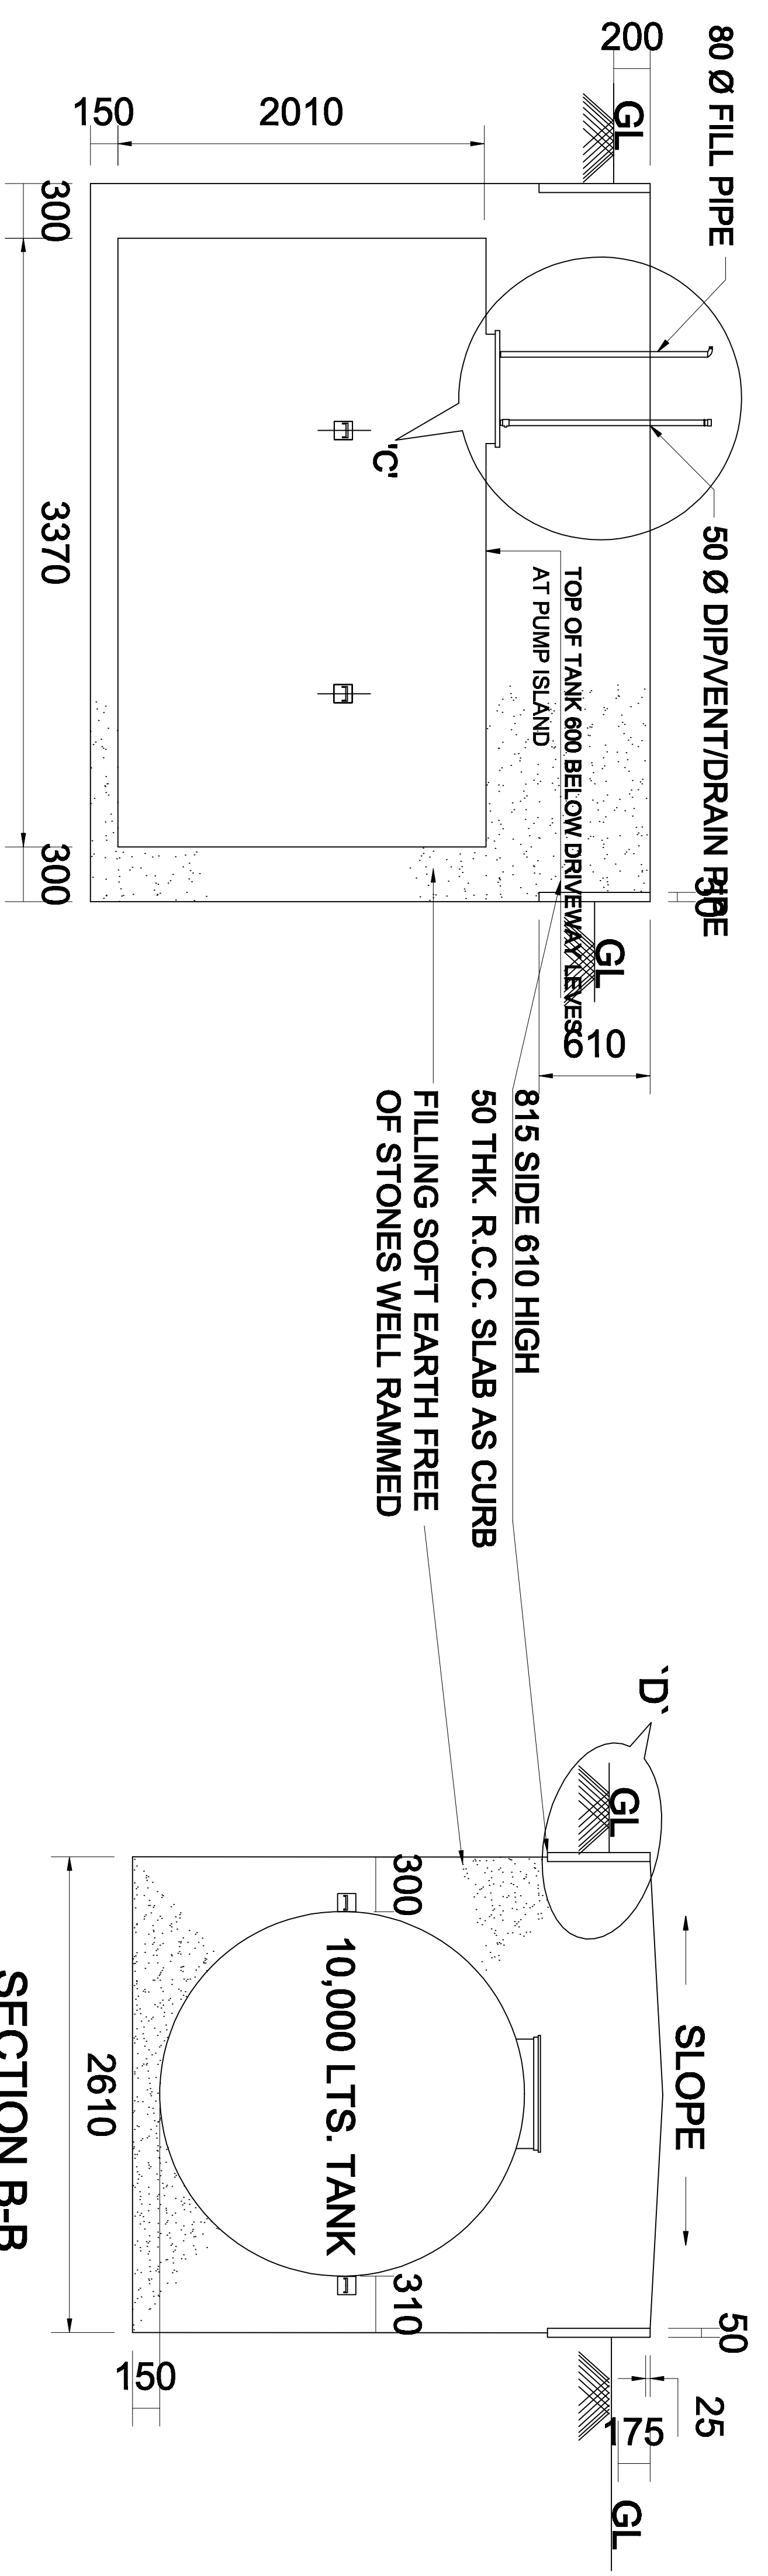


SECTION A-A

SECTION B-B

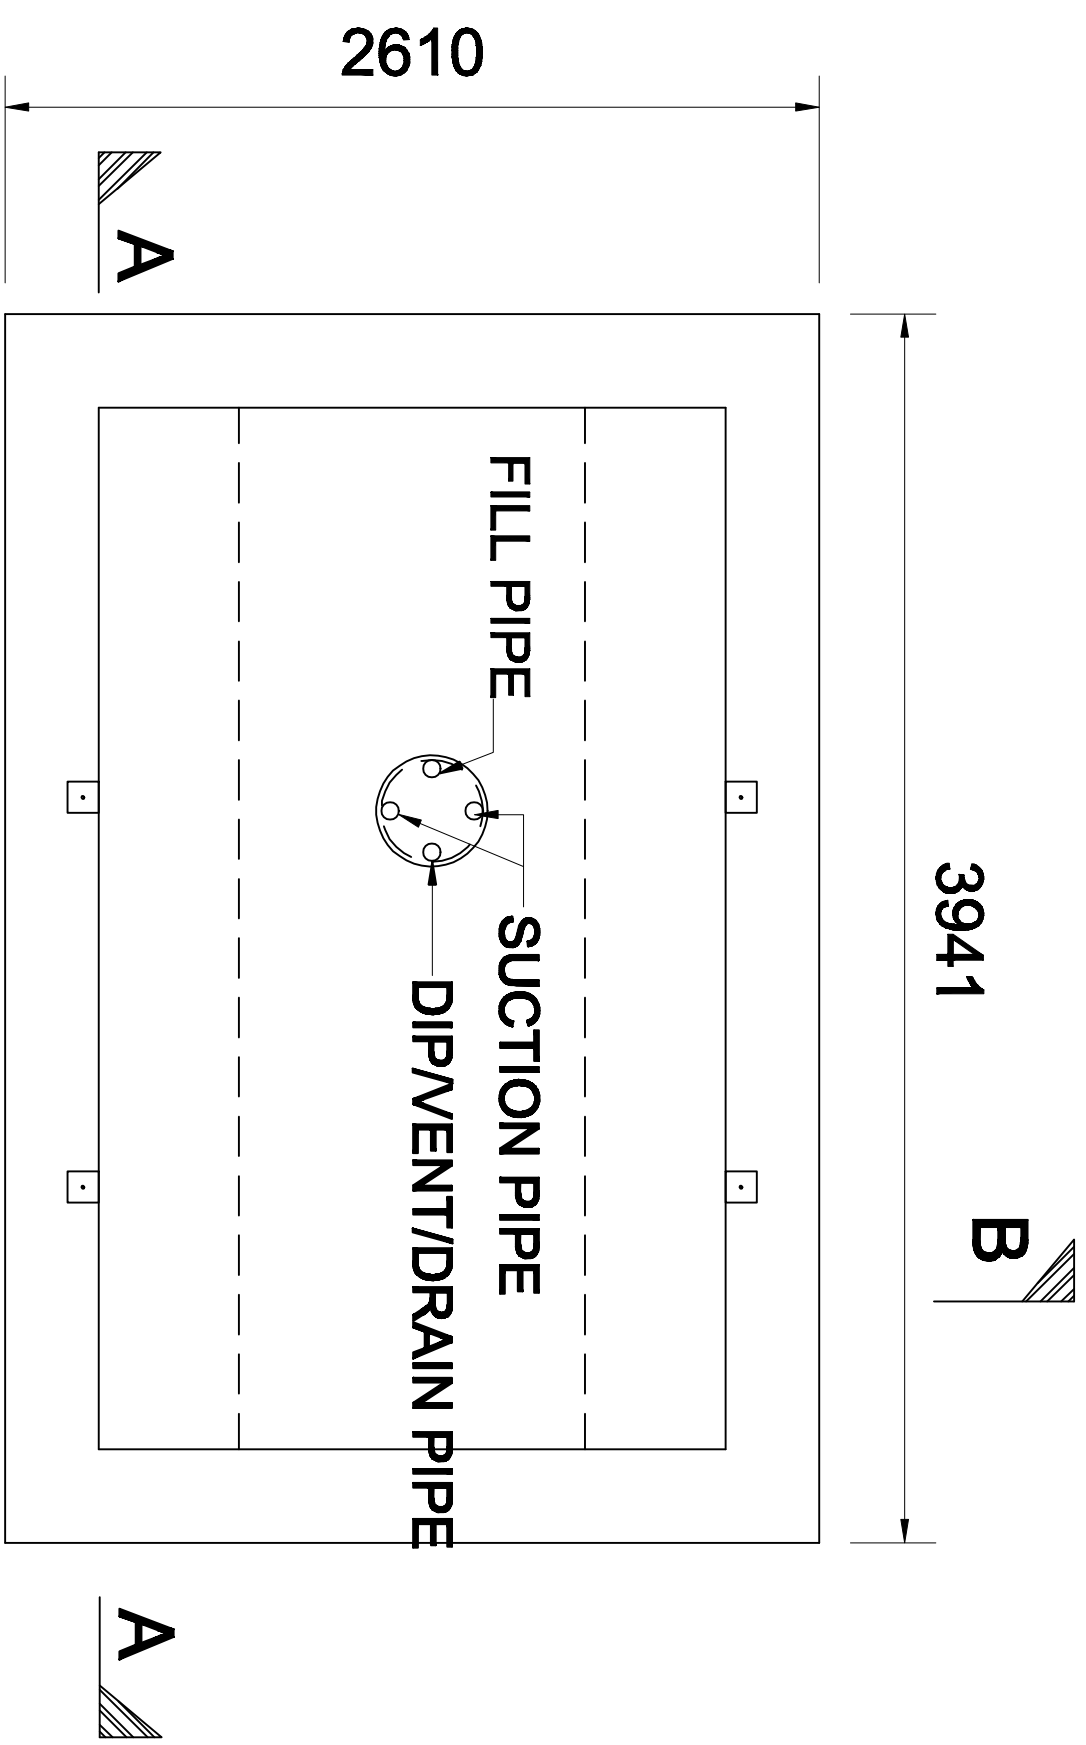

PLAN

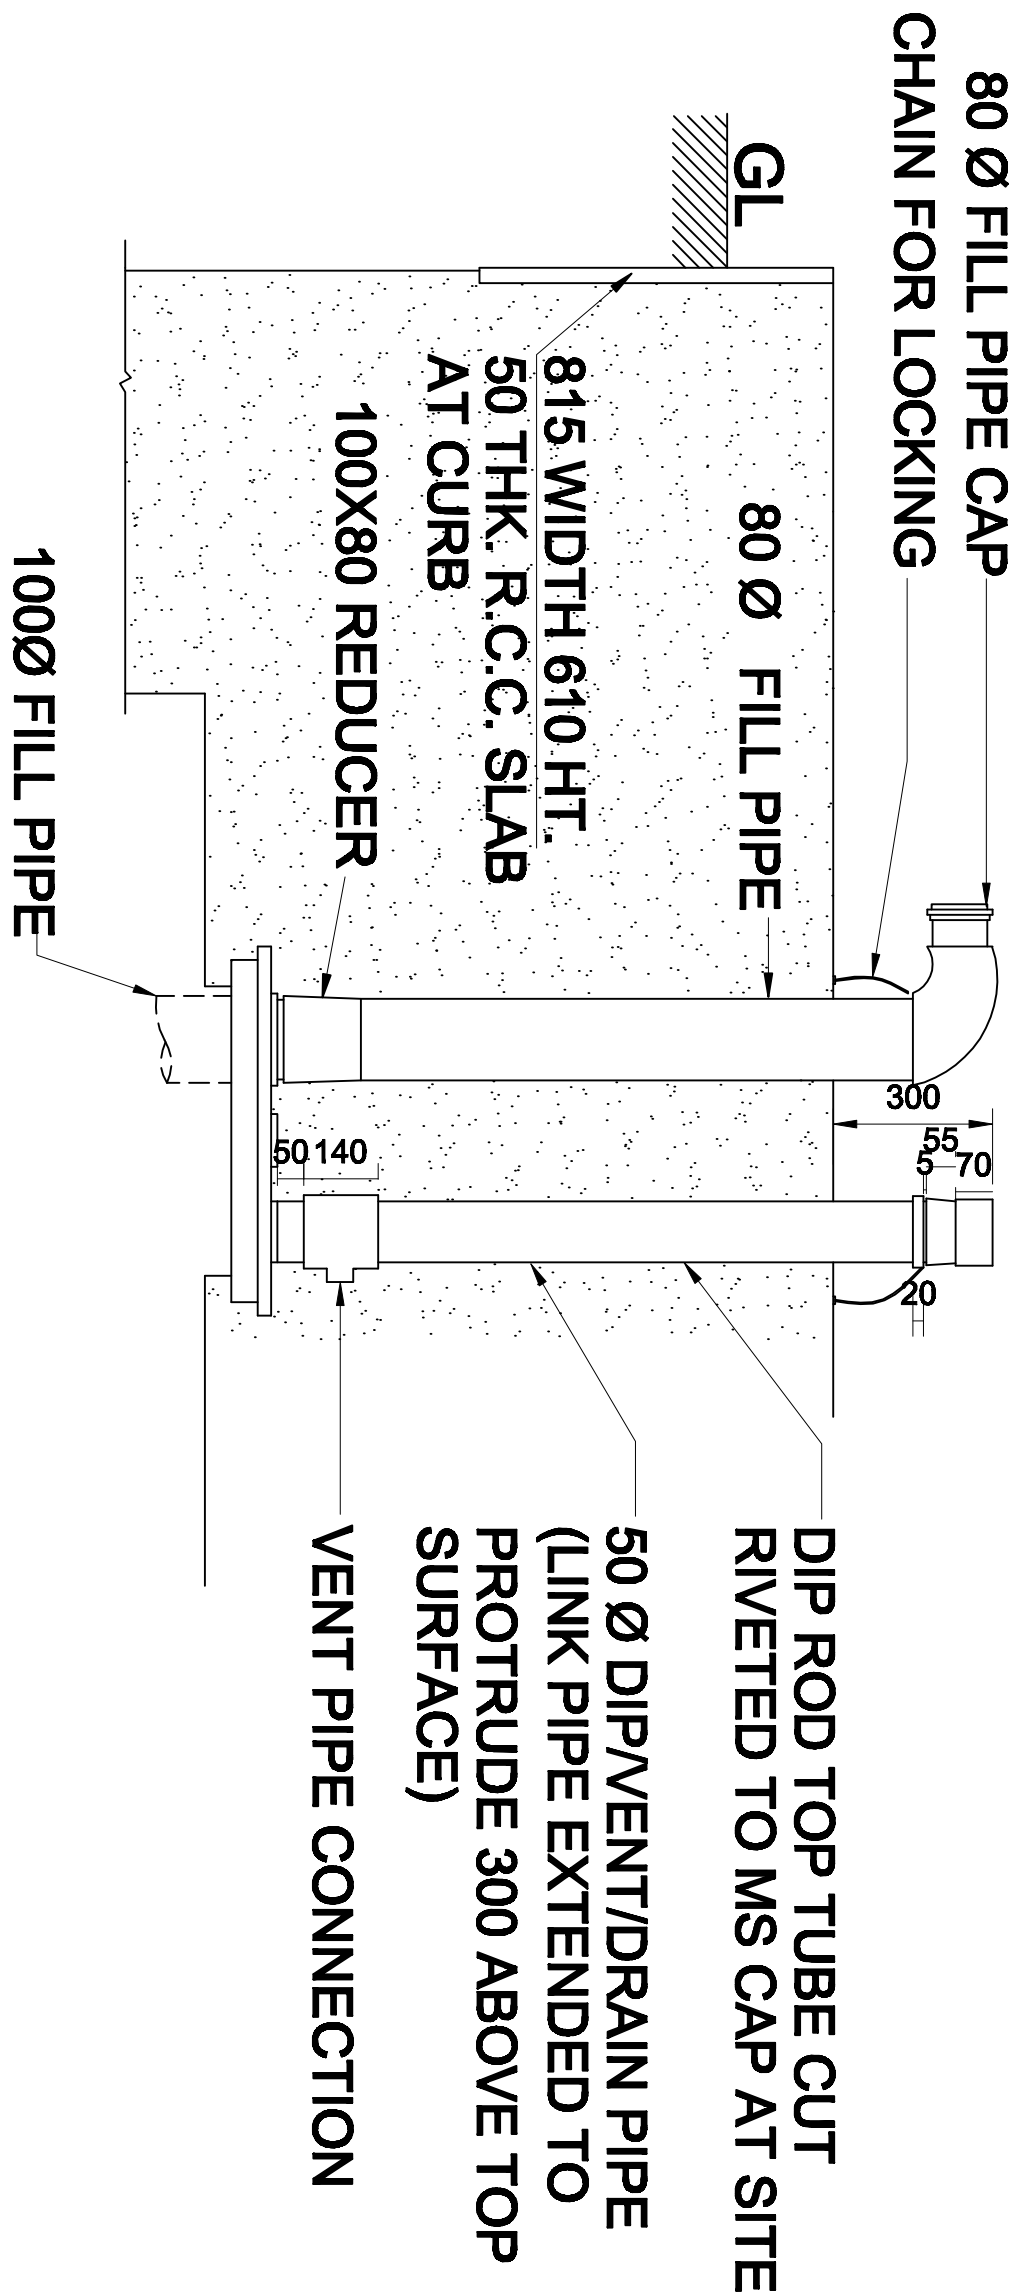

NOTES:-

DETAILS AT 'C'

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG INSTEAD OF STANDARD 2350

Bharat Petroleum भारत पेट्रोलियम कार्पोरेशन लिमिटेड Bharat Petroleum Corporation Limited		DATE		DRAWING NO.
TITLE:- INSTALLATION DETAILS OF 10,000 LITERS CYLINDRICAL UNDERGROUND TANK IN EARTH PIT		NUMBERS CROSSED OUT ARE SUPERSEDED DRAWING.		DRAWING NO. E.IS.01.019

10 KL TANK IN EARTH PIT