




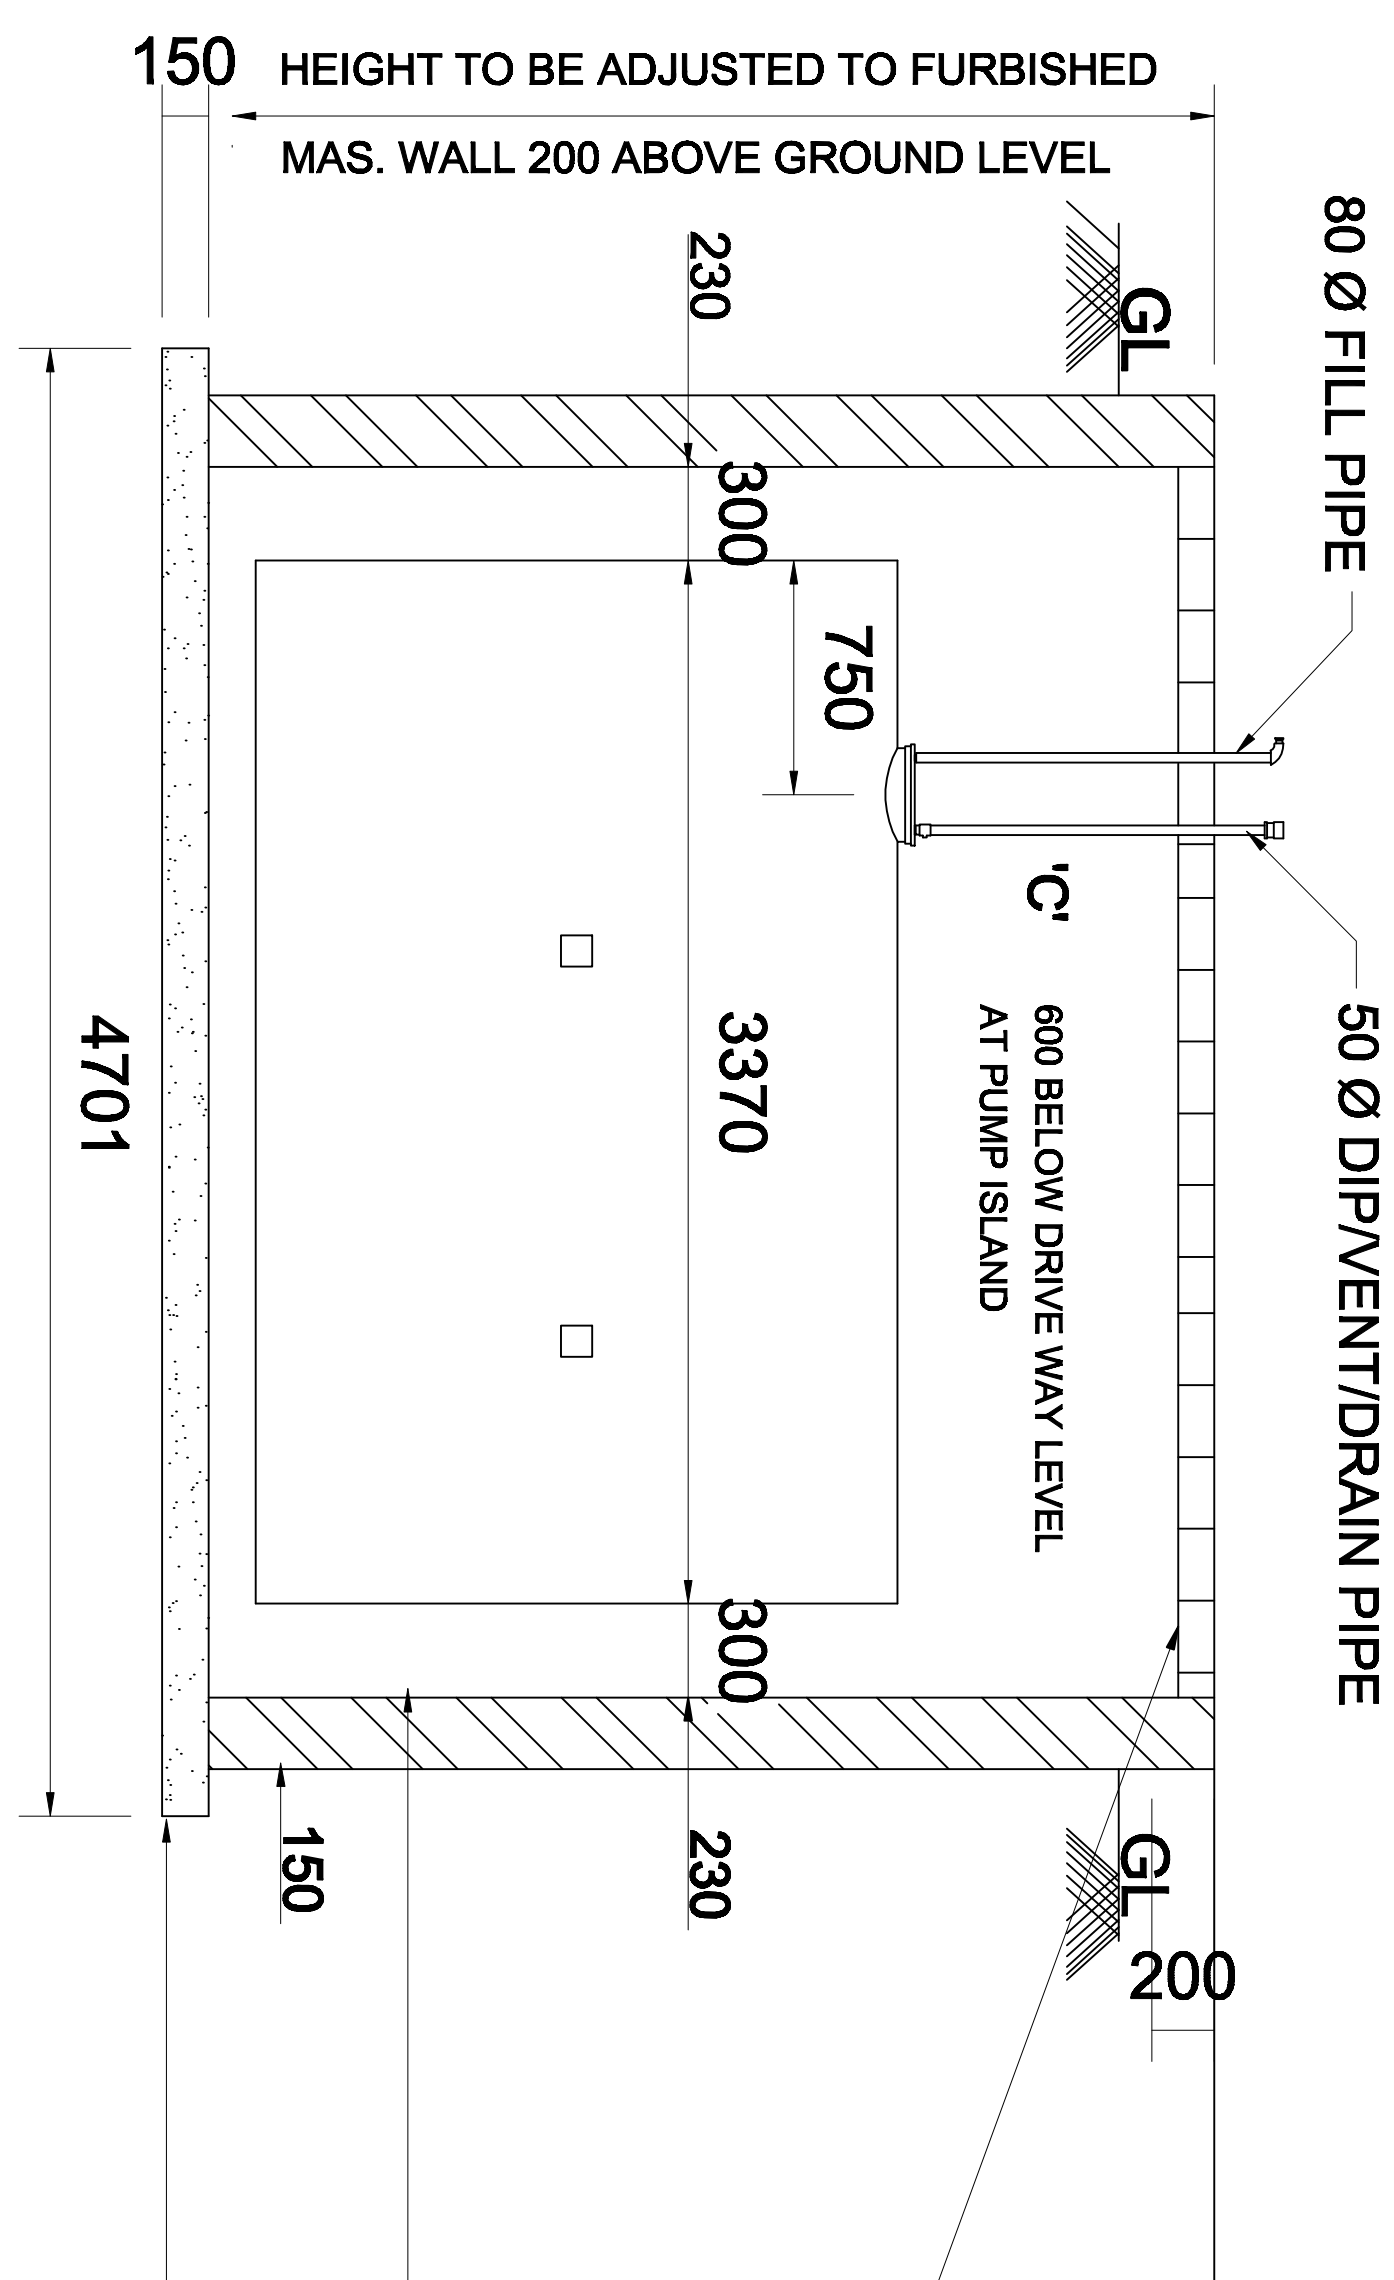

SECTION A-A

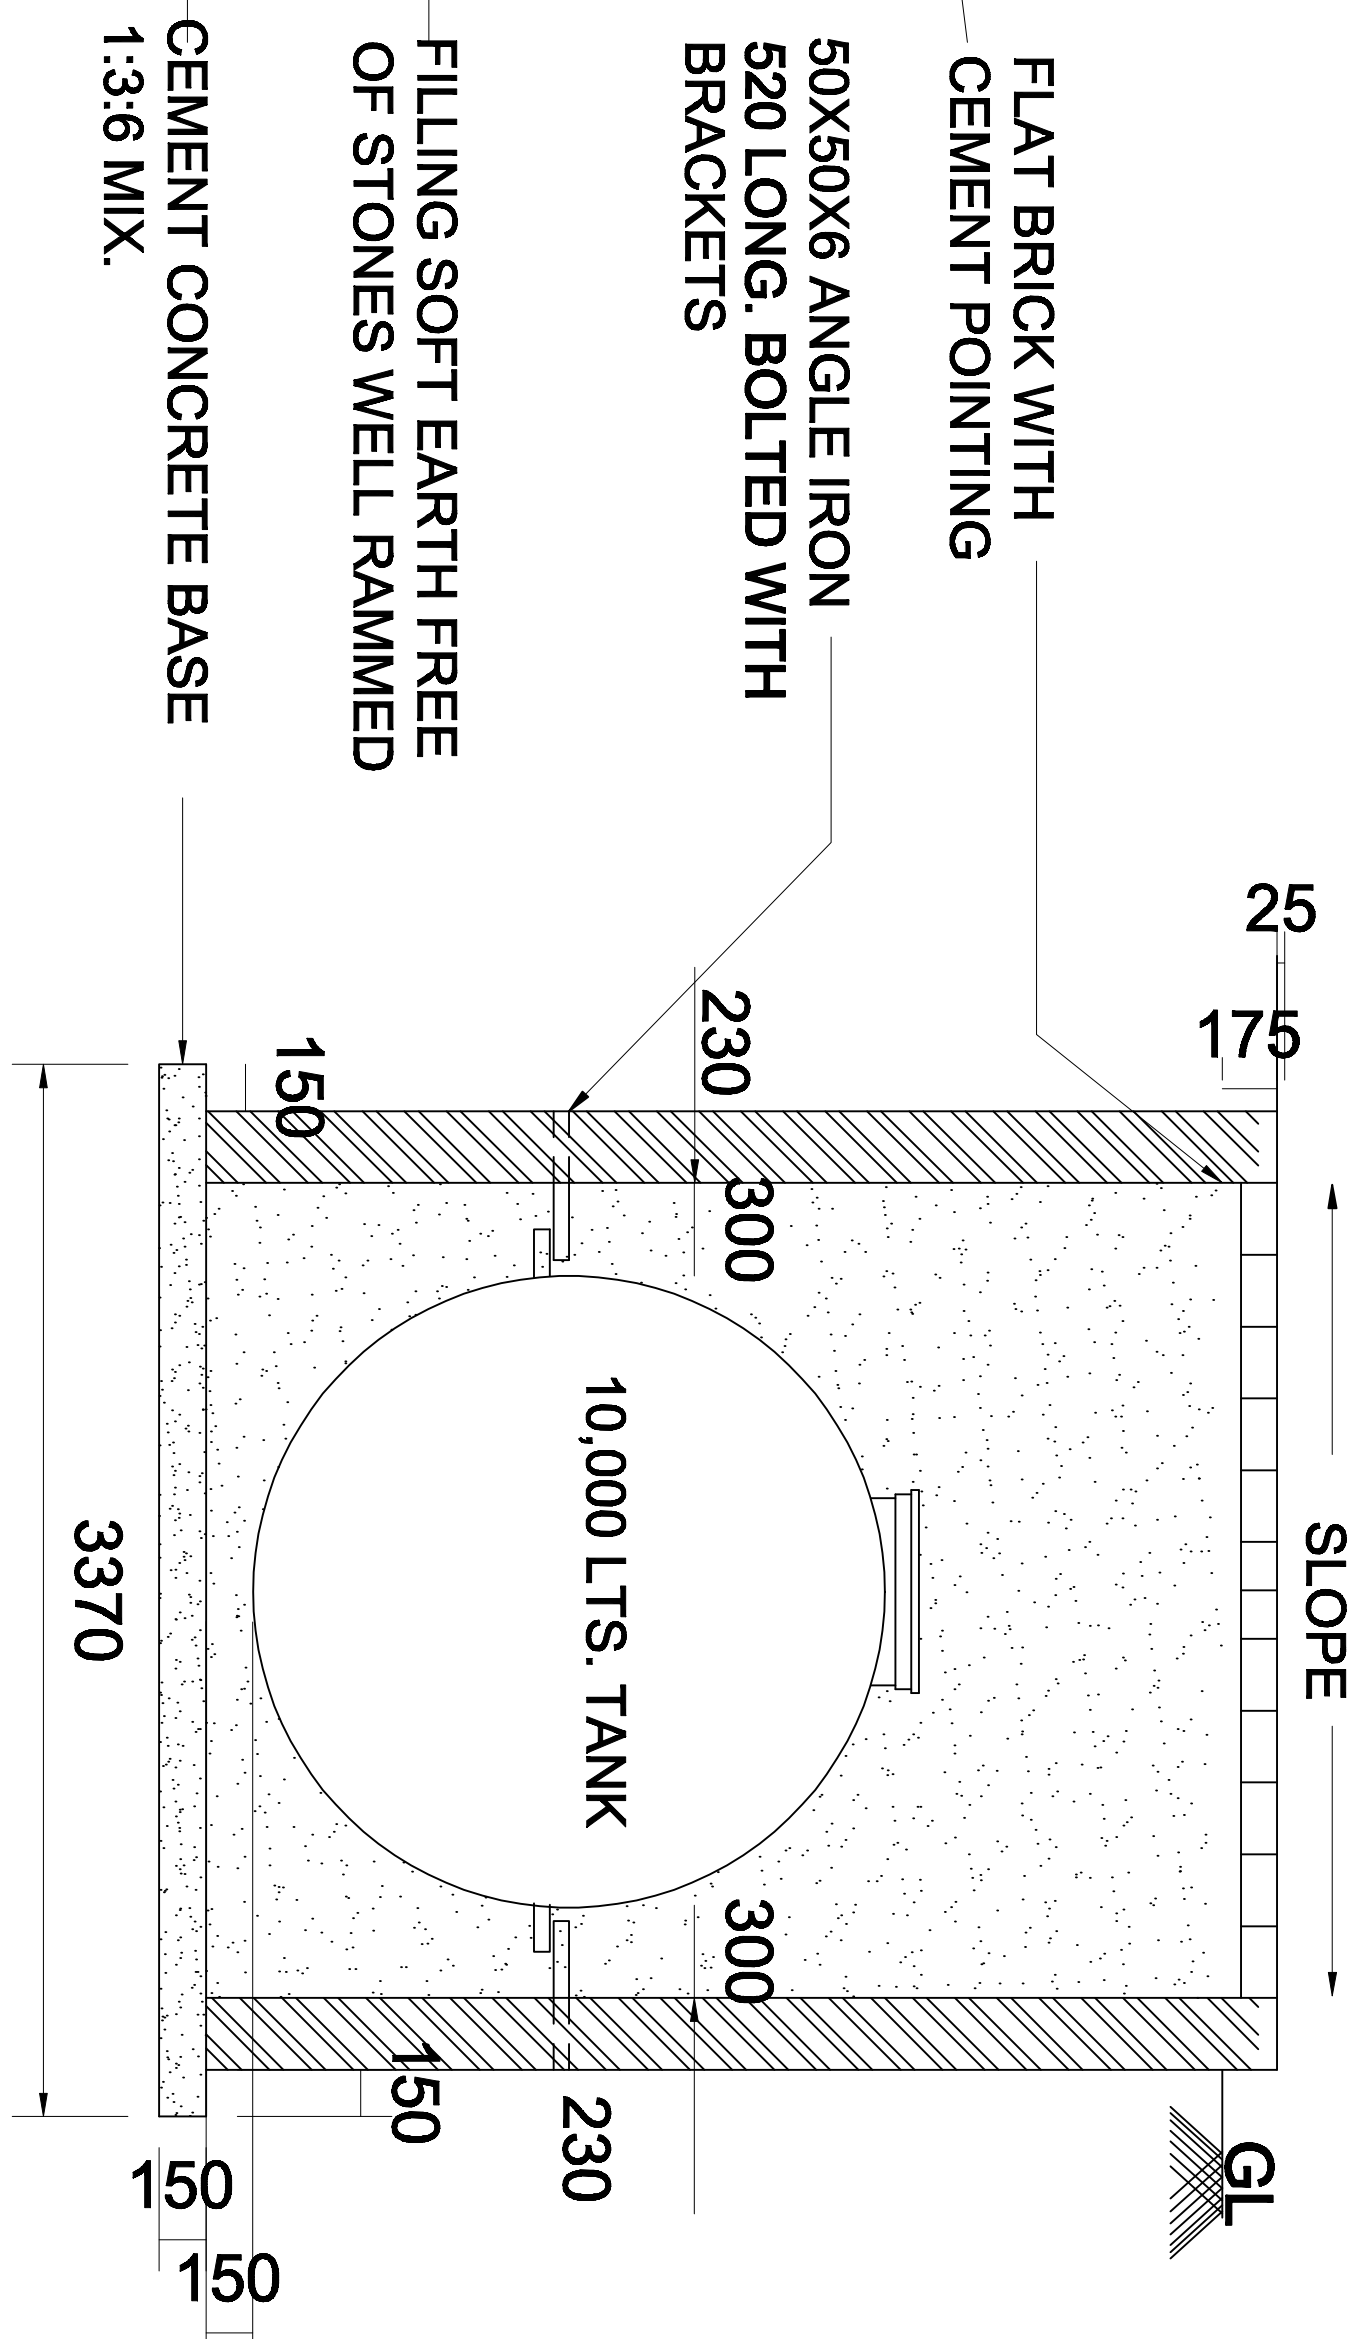


SECTION B-B

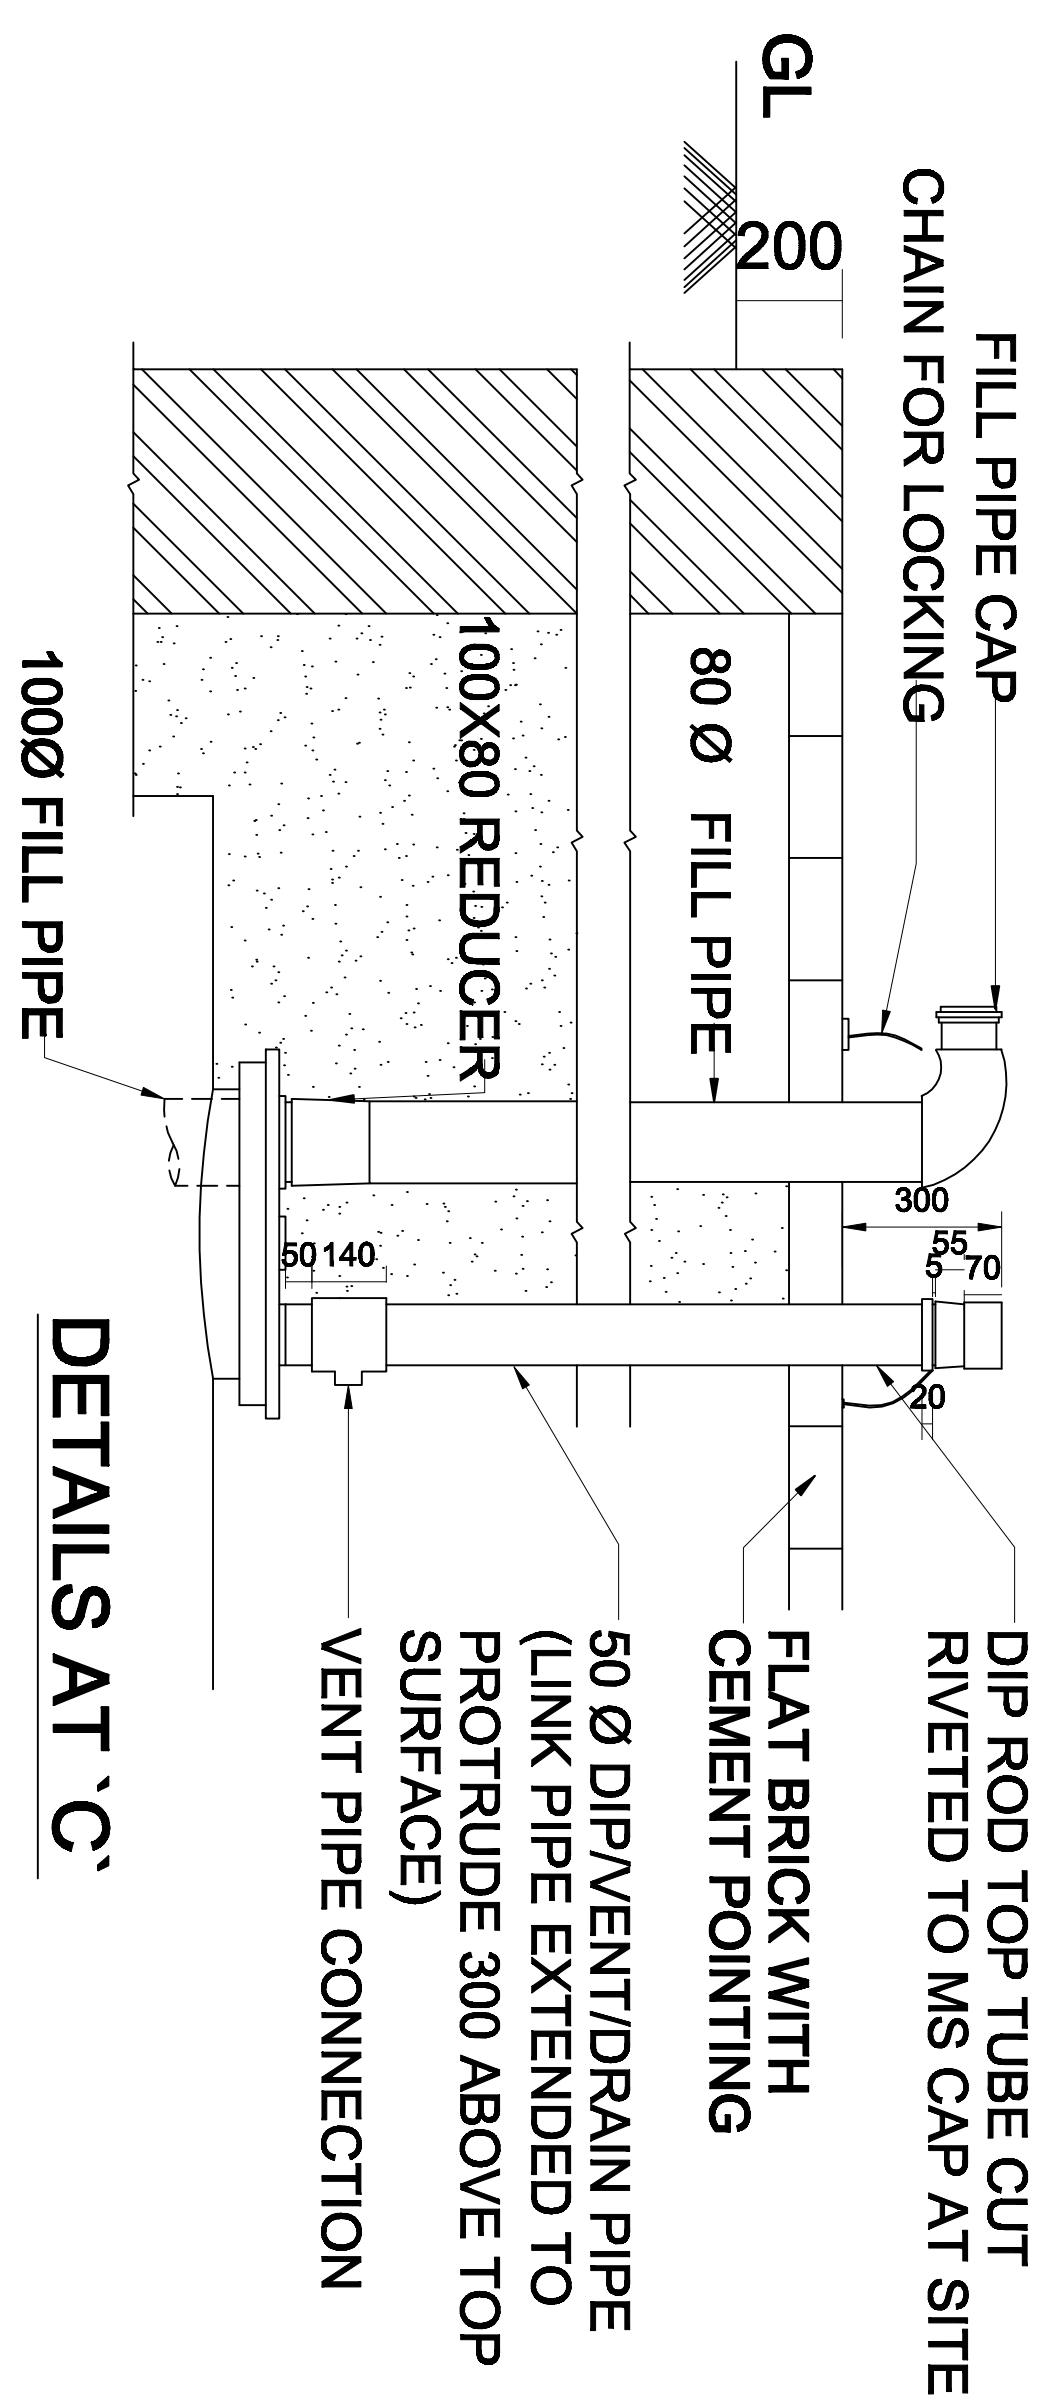

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG
- 3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMALTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL

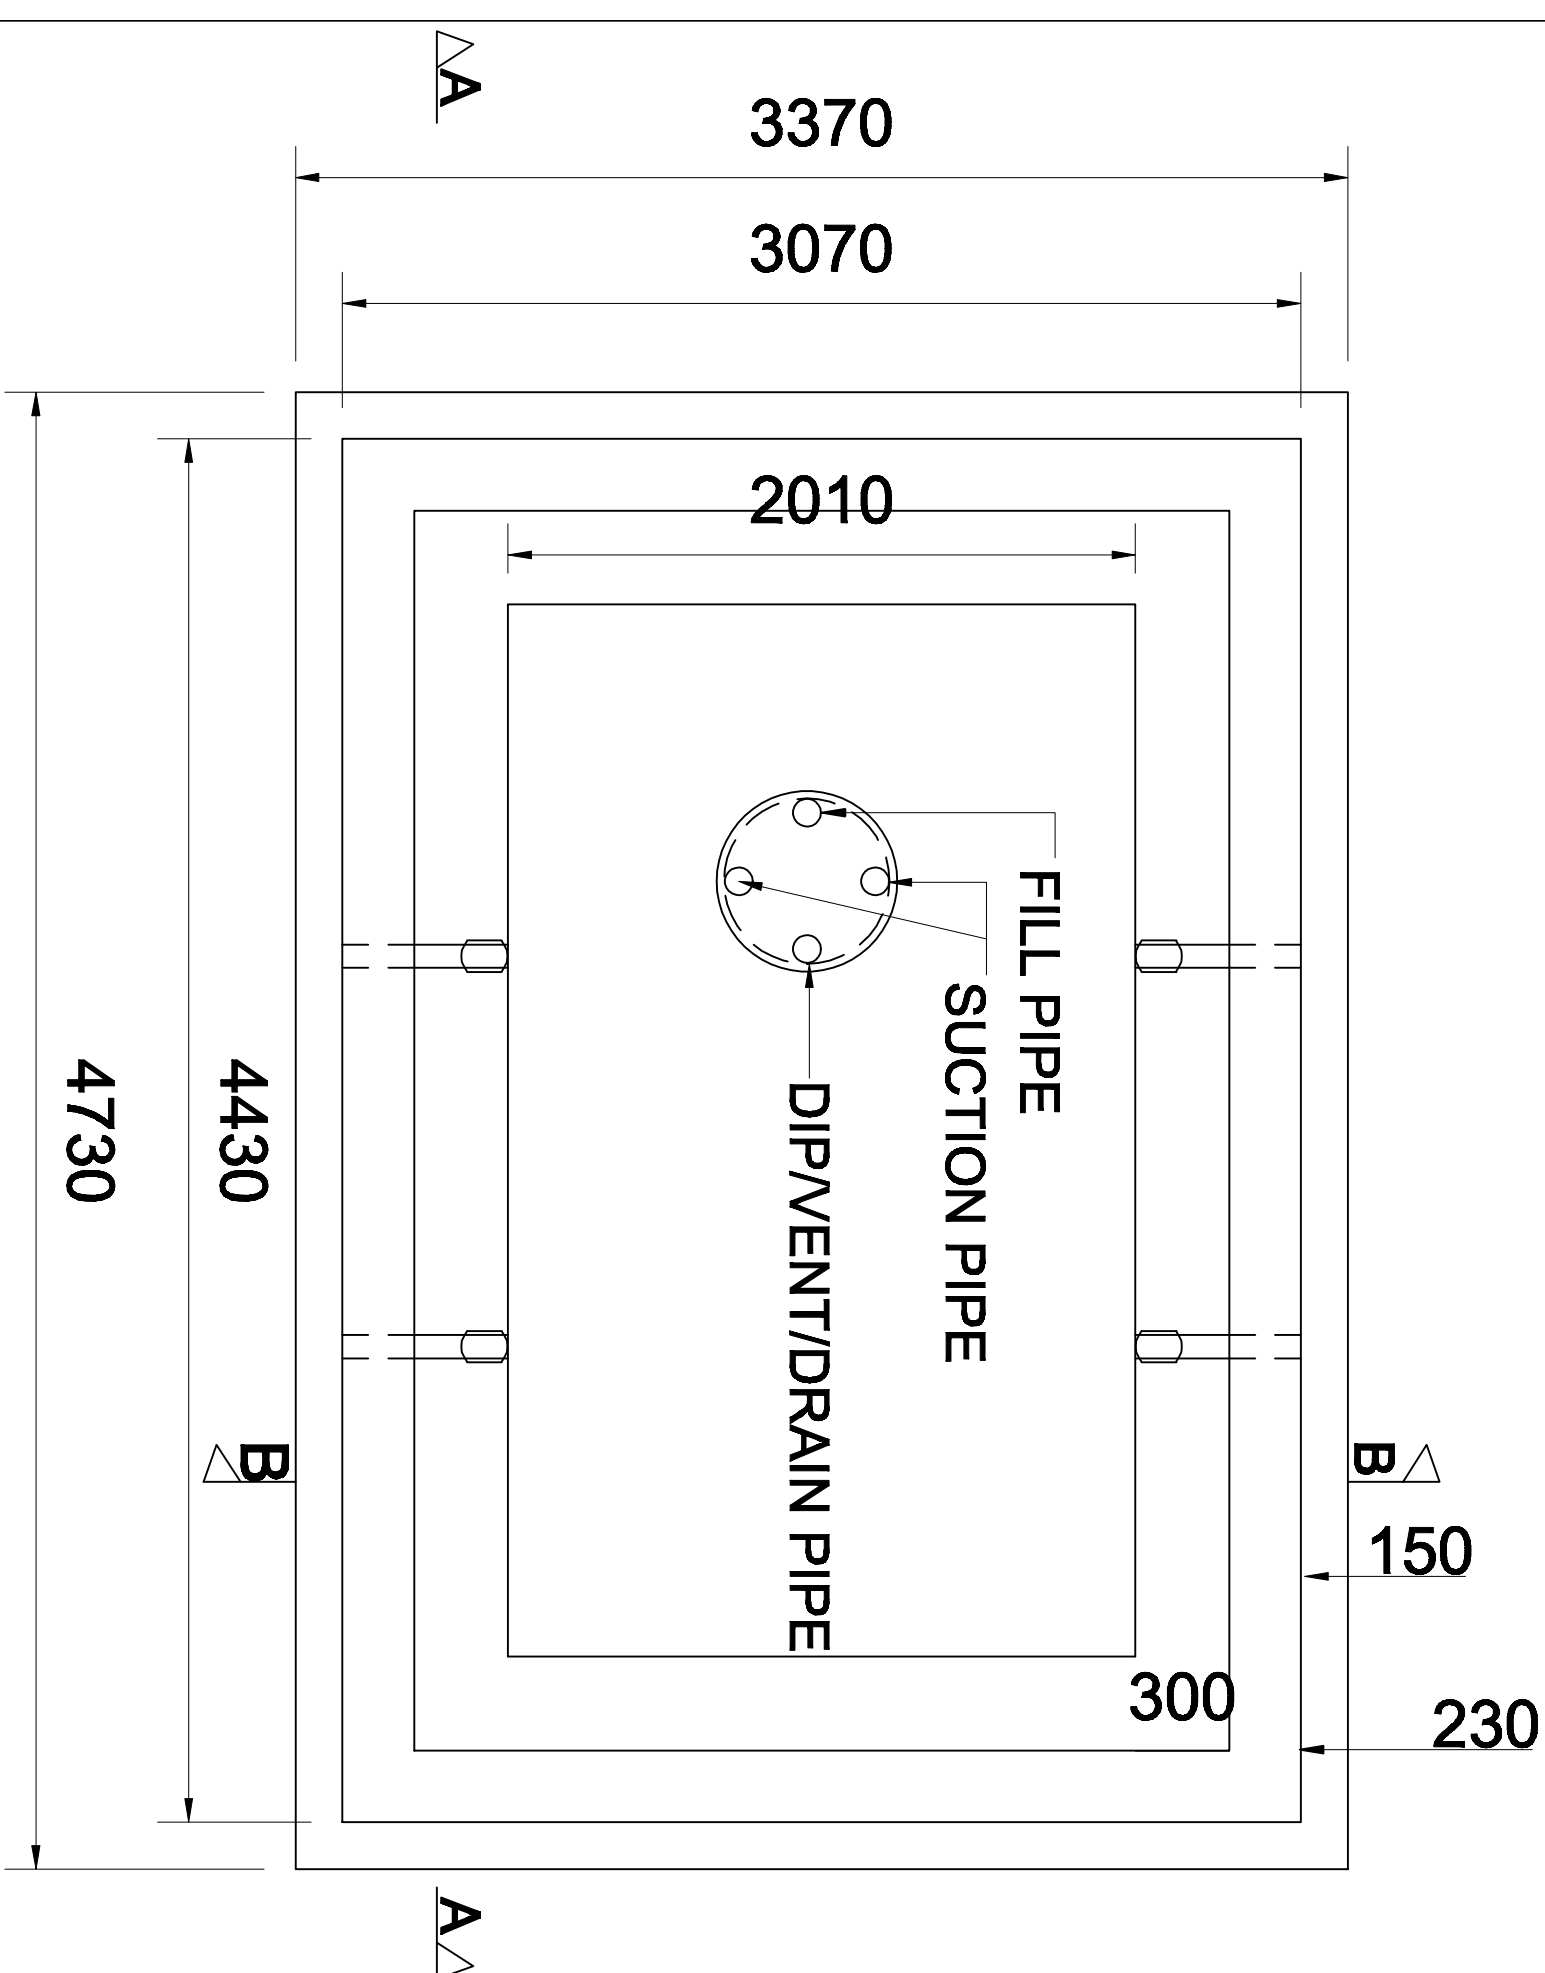

PLAN

10 KL TANK IN MASONRY PIT

 भारत पेट्रोलियम कार्पोरेशन लिमिटेड Bharat Petroleum Corporation Limited			
TITLE:- INSTALLATION DETAILS OF 10,000 LITERS CYLINDRICAL UNDERGROUND TANK IN MASONRY PIT		DATE	DRAWING NO.
		NUMBERS CROSSED OUT ARE SUPERSEDED DRAWING.	
		DRAWING NO.	E.IS.01.019