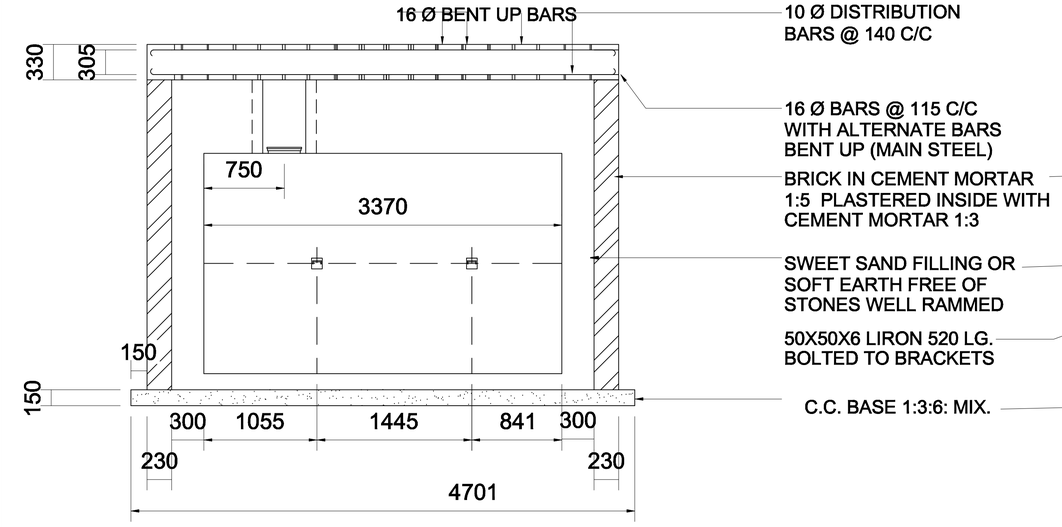

SECTION A-A

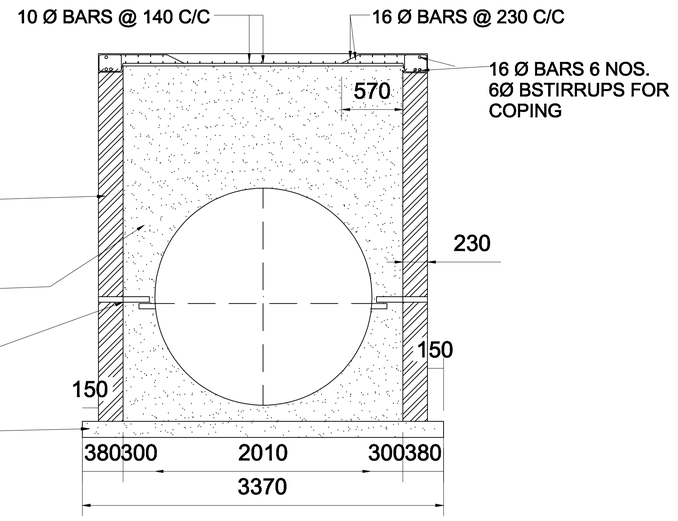

SECTION B-B



CROSS SECTION OF R.C.C. SLAB

BAR `a`



BAR `b`

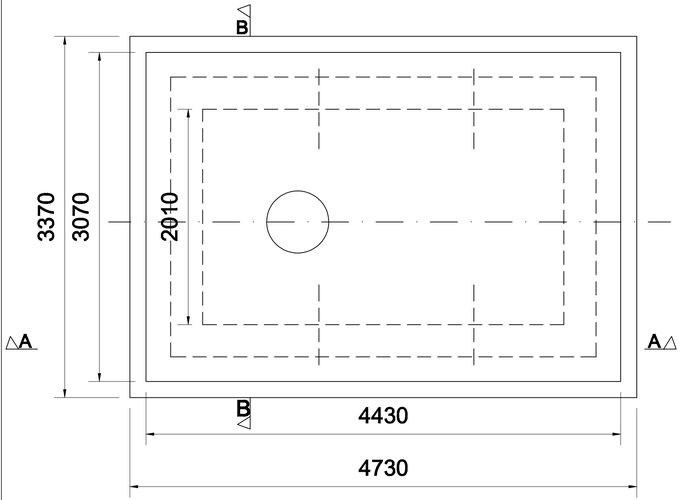

PLAN

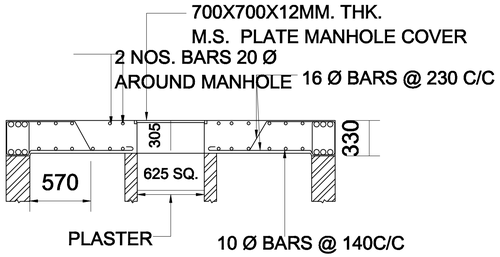

CROSS SECTION THROUGH MANHOLE



BAR `c'  BAR `c'

NOTES:-

1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.

2) C.C. BASE MAY BE ELUMINATED WHERE THE SOIL MET WITH, IS HARD NON YELDING LAYER, IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.

10 KL TANK IN MASONRY PIT WITH R.C.C. SLAB ON TOP

भारत पेट्रोलियम कार्पोरेशन लिमिटेड
Bharat Petroleum Corporation Limited

TITLE-: INSTALLATION DETAILS OF 10,000 LITERS CYLINDRICAL UNDERGROUND TANK IN MASONRY PIT WITH R.C.C. ON TOP

DATE | DRAWING NO.

NUMBERS CROSSED OUT ARE SUPERSEDED DRAWING.

DRAWING NO.
E.IS.01.019