

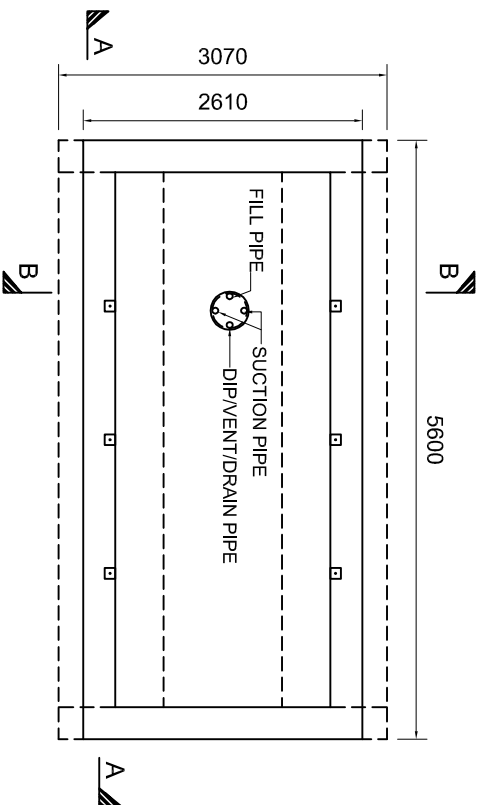
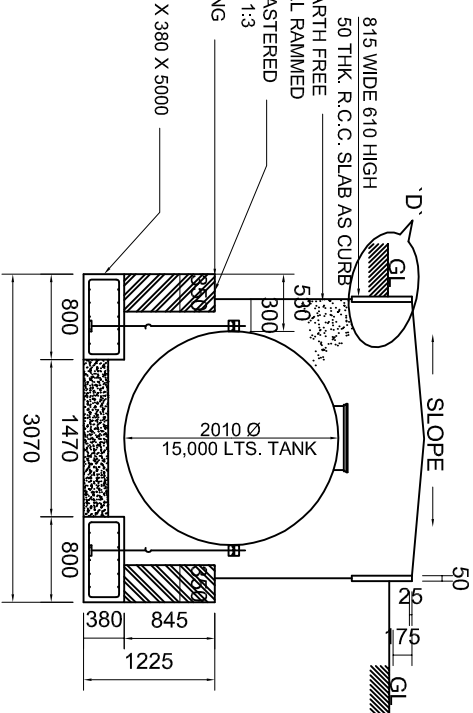


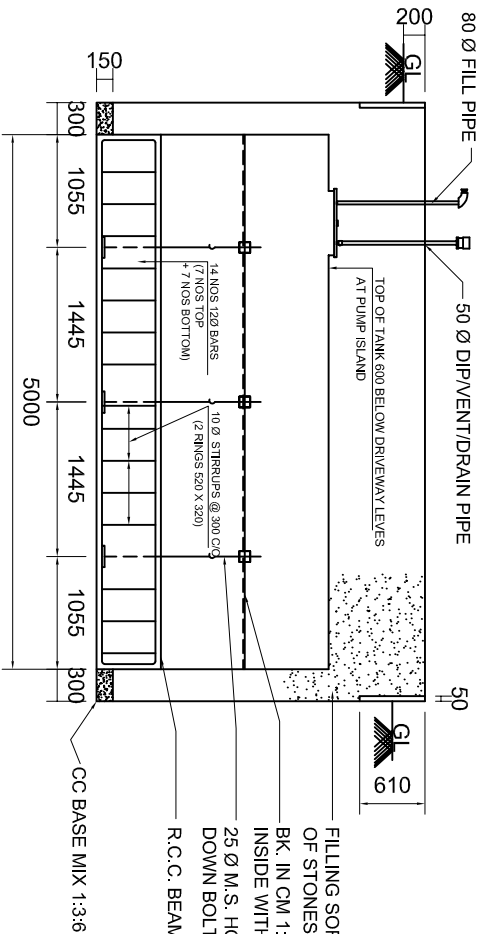

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FO THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG. INSTEAD OF STANDARD 2350
- 3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMALTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL AND RCC CURB
- 4) RCC BEAM SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

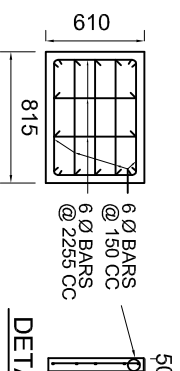

DETAIL 'D'
R.C.C. SLAB 1:2:4
AS CURB

TANK INEARTH PIT WITH HOLDING DOWN ARRANGEMEANT

BHARAT PETROLEUM CORPORATION LTD.							
TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK				DATE		DRAWING NO.	
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS			
SCALE :-	DRAWN:	CHECKED	SHEET NO.				
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1				
				DRAWING NO. RE.DRG. 401			