




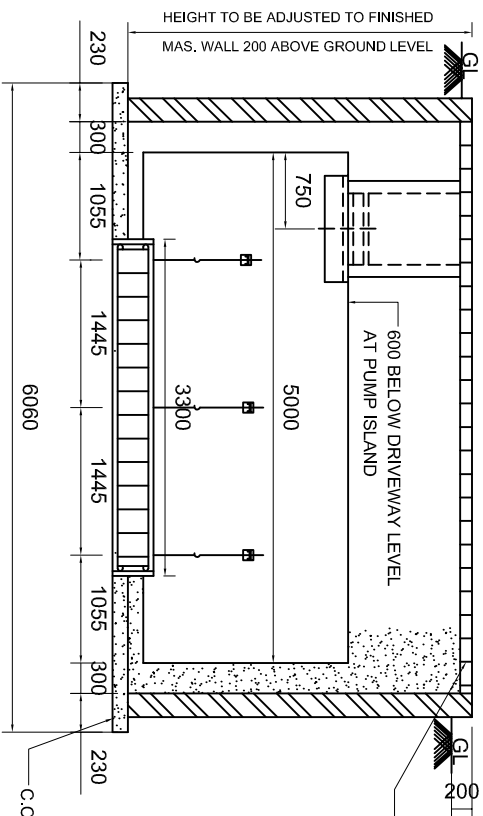

SECTION A-A

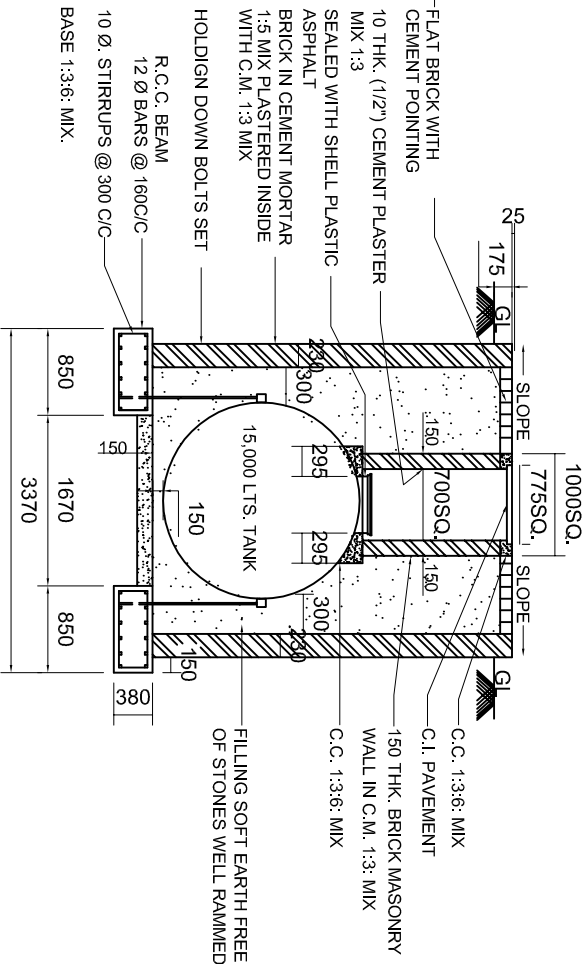

SECTION B-B

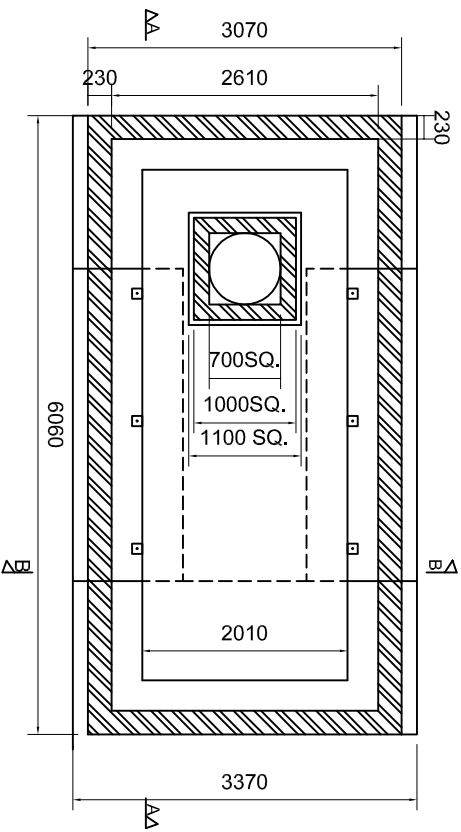

PLAN

TANK IN MASONRY PIT WITH HOLDING DOWN ARRANGEMENT

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMALTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL
- 3) R.C.C. BEAMS SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK				DATE	DRAWING NO.
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
				DRAWING NO. RE.DRG. 401	
SCALE :-	DRAWN:	CHECKED	SHEET NO. 1 OF 1		
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)				