



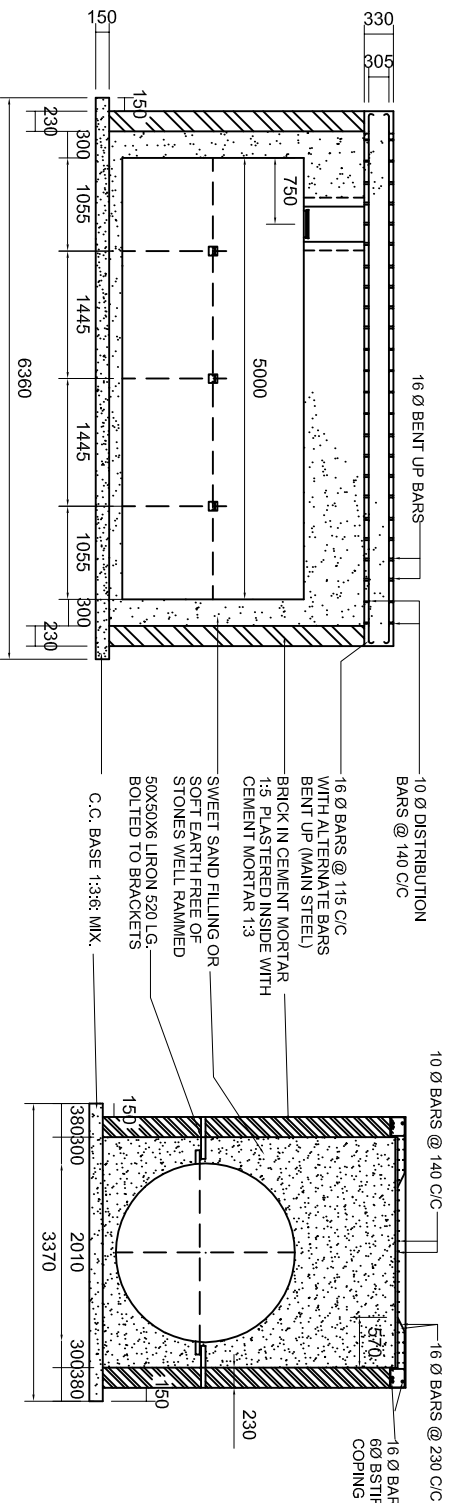


SECTION A-A

SECTION B-B




CROSS SECTION OF R.C.C. SLAB




BAR 'a'



BAR 'b'

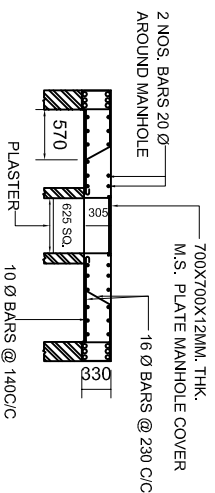

CROSS SECTION THROUGH MANHOLE




BAR 'c'

BAR 'c'

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH, IS HARD NON YELDING LAYER, IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.

PLAN

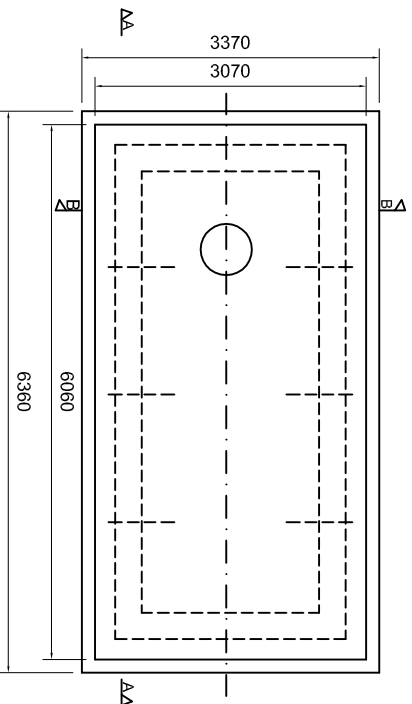

TANK IN MASONRY PIT WITH
R.C.C. SLAB ON TOP

BHARAT PETROLEUM CORPORATION LTD.

TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK			DATE: DRAWING NO.	
SCALE :-			NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
DRAWN: Sr. Mgr. (DESIGN & DEVP.)			DRAWING NO.	
CHECKED			RE.DRG. 401	
DATE : 20/12/1999			1 OF 1	