

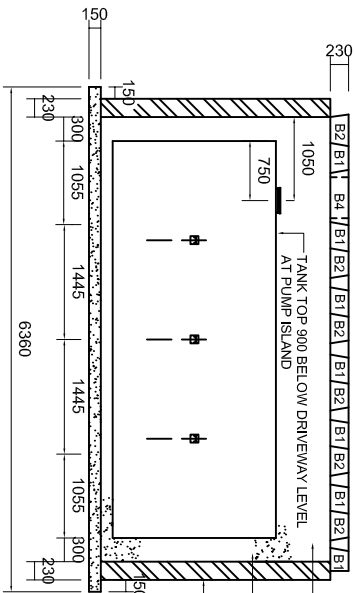





B3-230X300X7070
2 NOS. R.C.C. BEAM
FILLING SOFT EARTH FREE
OF STONES WELL RAMMED
BRICK IN C.M. 1:5 PLASTERED
INSIDE WITH C.M. 1:3
50X50X6 ANGLE IRON
520 LONG, BOLTED TO
BRACKETS

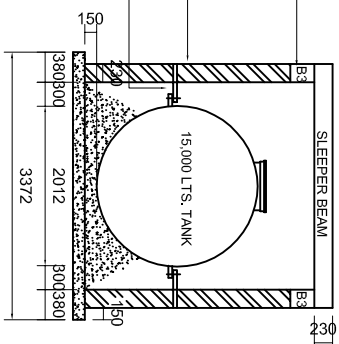


SECTION A-A

SECTION B-B



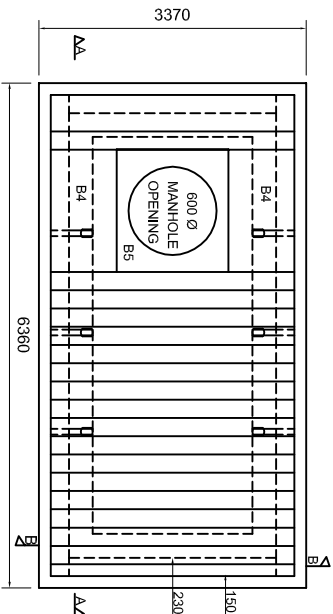


PLAN

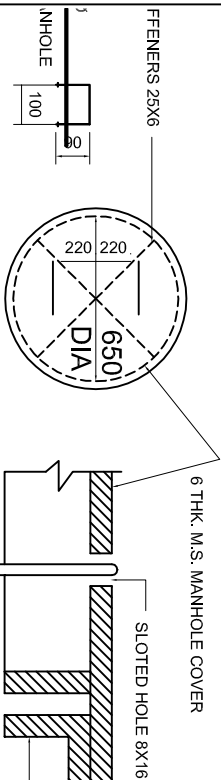

DETAILS OF MANHOLE COVER

TANK IN MASONRY PIT WITH
R.C.C. SLEEPER SLAB ON TOP

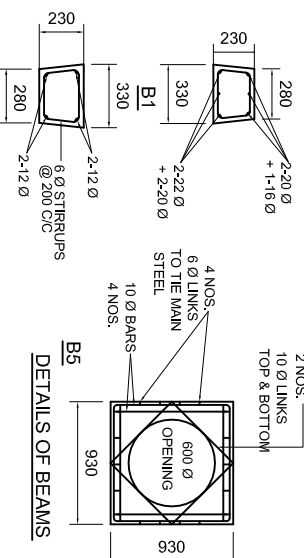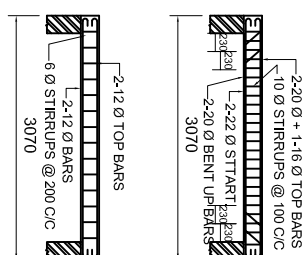

DETAILS OF BEAMS

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH IS HARD NON YELDING LAYER, IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.
- 3) BEAMS B1, B2, B4, & B5 MAY BE CAST IN SITU. BEAM B1 SHOULD BE CAST FIRST & AFTER CURING, PAPER SEPARATOR SHOULD BE GLUED TO THE FACES ADJOINING. BEAMS B2, B4, & B5 BEFORE THESE BEAMS ARE CAST.

BHARAT PETROLEUM CORPORATION LTD.

TITLE: INSTALLATION DETAILS OF 15,000 LITRES
CYLINDRICAL UNDERGROUND TANK

SCALE :- DRAWN: S. Mgr. (DESIGN & DEVP.)

CHECKED

SHEET NO. 1 OF 1

DATE DRAWING NO.

NUMBERS CROSSED OUT ARE
SUPERSEDED DRAWINGS

DRAWING NO.

RE.DRG. 401