




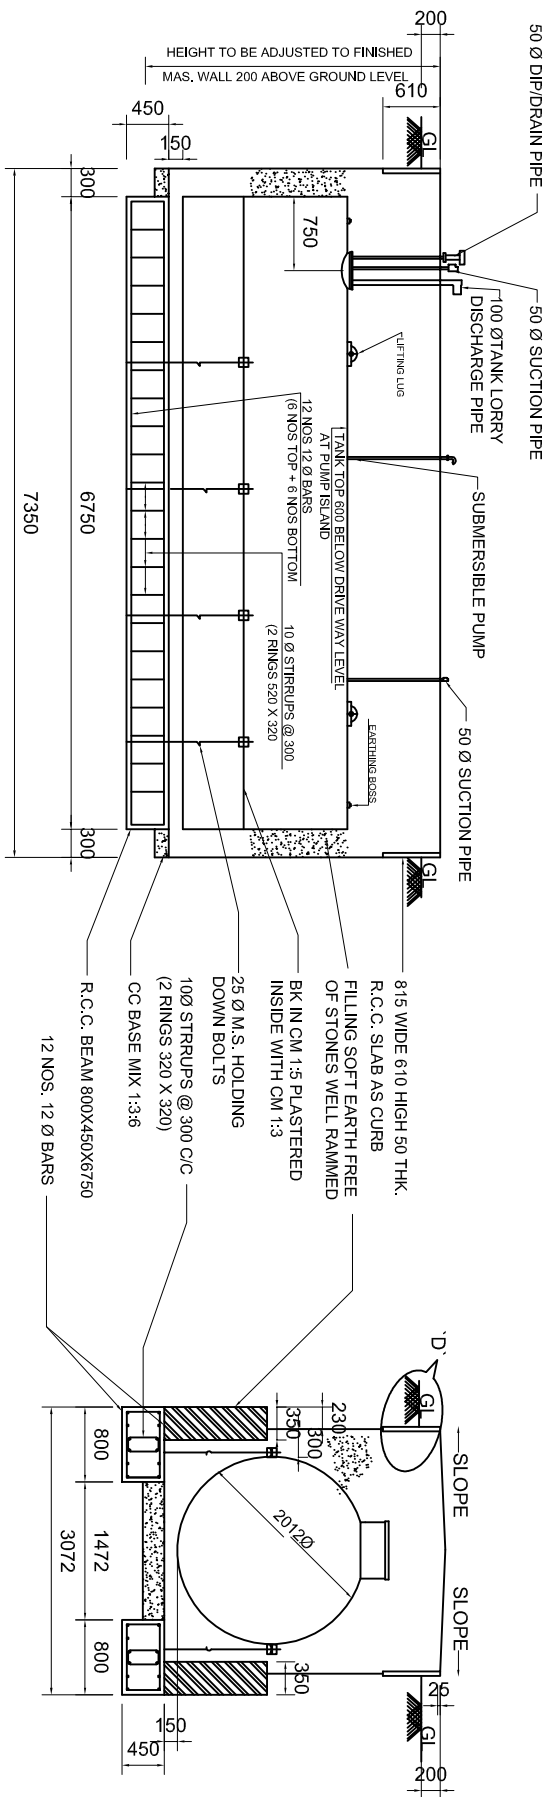


SECTION A-A

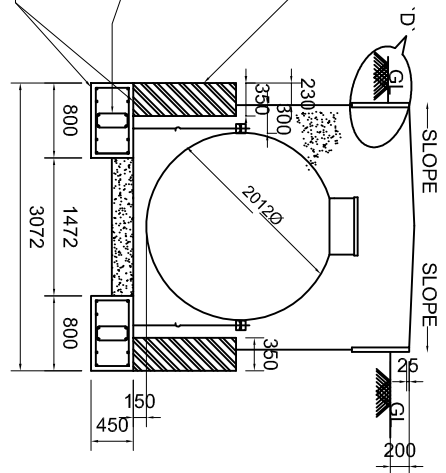

SECTION B-B

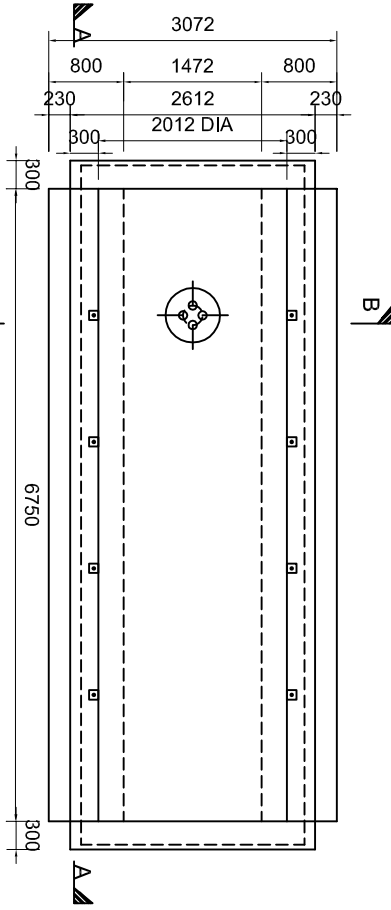

PLAN

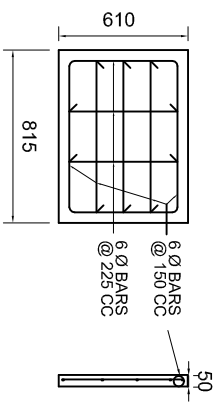

DETAIL 'D' R.C.C. SLAB AS CURB

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMALTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL AND RCC CURB
- 3) RCC BEAM SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

TANK IN EARTH PIT WITH HOLDING DOWN ARRANGEMEANT

BHARAT PETROLEUM CORPORATION LTD.				DATE	DRAWING NO.
TITLE: INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE :-	DRAWN:	CHECKED	SHEET NO.	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE.DRG. 402	