

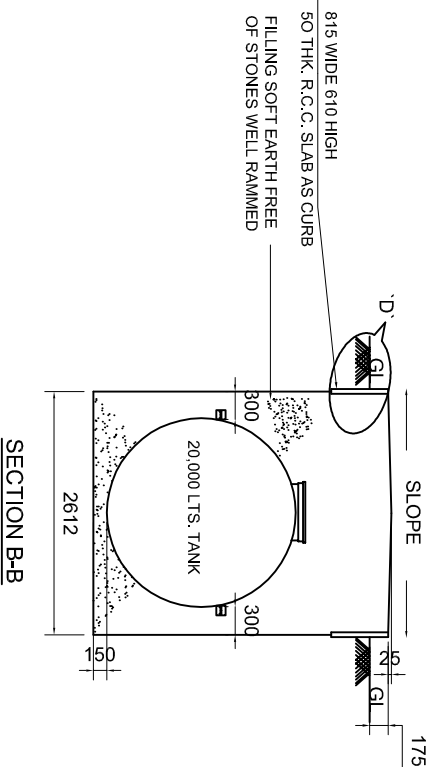


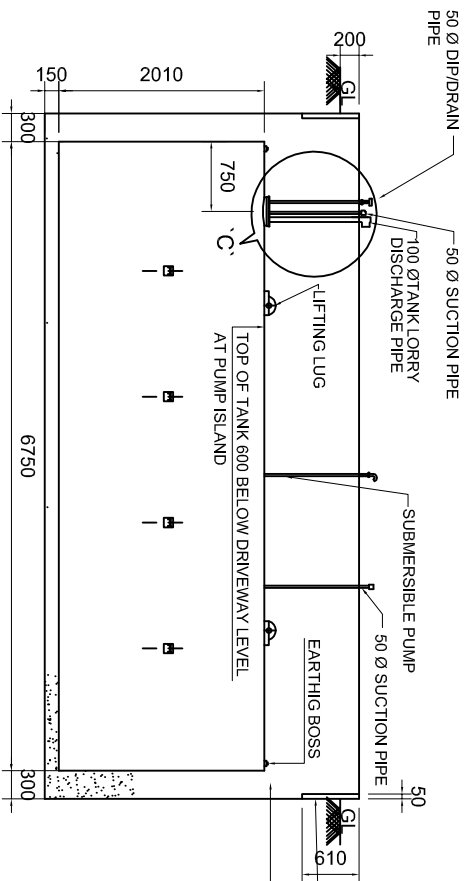


SECTION A-A

SECTION B-B

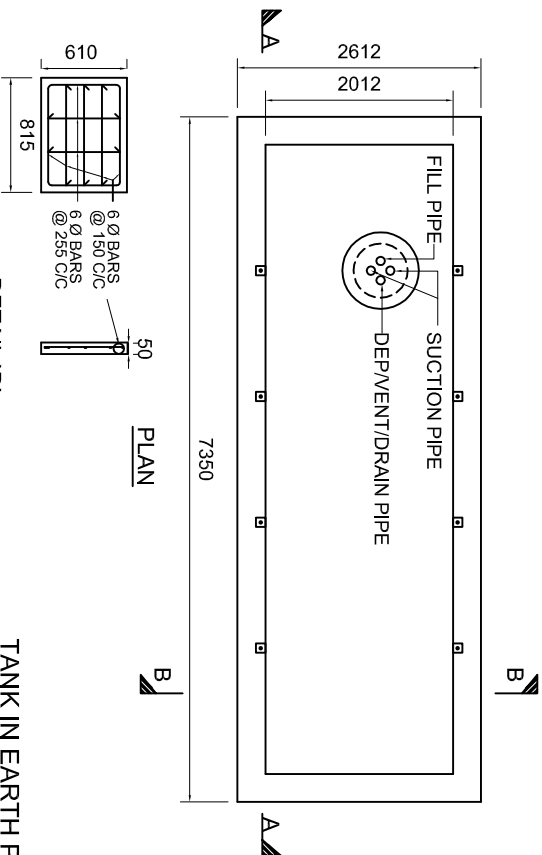

DETAIL 'D'
R.C.C. SLAB

TANK IN EARTH PIT

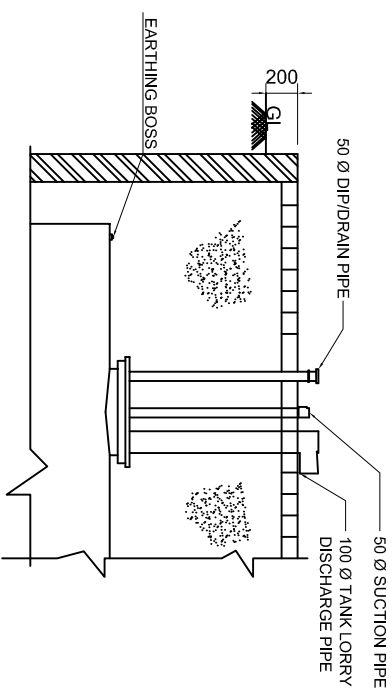

DETAILS AT 'C'
(REFER DETAIL DRG. NO. RE 382)

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP R/C SUPPLIED WITH THE TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG INSTEAD OF STANDARD 2350

BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK				DATE	DRAWING NO.
SCALE :-				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
DRAWN:	CHECKED	SHEET NO.		DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)	1 OF 1		RE.DRG. 402	