




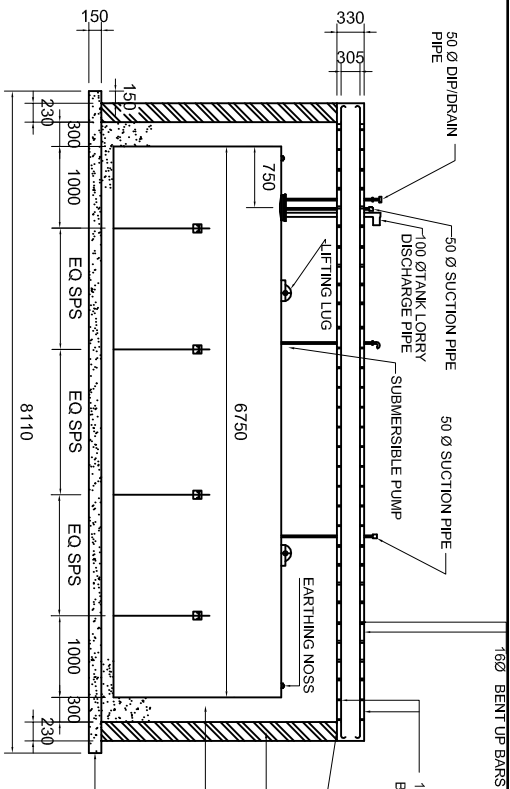


SECTION A-A

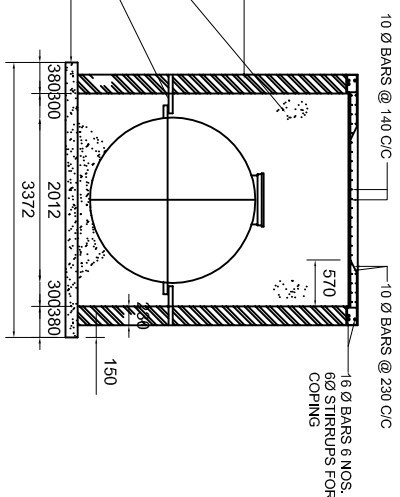




SECTION B-B

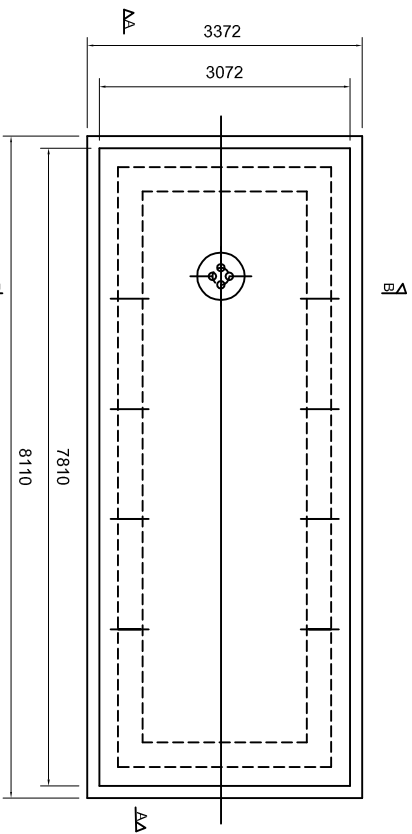

PLAN



CROSS SECTION OF R.C.C. SLAB

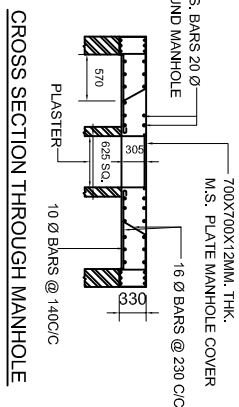

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH, IS HARD NON YELDING LAYER, IN SUCH CASE ONLY 530 WIDE X 150 THK. FLITING UNDER MASONRY WALLS SHOULD BE PROVIDED.

BHARAT PETROLEUM CORPORATION LTD.

TITLE: INSTALLATION DETAILS OF 20,000 LITRES

CYLINDRICAL UNDERGROUND TANK

SCALE :-

DATE : 20/12/1999

DATE

DRAWING NO.

NUMBERS CROSSED OUT ARE
SUPERSEDED DRAWINGS

DRAWING NO.

RE.DRG. 402