

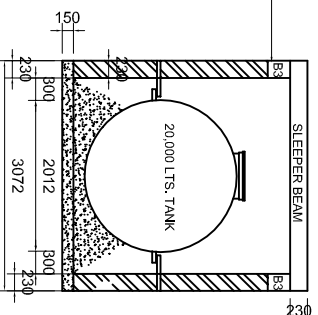
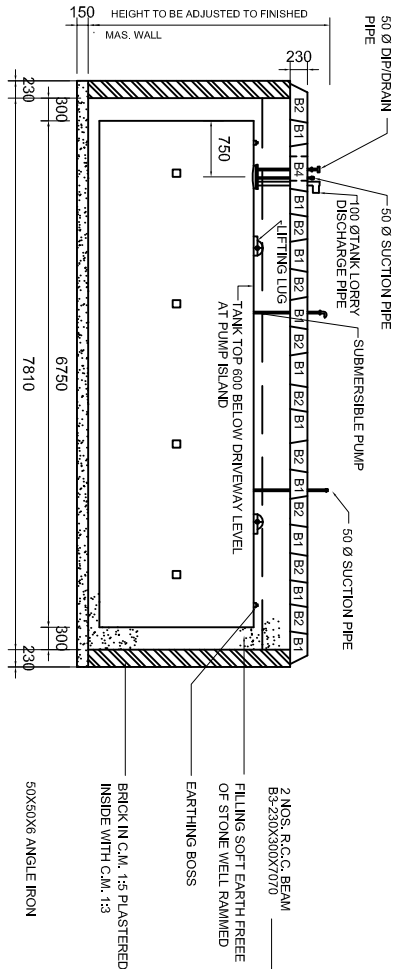


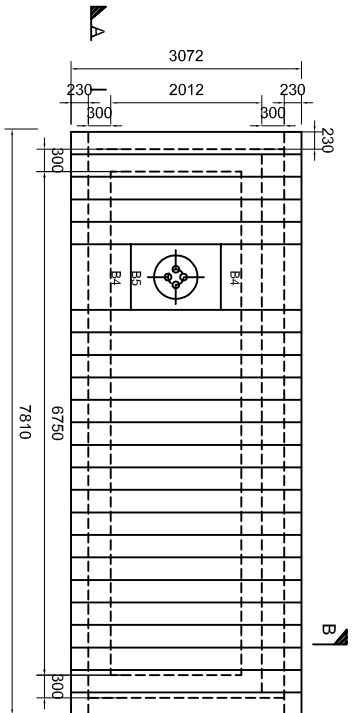


SECTION A-A

SECTION B-B



PLAN

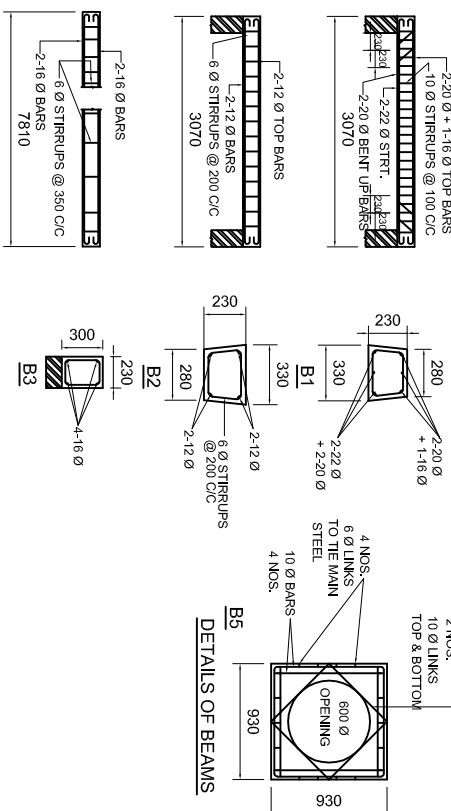


DETAILS OF BEAMS

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH IS HARD NON YELDING LAYER. IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.
- 3) BEAMS B1, B2, B4, & B5 MAY BE CAST IN SITU. BEAM B1 SHOULD BE CAST FIRST & AFTER CURING, PAPER SEPARATOR SHOULD BE GLUED TO THE FACES ADJOINING. BEAMS B2, B4, & B5 BEFORE THESE BEAMS ARE CAST.

DETAILS OF MANHOLE COVER

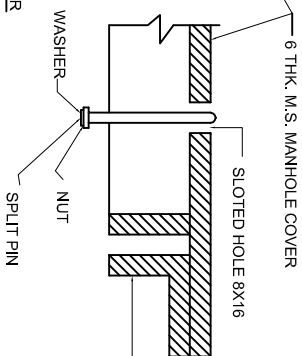

25X25X5 L CURBING

TANK IN MASONRY PIT WITH R.C.C. SLEEPER BEAM ON TOP

BHARAT PETROLEUM CORPORATION LTD.

TITLE: INSTALLATION DETAILS OF 20,000 LITRES

CYLINDRICAL UNDERGROUND TANK

SCALE :- DRAWN: St. Mgr. (DESIGN & DEVP.)

CHECKED

SHEET NO. 1 OF 1

DATE DRAWING NO.

NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS

DRAWING NO. RE.DRG. 402