



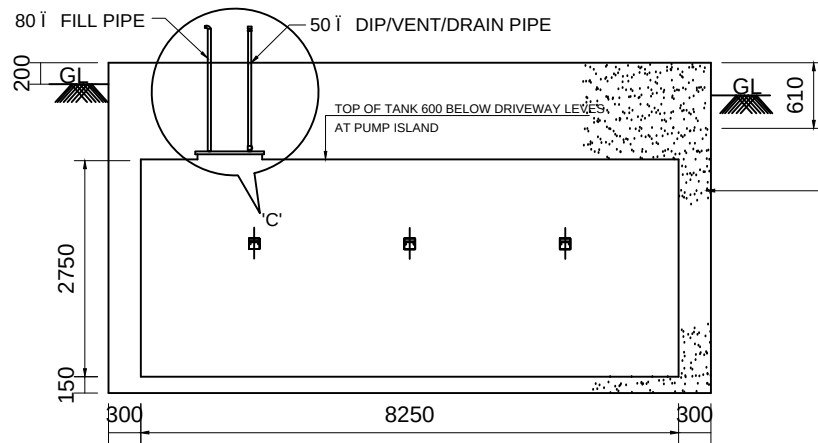


SECTION A-A

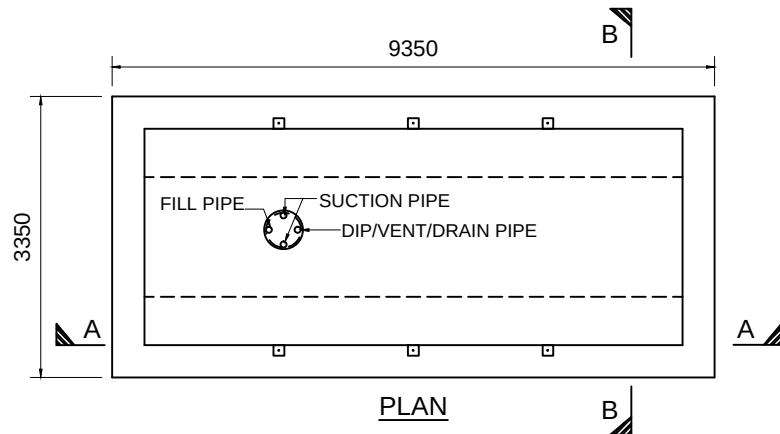


PLAN

TANK IN EARTH PIT

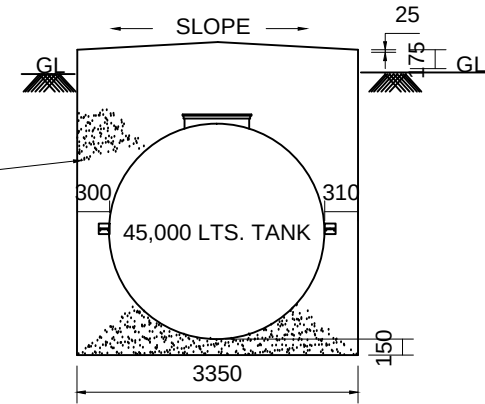

SECTION B-B

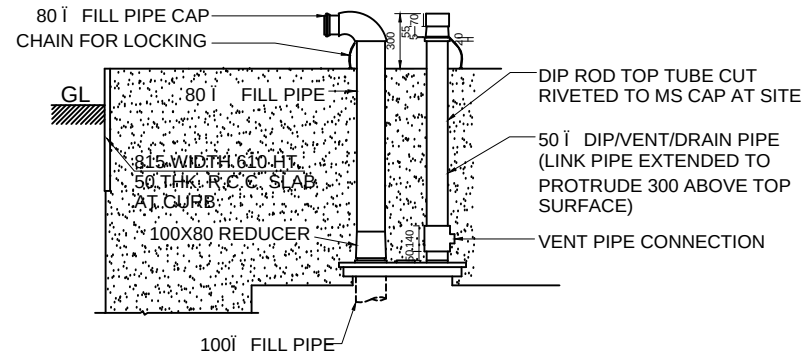

DETAILS AT 'C'

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG. INSTEAD OF STANDARD 2350

BHARAT PETROLEUM CORPORATION LTD.				DATE	DRAWING NO.
TITLE: INSTALLATION DETAILS OF 45,000 LITRES CYLINDRICAL UNDERGROUND TANK IN EARTHEN PIT				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE :-	DRAWN:	CHECKED	SHEET NO.	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE.DRG. 401 E. IS. 01. 019	